

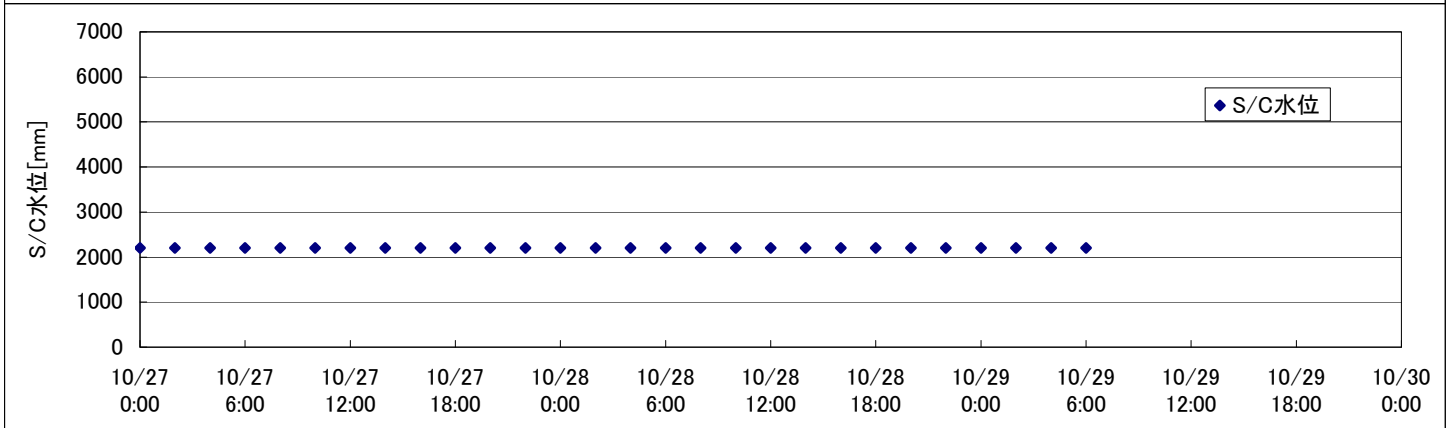
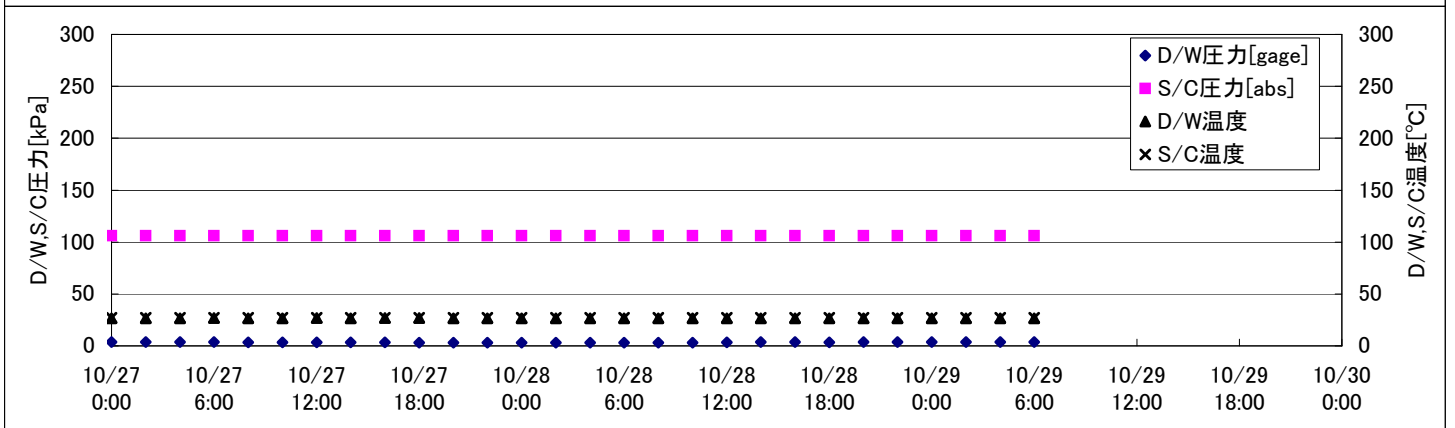
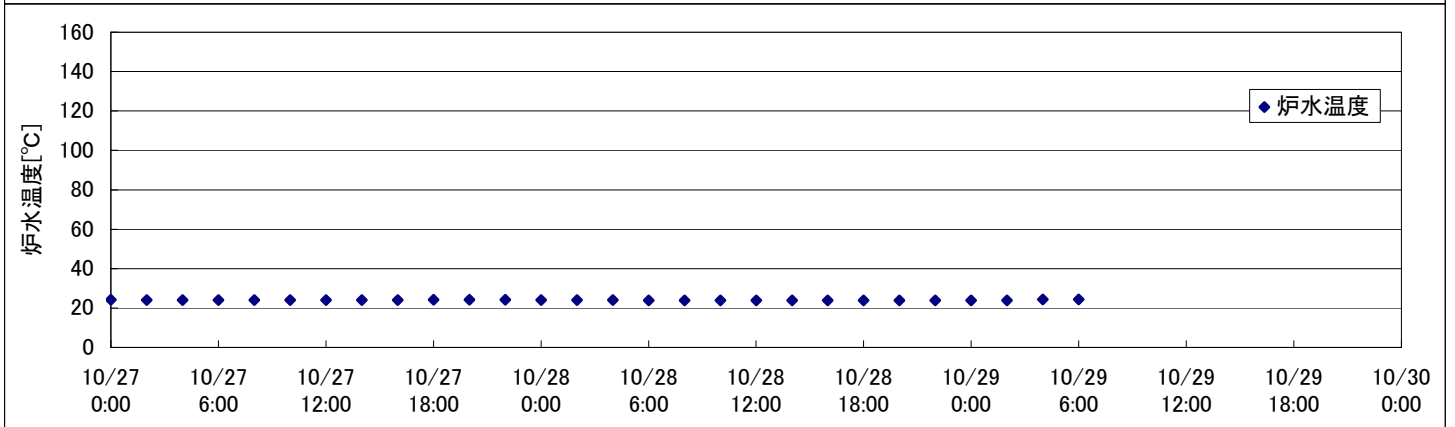
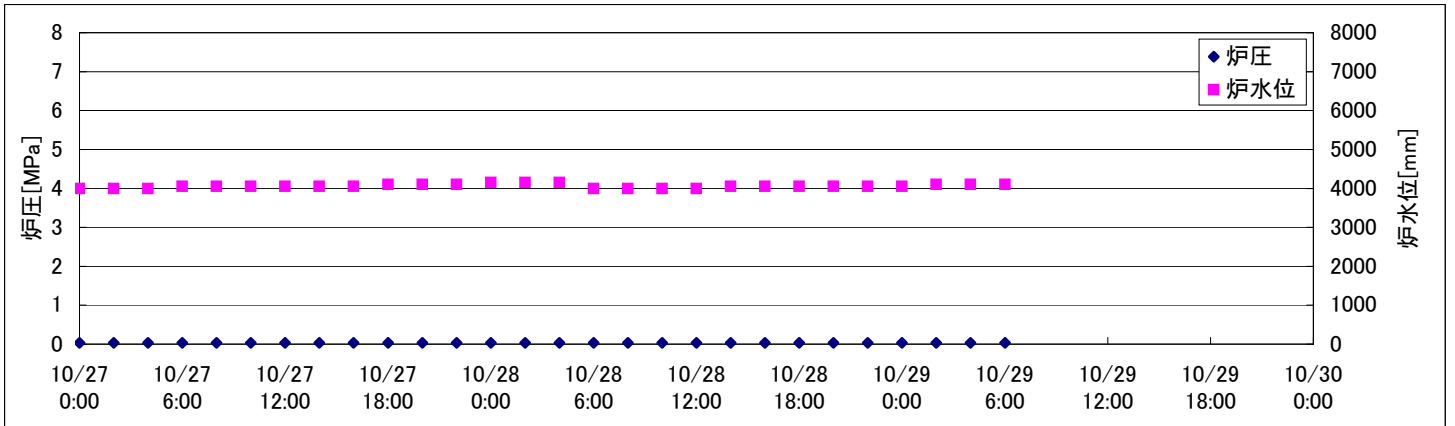
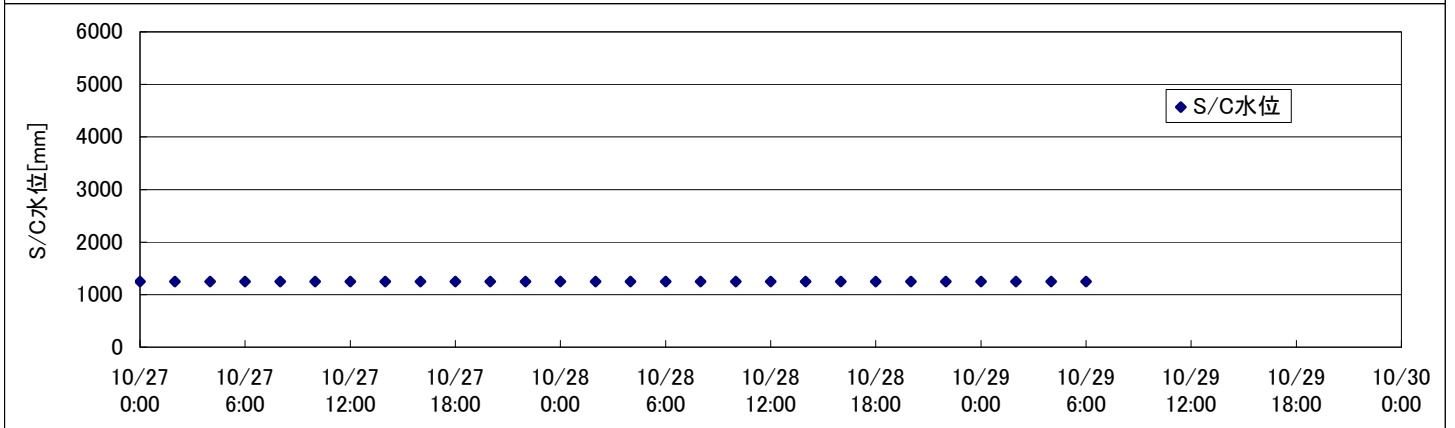
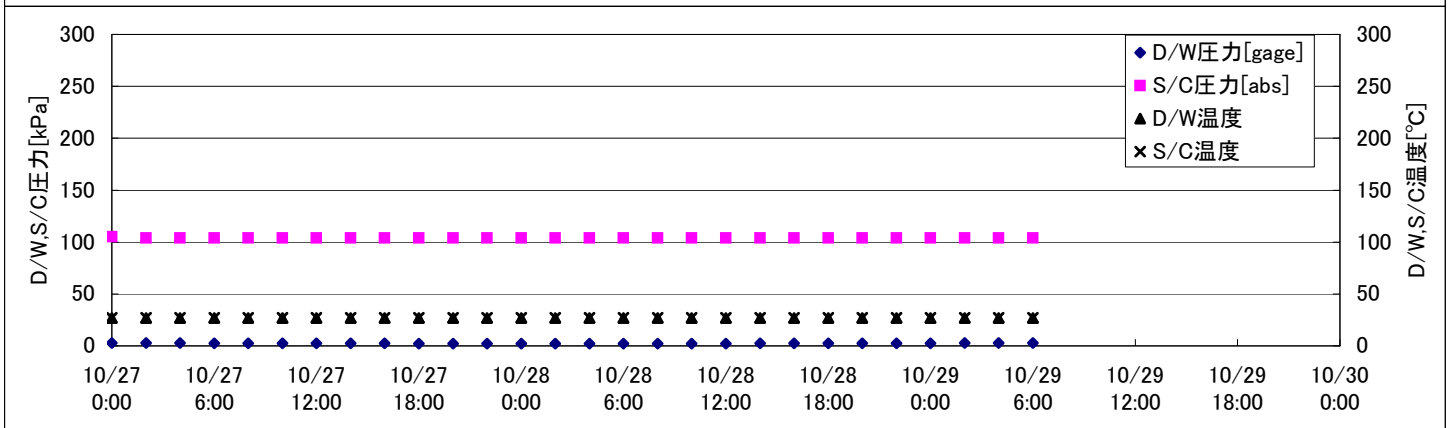






2F-1号機

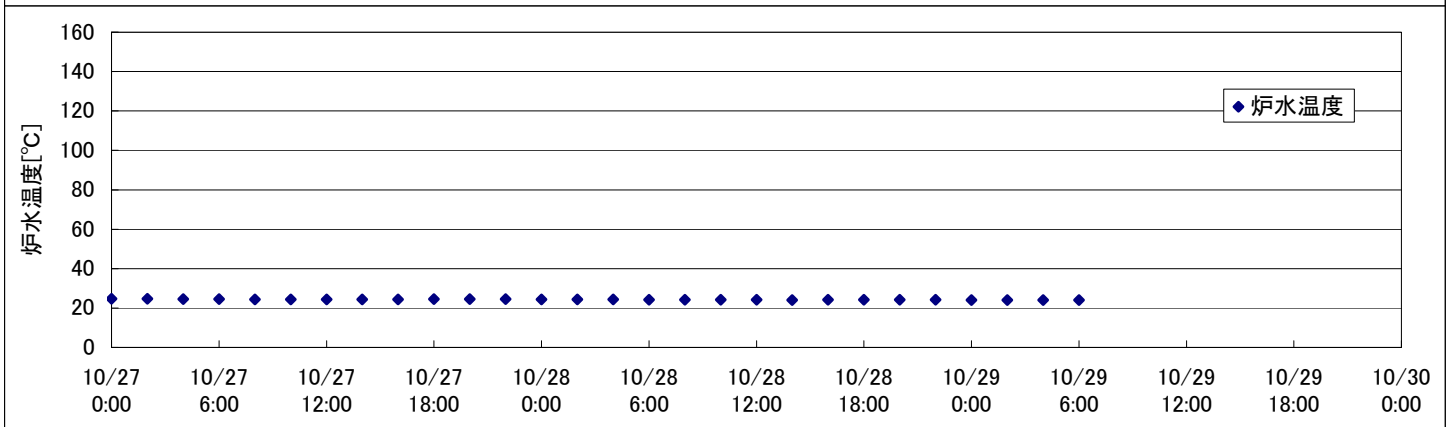





2F-2号機

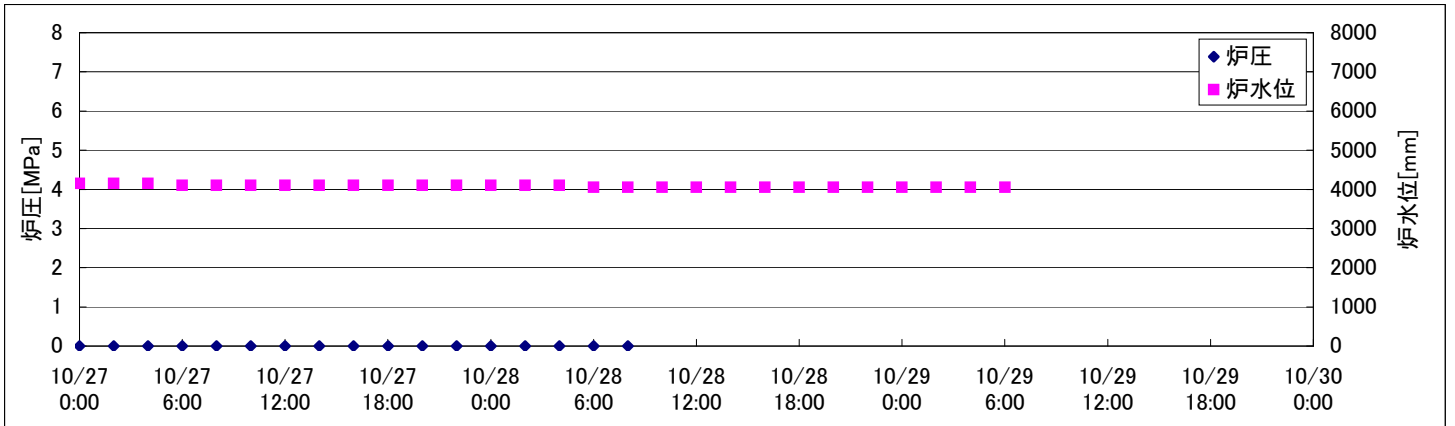

2F-3号機

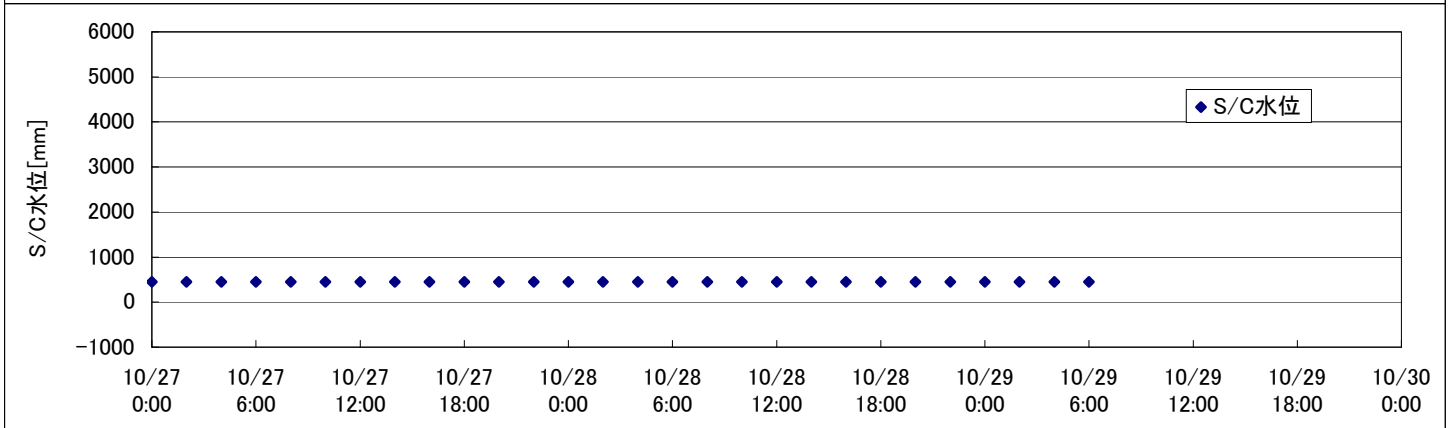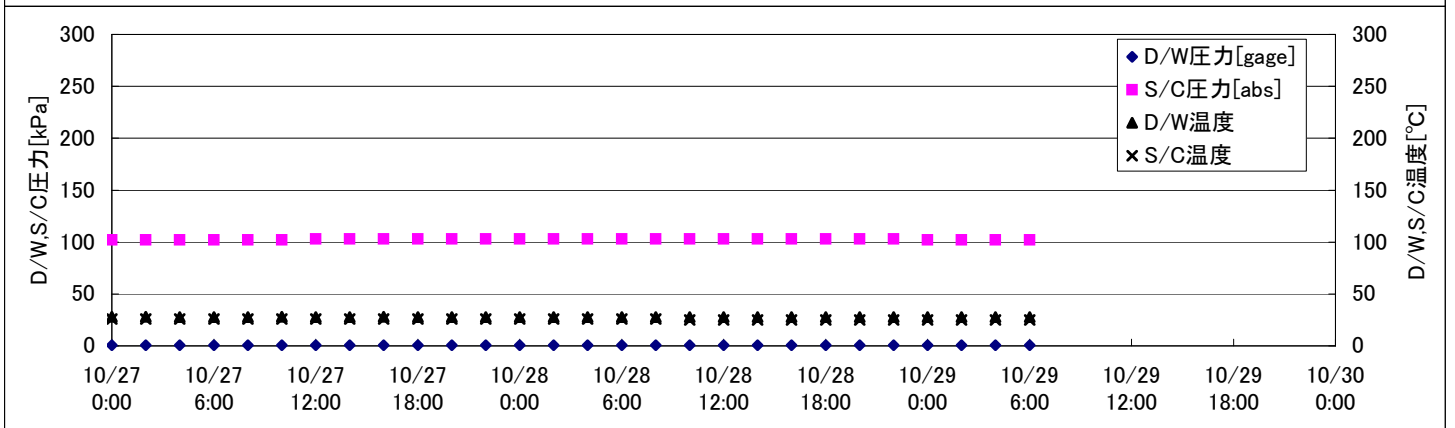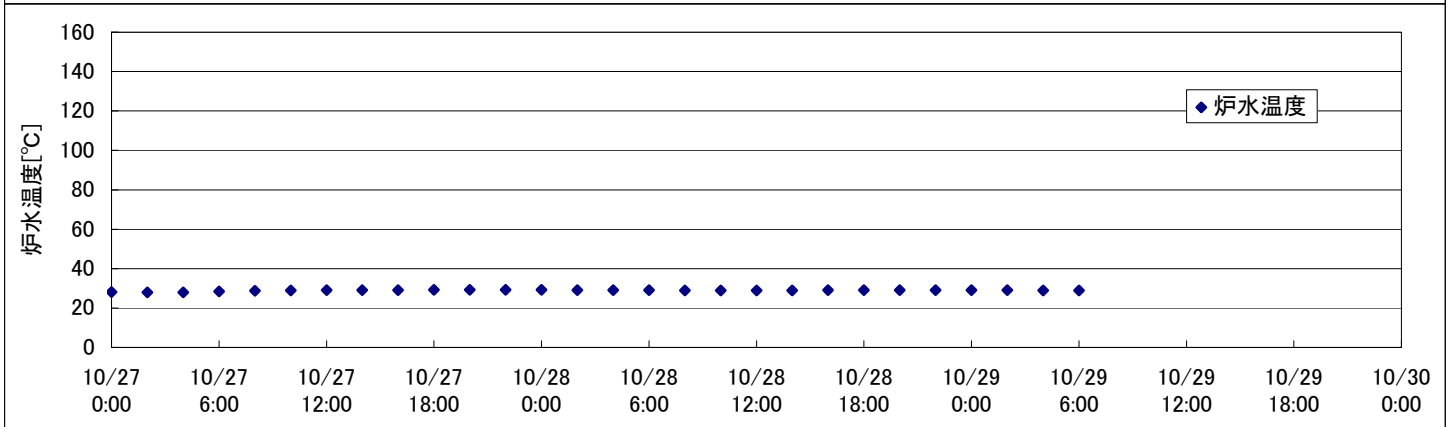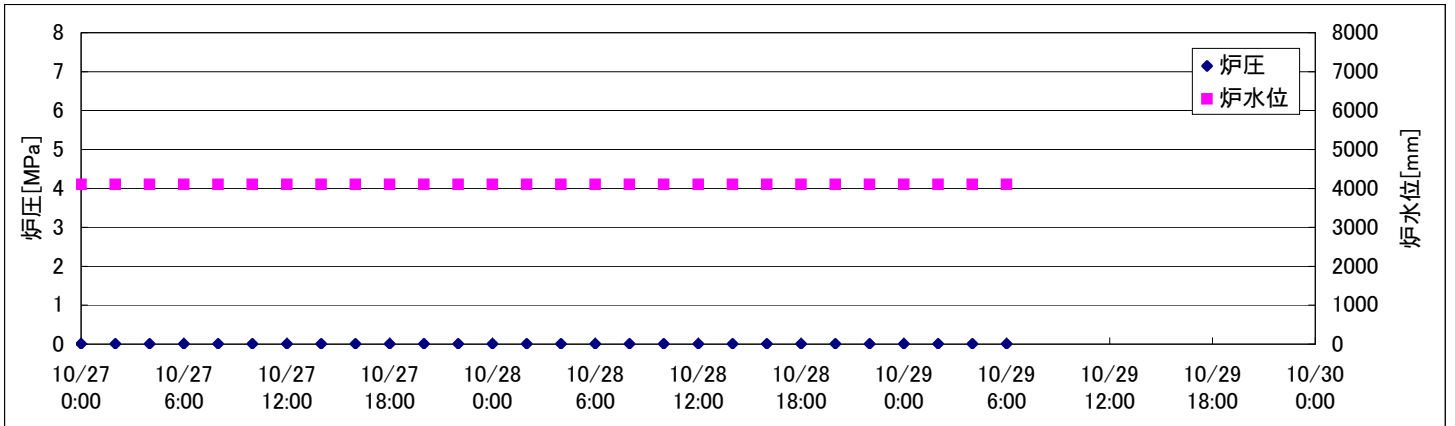

2F-4号機

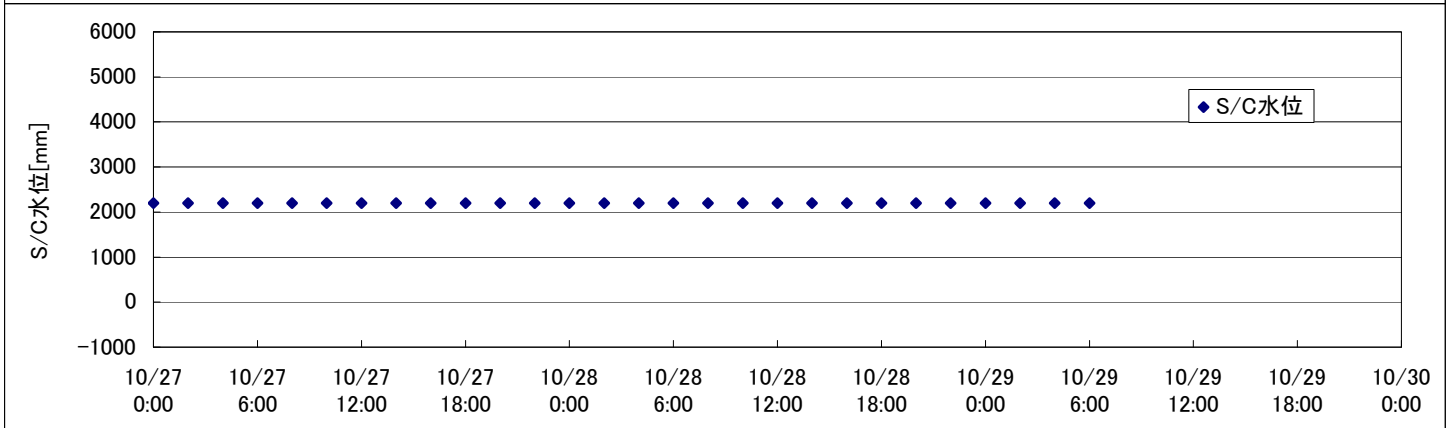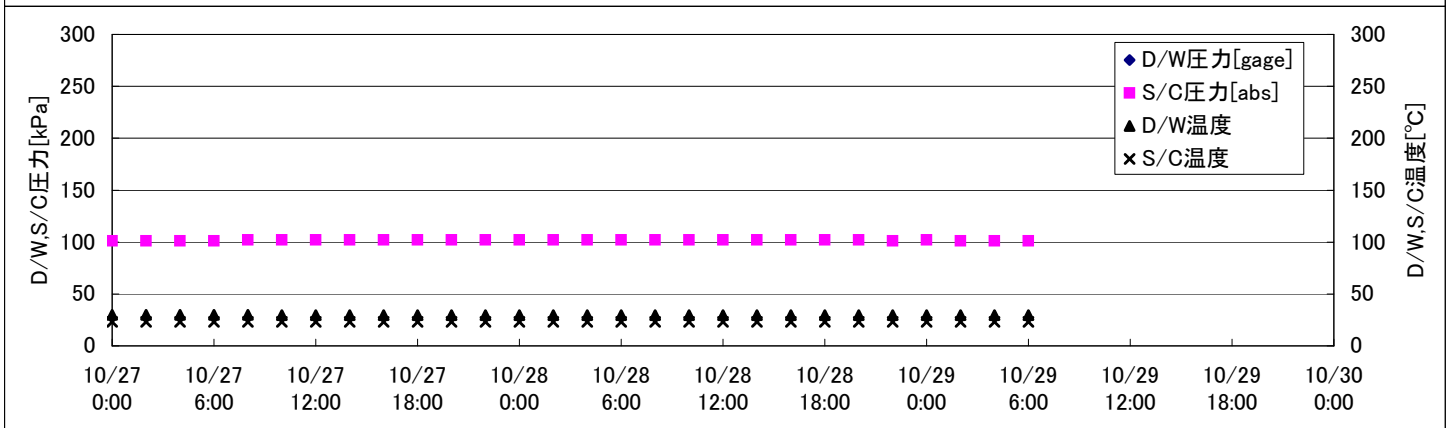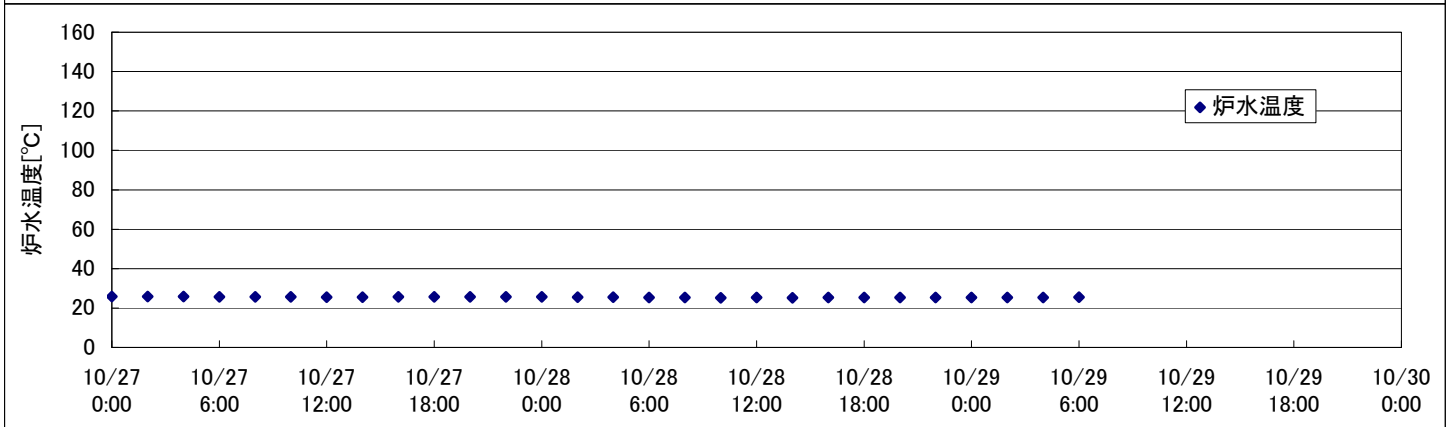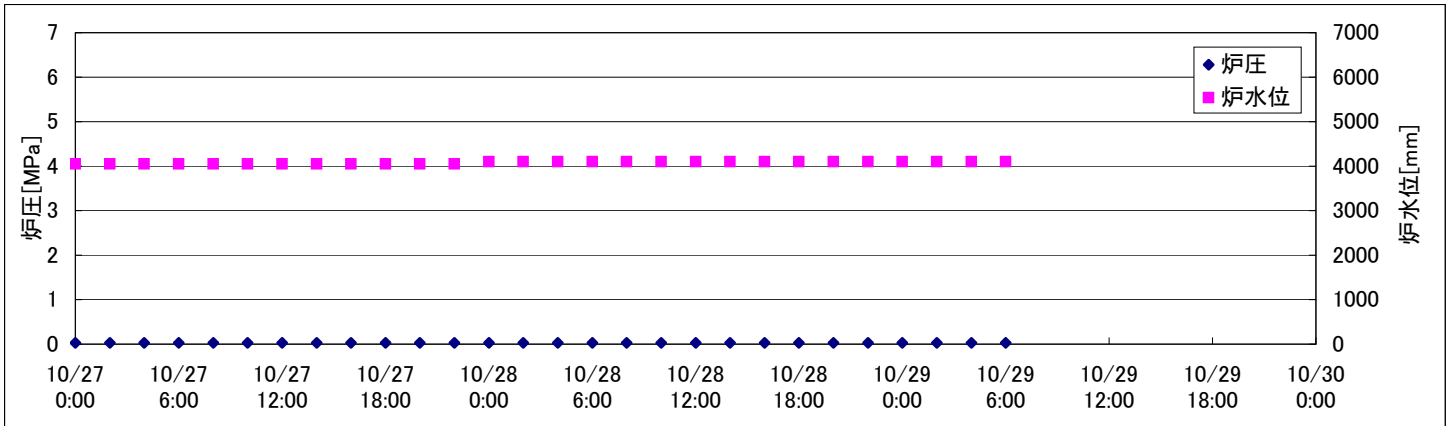





2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]





時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/10/27 0:00	0.03	4050	25.9		29.9	101	2200	23
2011/10/27 2:00	0.03	4050	25.9		29.9	101	2200	23
2011/10/27 4:00	0.03	4050	25.8		30.0	101	2200	23
2011/10/27 6:00	0.03	4050	25.7		29.9	101	2200	23
2011/10/27 8:00	0.03	4050	25.6		29.9	102	2200	23
2011/10/27 10:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 12:00	0.03	4050	25.5		29.7	102	2200	23
2011/10/27 14:00	0.03	4050	25.5		29.7	102	2200	23
2011/10/27 16:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 18:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 20:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 22:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/28 0:00	0.03	4100	25.6		29.7	102	2200	23
2011/10/28 2:00	0.03	4100	25.5		29.7	102	2200	23
2011/10/28 4:00	0.03	4100	25.5		29.7	102	2200	23
2011/10/28 6:00	0.03	4100	25.4		29.7	102	2200	23
2011/10/28 8:00	0.03	4100	25.3		29.7	102	2200	23
2011/10/28 10:00	0.03	4100	25.2		29.6	102	2200	23
2011/10/28 12:00	0.03	4100	25.3		29.6	102	2200	23
2011/10/28 14:00	0.03	4100	25.2		29.6	102	2200	23
2011/10/28 16:00	0.03	4100	25.3		29.6	102	2200	23
2011/10/28 18:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/28 20:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/28 22:00	0.03	4100	25.4		29.6	101	2200	23
2011/10/29 0:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/29 2:00	0.03	4100	25.4		29.6	101	2200	23
2011/10/29 4:00	0.03	4100	25.3		29.5	101	2200	23
2011/10/29 6:00	0.03	4100	25.5		29.5	101	2200	23
2011/10/29 8:00								
2011/10/29 10:00								
2011/10/29 12:00								
2011/10/29 14:00								
2011/10/29 16:00								
2011/10/29 18:00								
2011/10/29 20:00								
2011/10/29 22:00								
2011/10/30 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず





2F-1号機

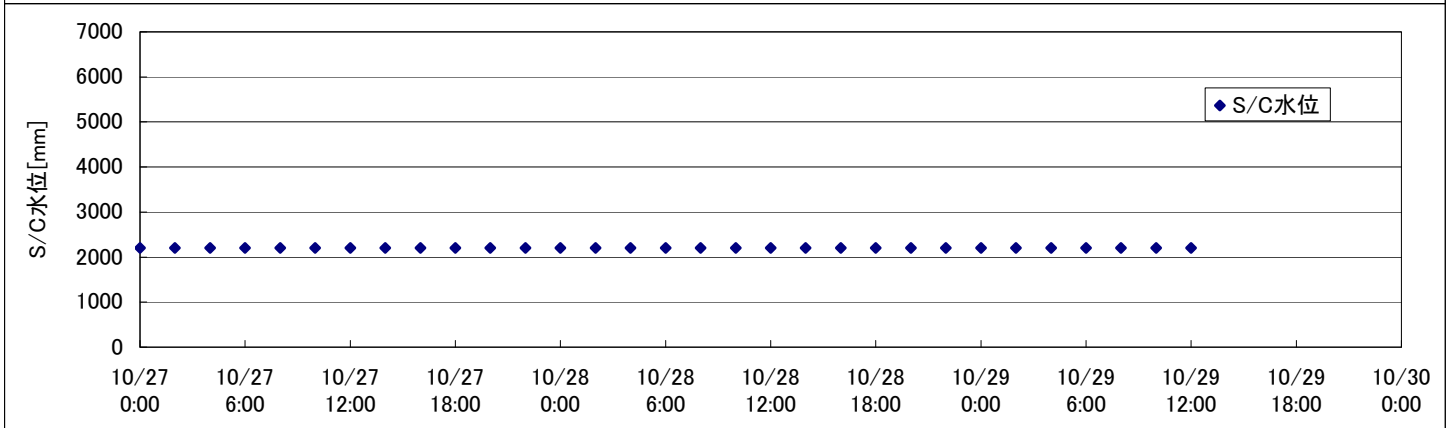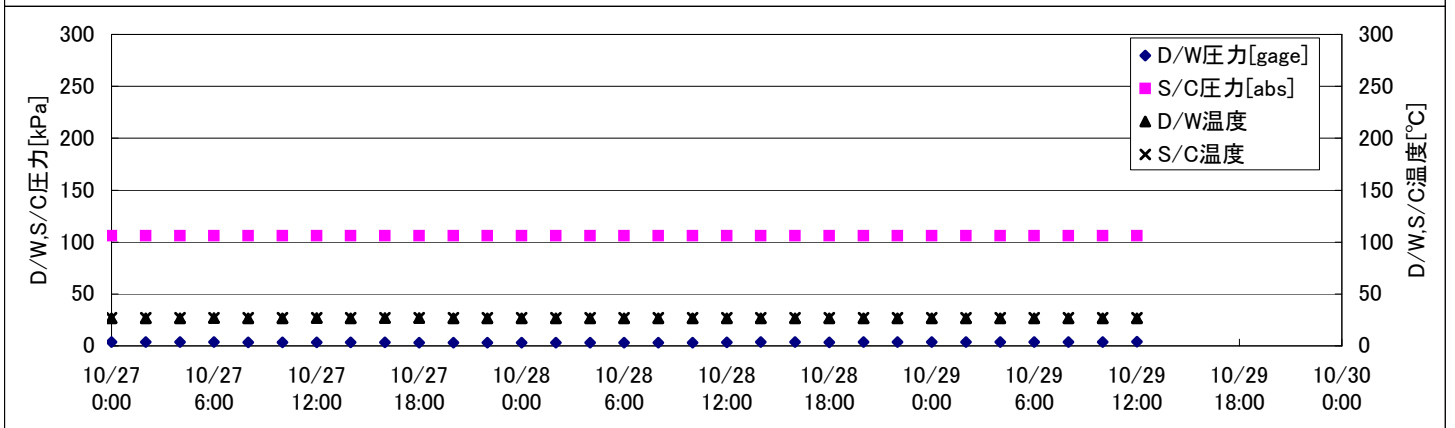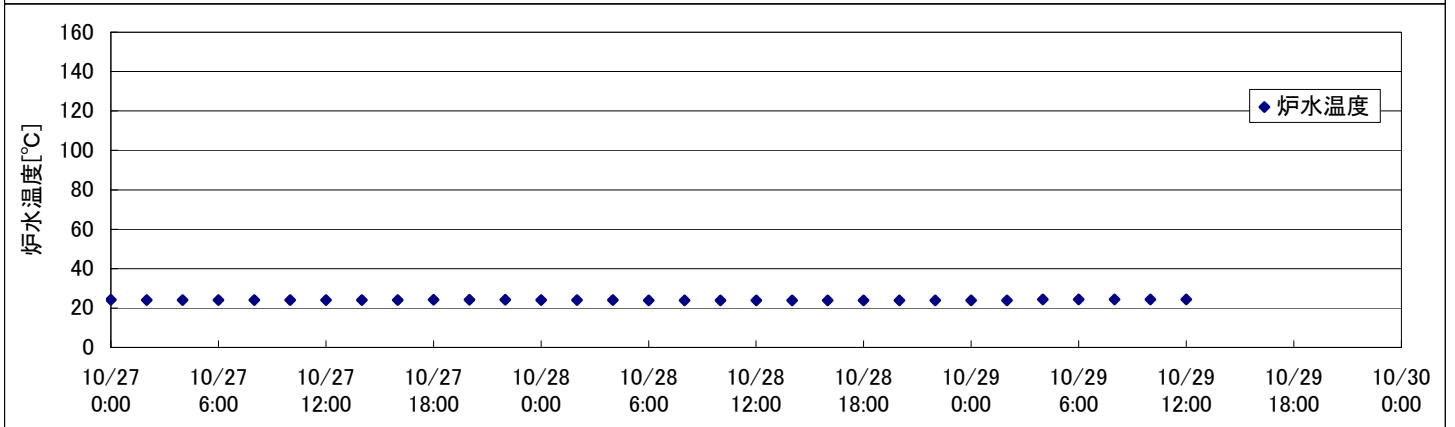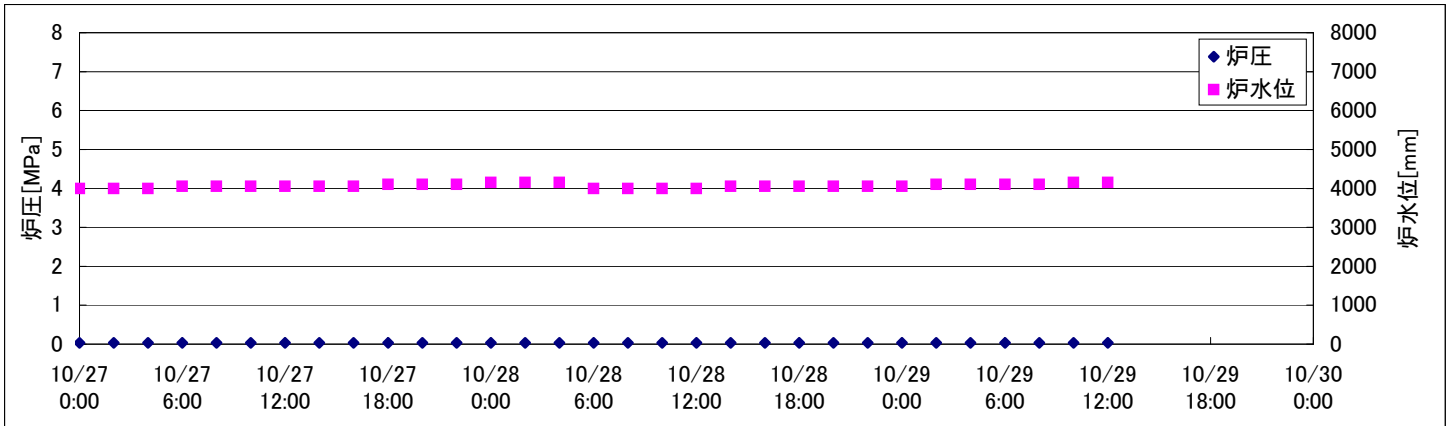





2F-2号機

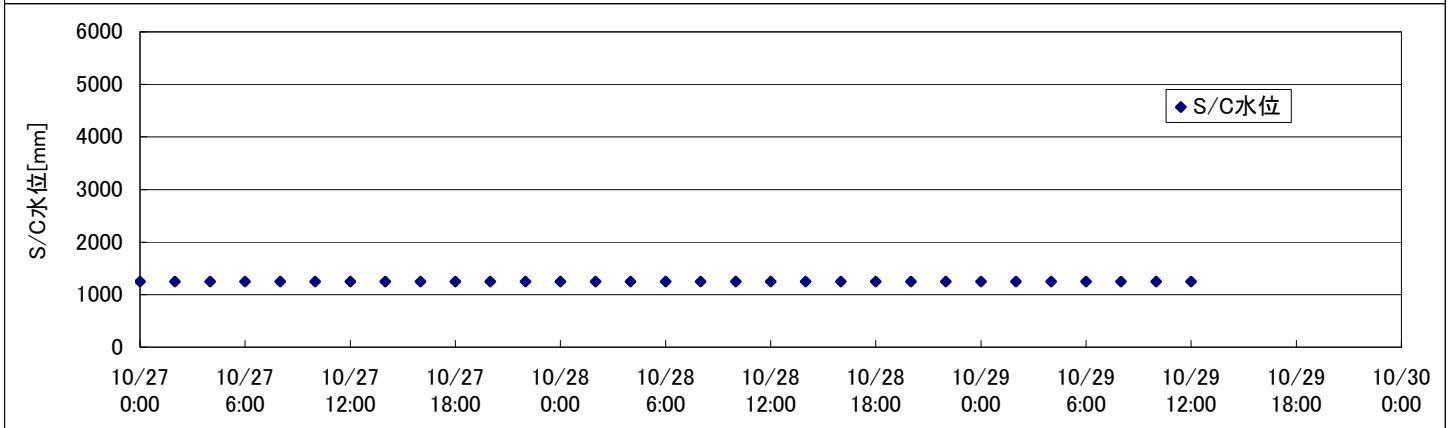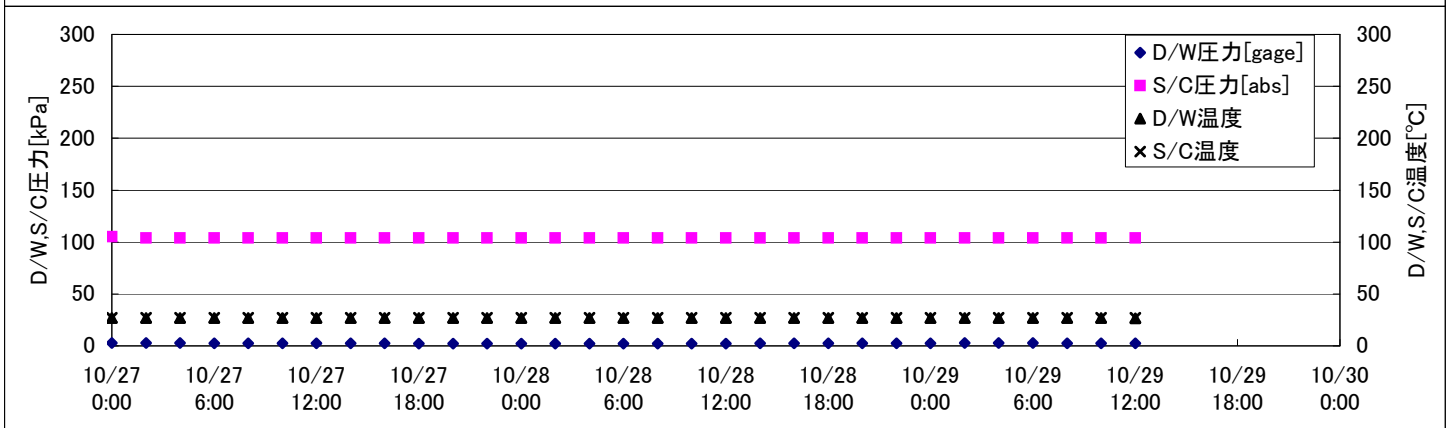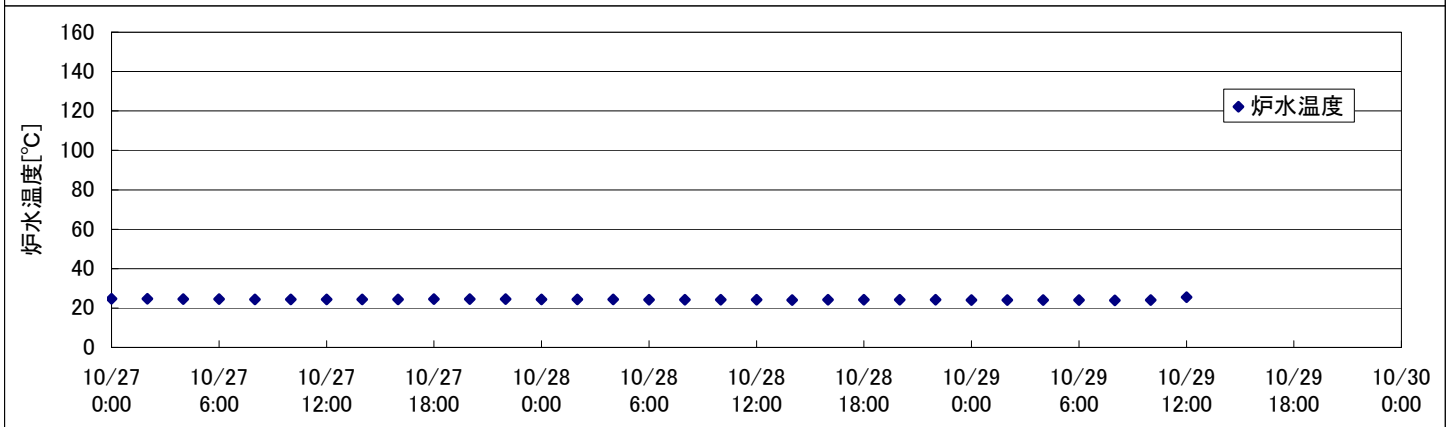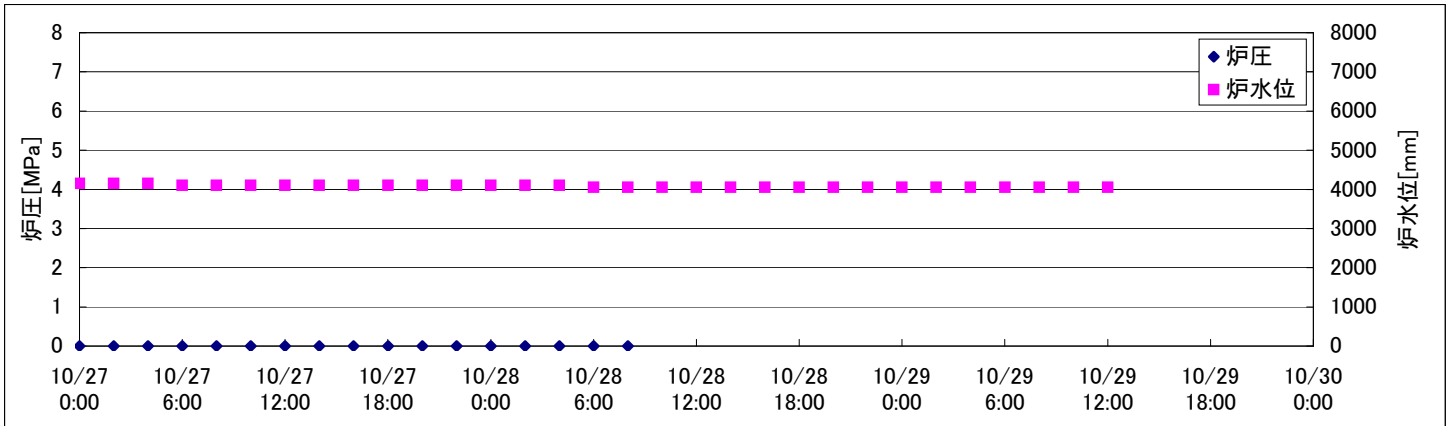

2F-3号機

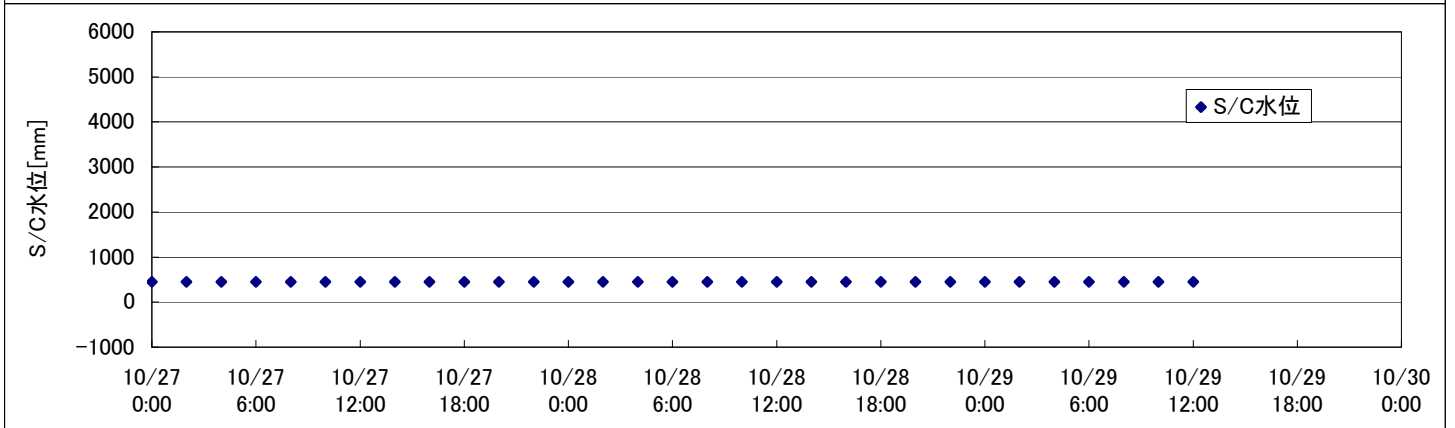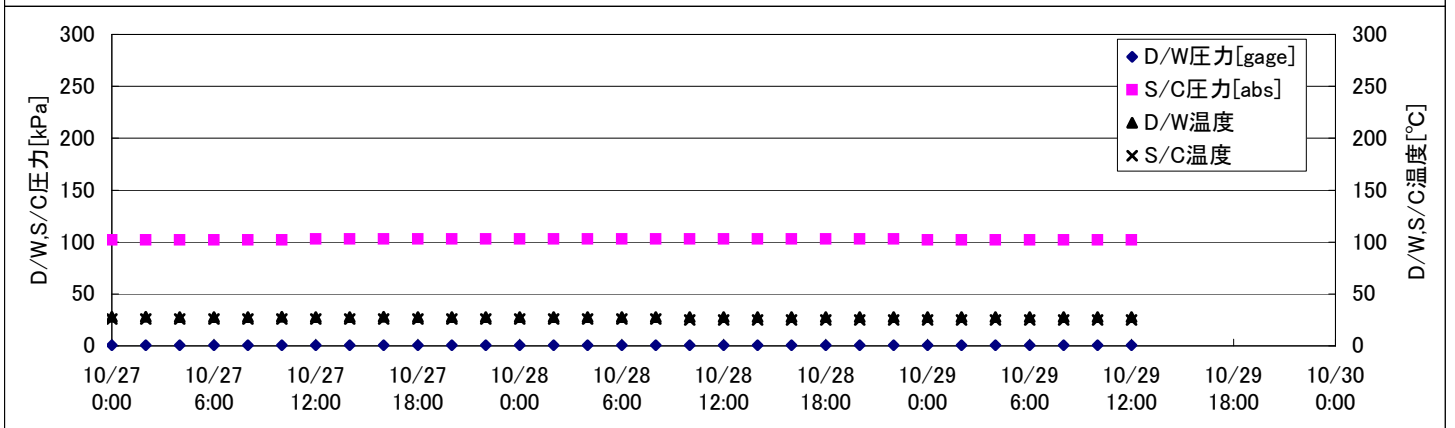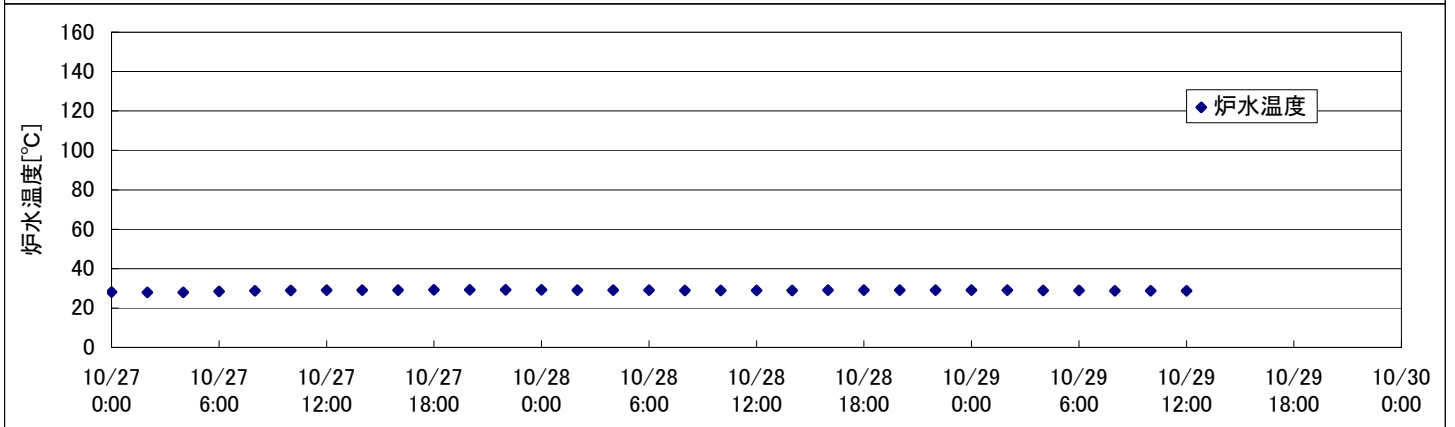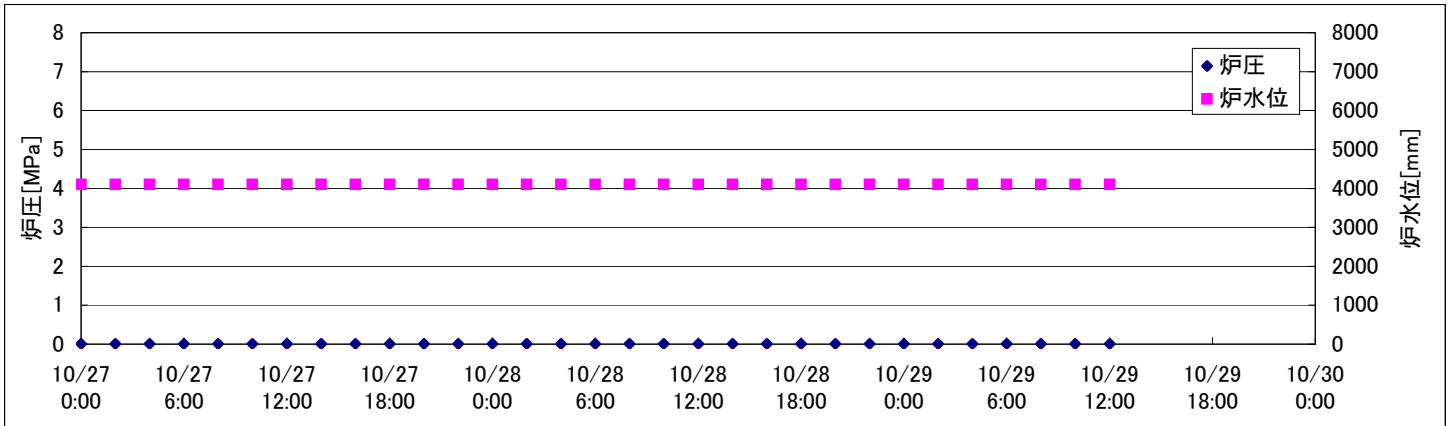

2F-4号機

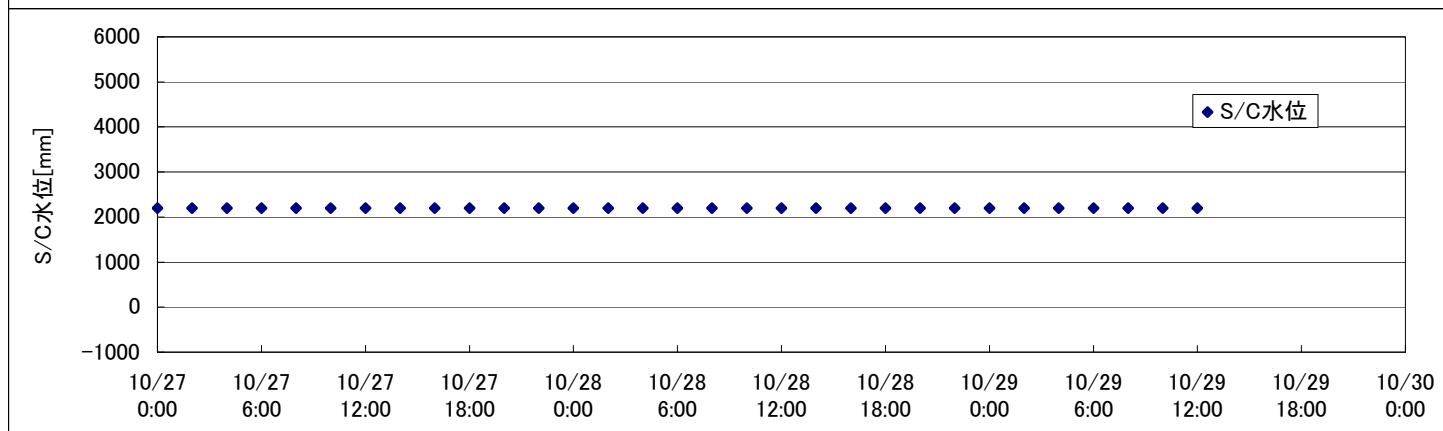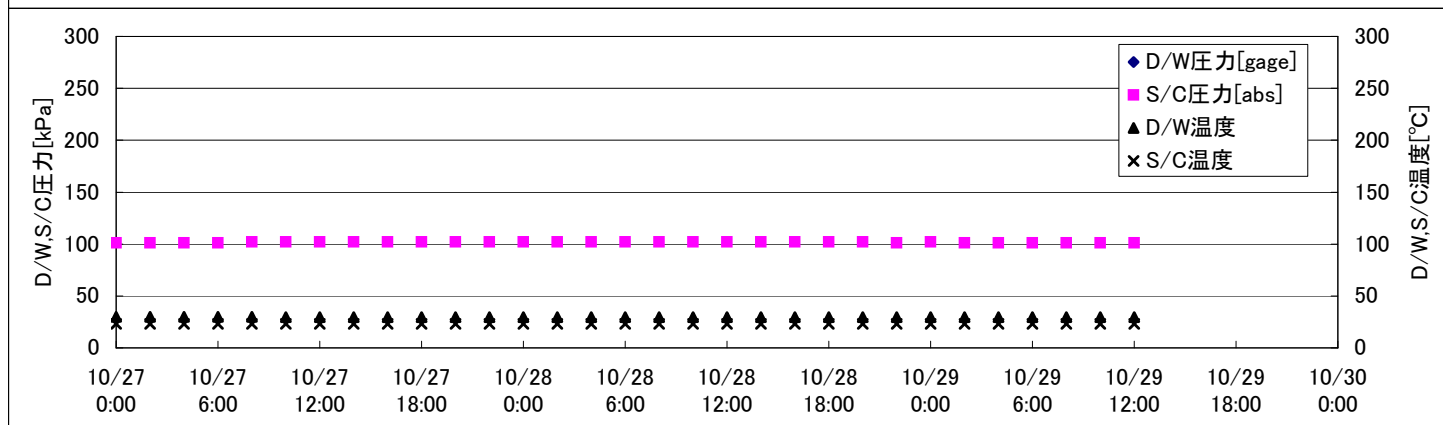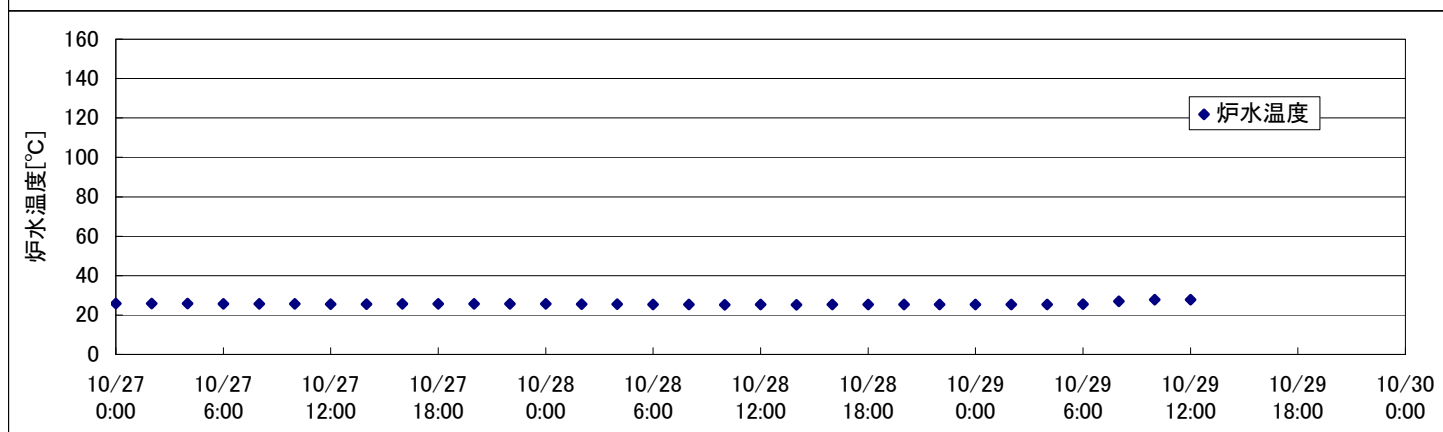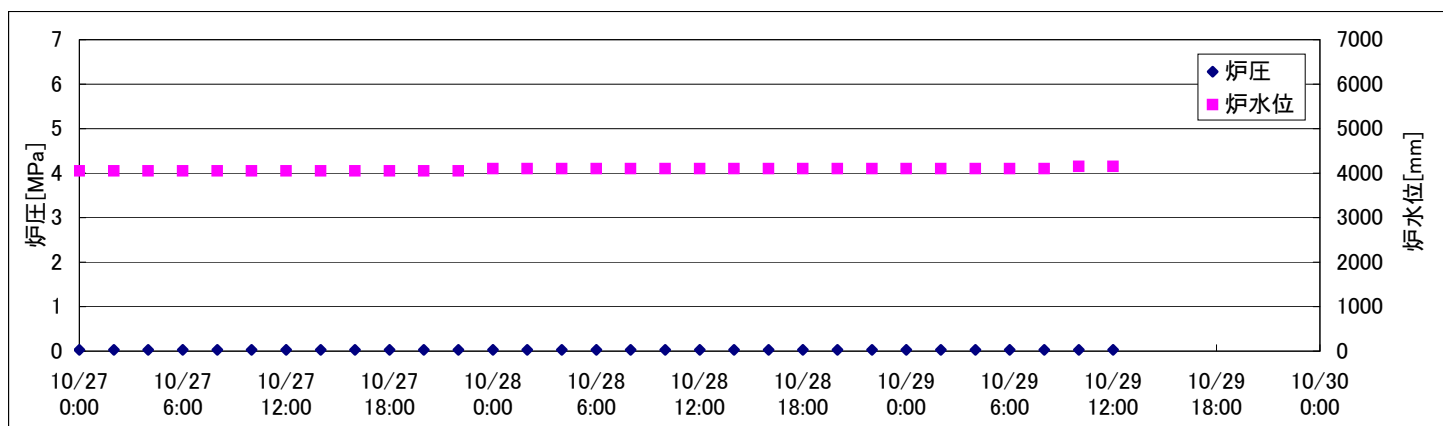

2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]

時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/10/27 0:00	0.03	4050	25.9		29.9	101	2200	23
2011/10/27 2:00	0.03	4050	25.9		29.9	101	2200	23
2011/10/27 4:00	0.03	4050	25.8		30.0	101	2200	23
2011/10/27 6:00	0.03	4050	25.7		29.9	101	2200	23
2011/10/27 8:00	0.03	4050	25.6		29.9	102	2200	23
2011/10/27 10:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 12:00	0.03	4050	25.5		29.7	102	2200	23
2011/10/27 14:00	0.03	4050	25.5		29.7	102	2200	23
2011/10/27 16:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 18:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 20:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/27 22:00	0.03	4050	25.6		29.7	102	2200	23
2011/10/28 0:00	0.03	4100	25.6		29.7	102	2200	23
2011/10/28 2:00	0.03	4100	25.5		29.7	102	2200	23
2011/10/28 4:00	0.03	4100	25.5		29.7	102	2200	23
2011/10/28 6:00	0.03	4100	25.4		29.7	102	2200	23
2011/10/28 8:00	0.03	4100	25.3		29.7	102	2200	23
2011/10/28 10:00	0.03	4100	25.2		29.6	102	2200	23
2011/10/28 12:00	0.03	4100	25.3		29.6	102	2200	23
2011/10/28 14:00	0.03	4100	25.2		29.6	102	2200	23
2011/10/28 16:00	0.03	4100	25.3		29.6	102	2200	23
2011/10/28 18:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/28 20:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/28 22:00	0.03	4100	25.4		29.6	101	2200	23
2011/10/29 0:00	0.03	4100	25.4		29.6	102	2200	23
2011/10/29 2:00	0.03	4100	25.4		29.6	101	2200	23
2011/10/29 4:00	0.03	4100	25.3		29.5	101	2200	23
2011/10/29 6:00	0.03	4100	25.5		29.5	101	2200	23
2011/10/29 8:00	0.03	4100	27.0		29.6	101	2200	23
2011/10/29 10:00	0.03	4150	27.7		29.6	101	2200	23
2011/10/29 12:00	0.03	4150	27.8		29.5	101	2200	23
2011/10/29 14:00								
2011/10/29 16:00								
2011/10/29 18:00								
2011/10/29 20:00								
2011/10/29 22:00								
2011/10/30 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず