

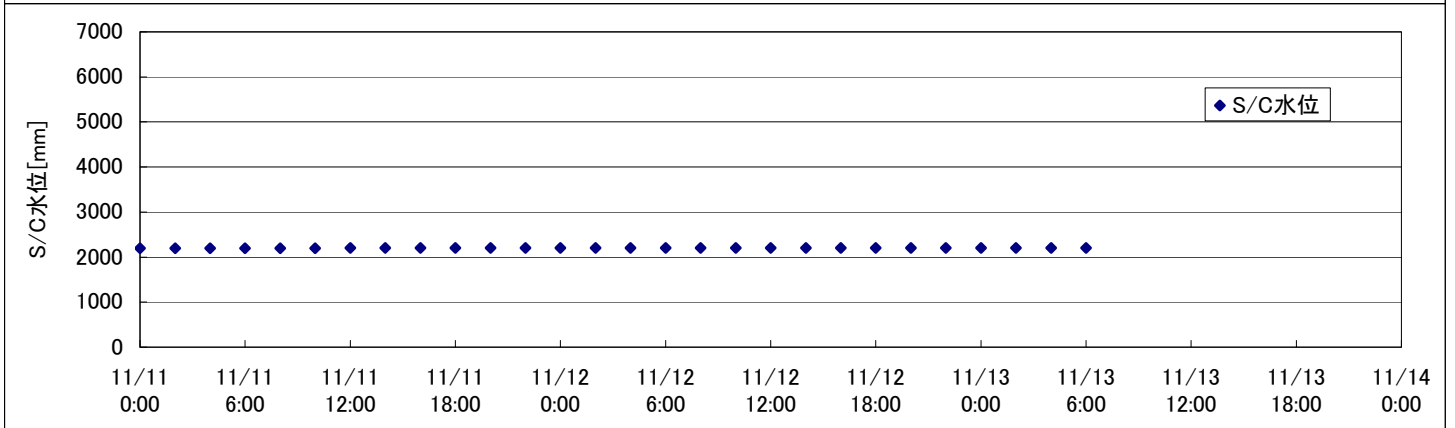
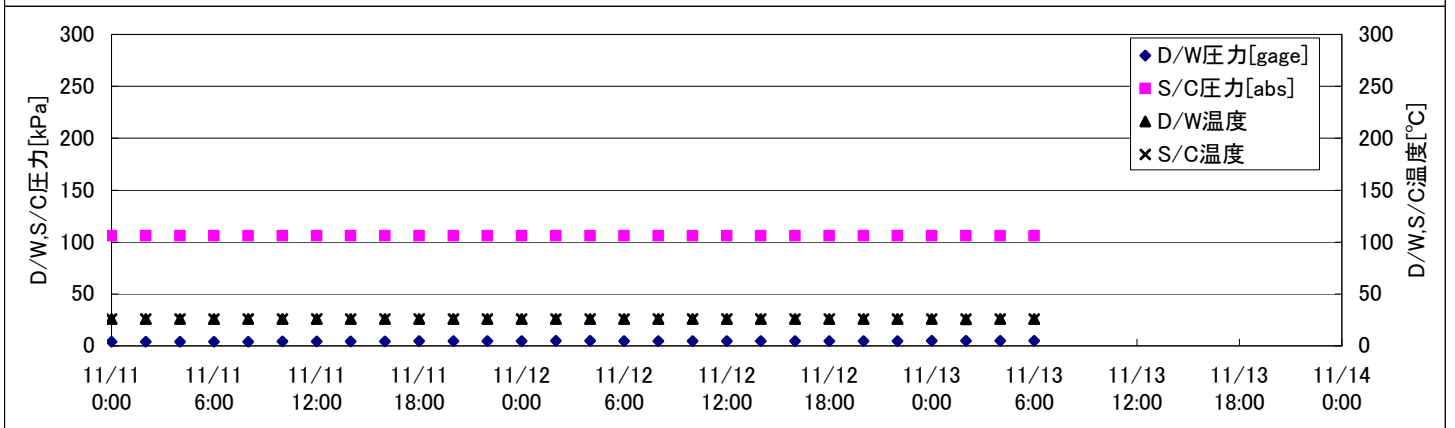
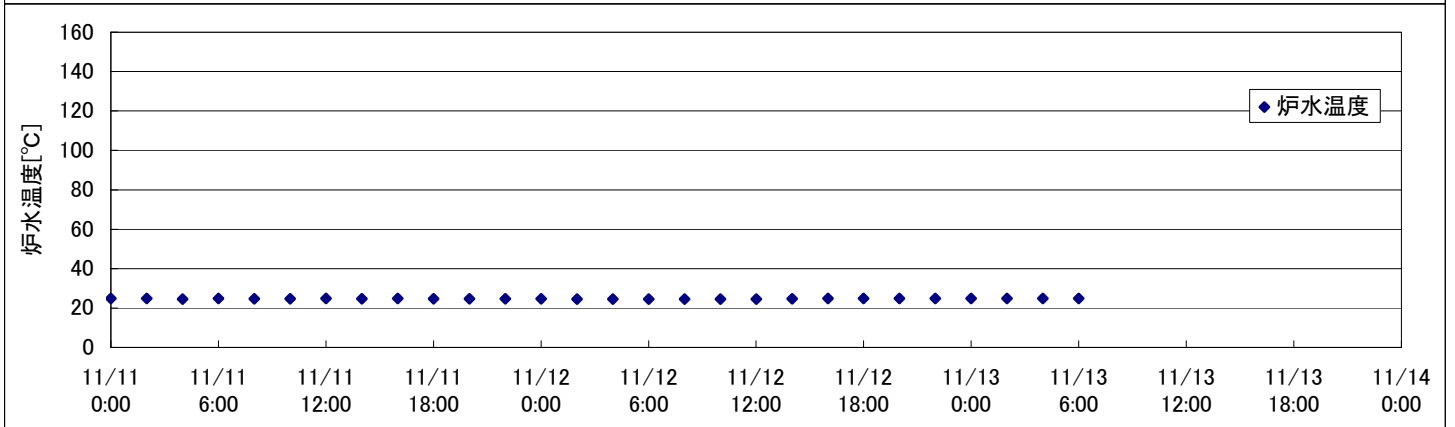
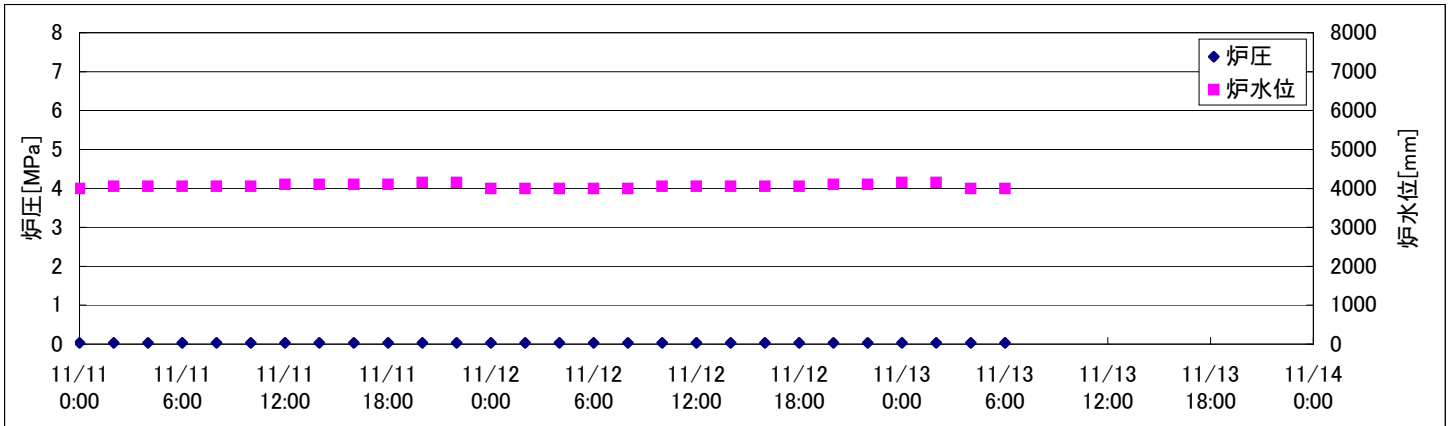
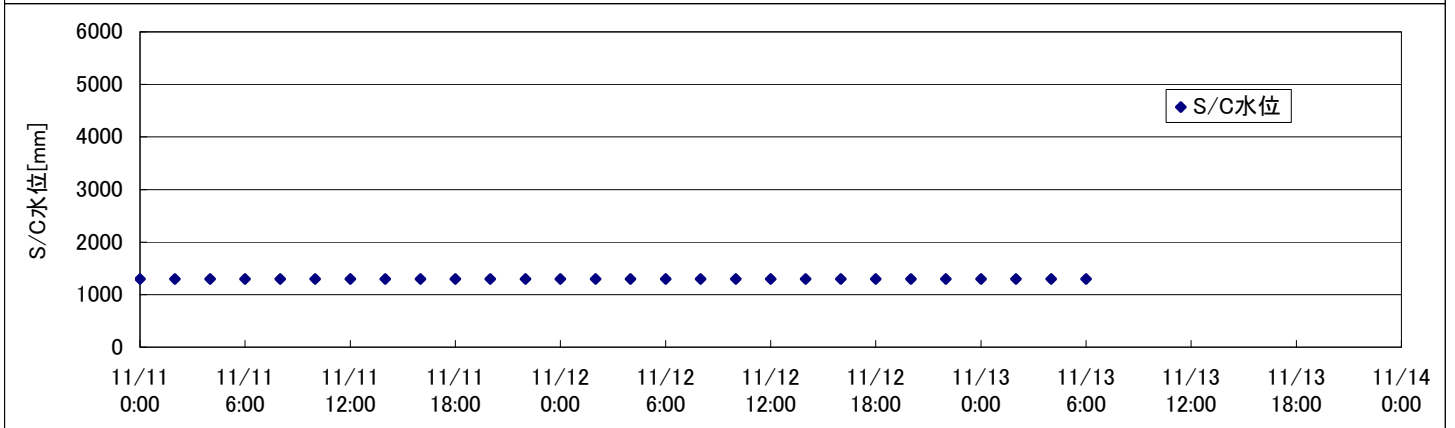
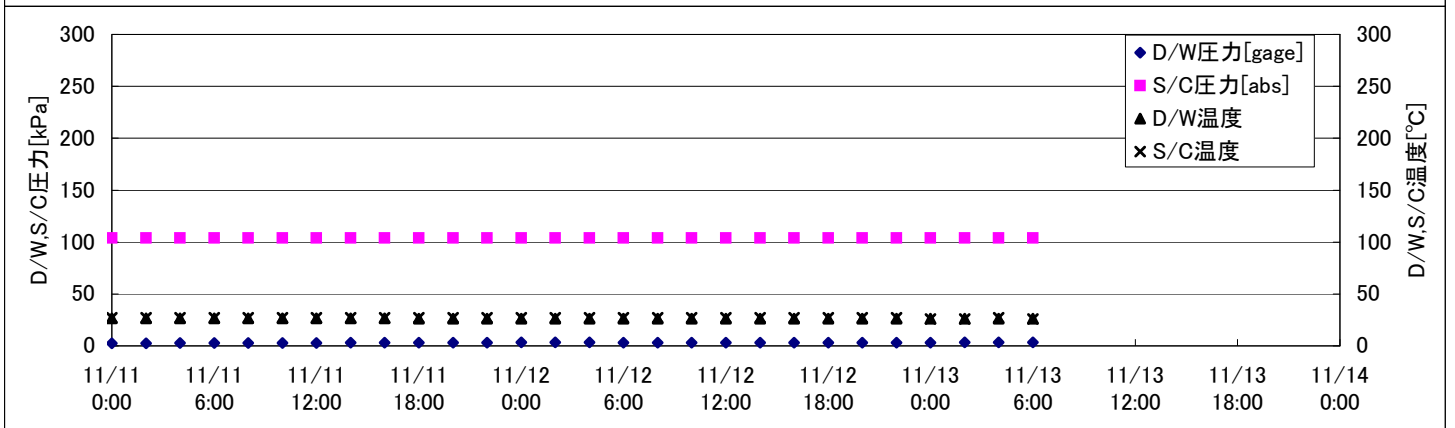






2F-1号機

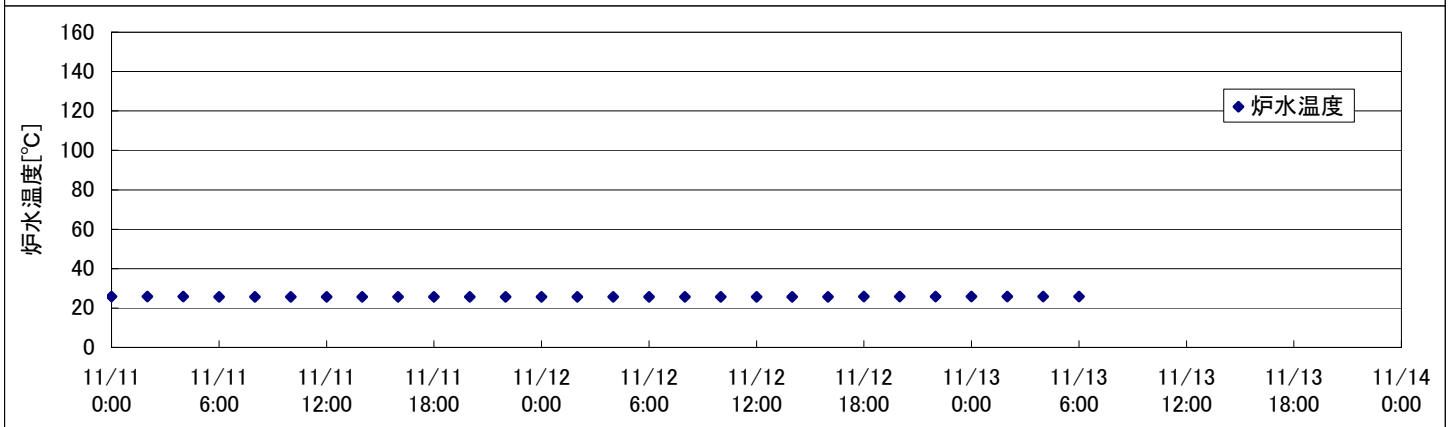





2F-2号機

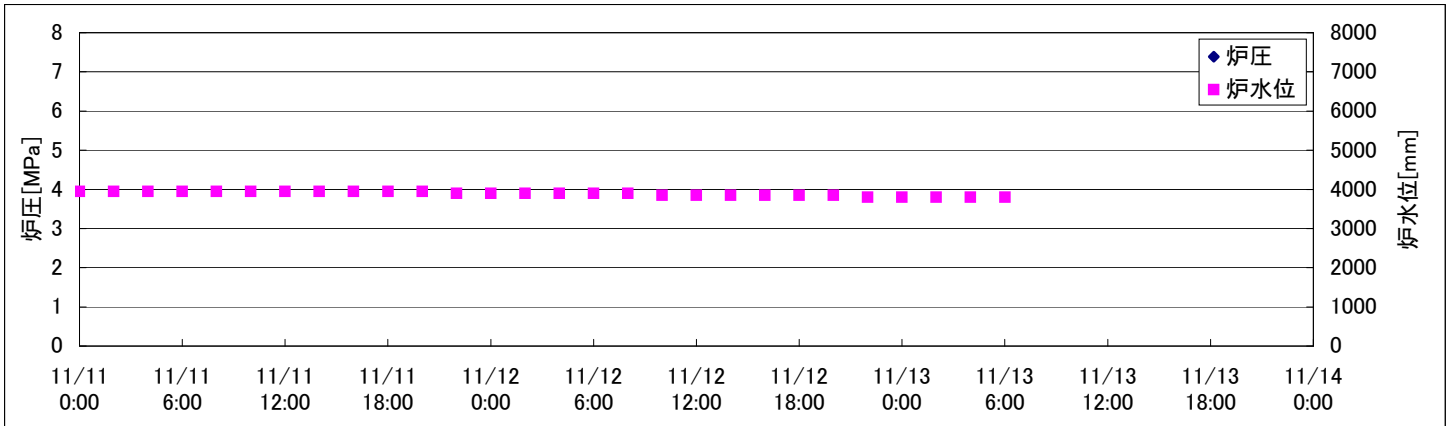

2F-3号機

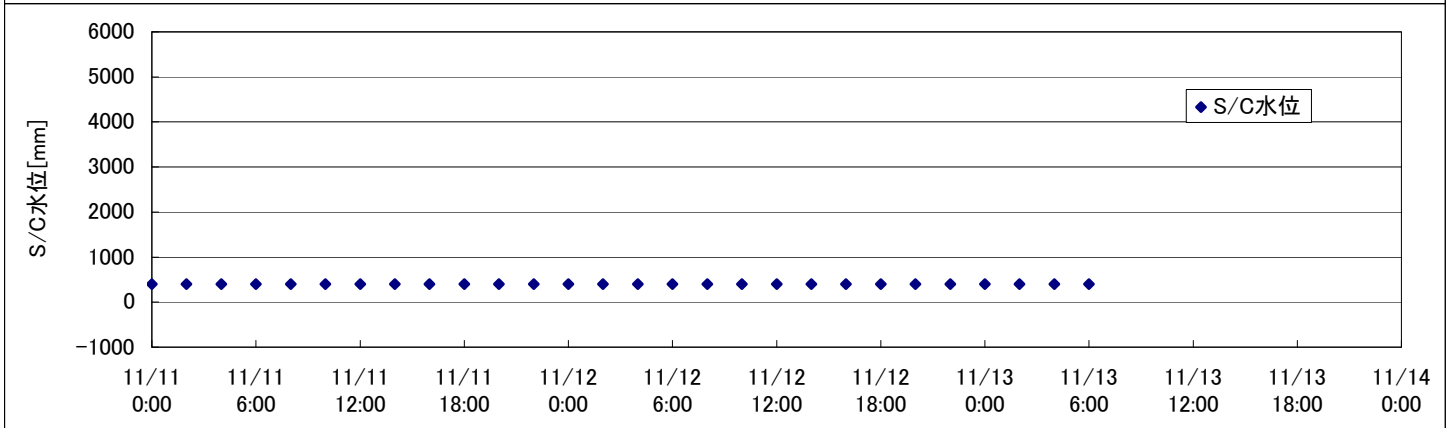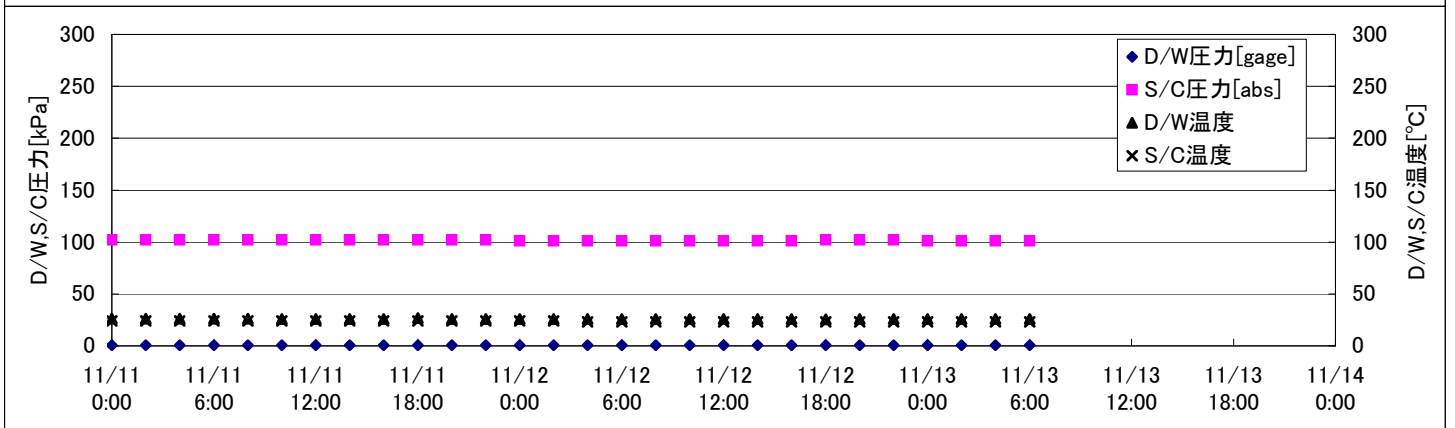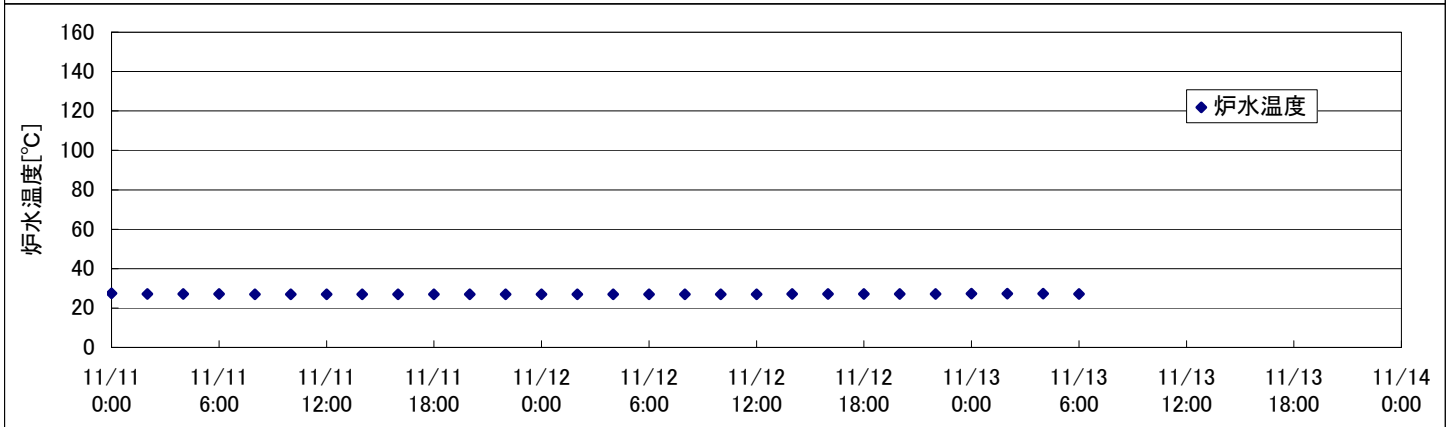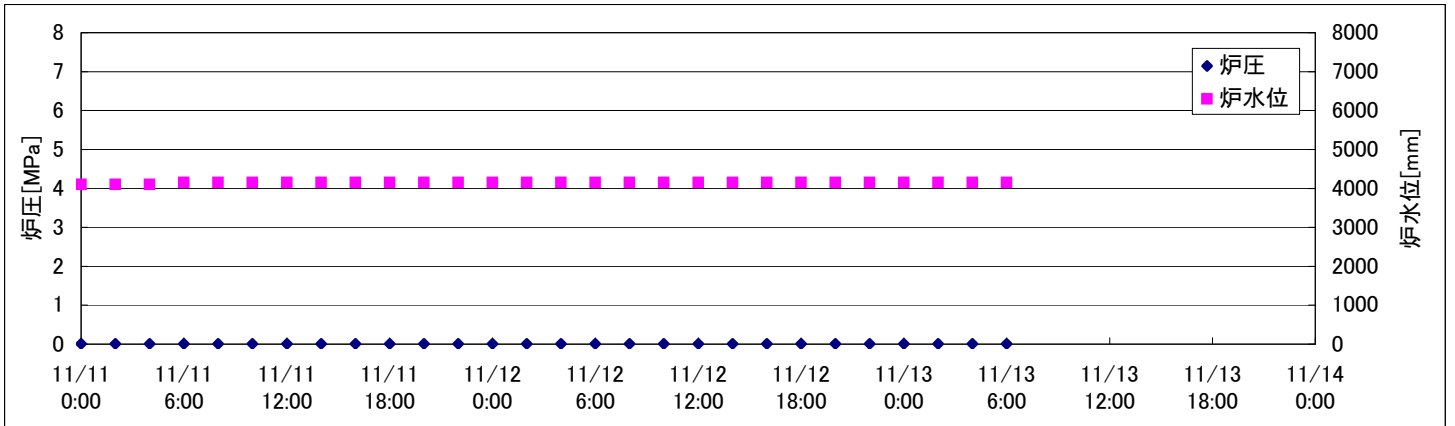

2F-4号機

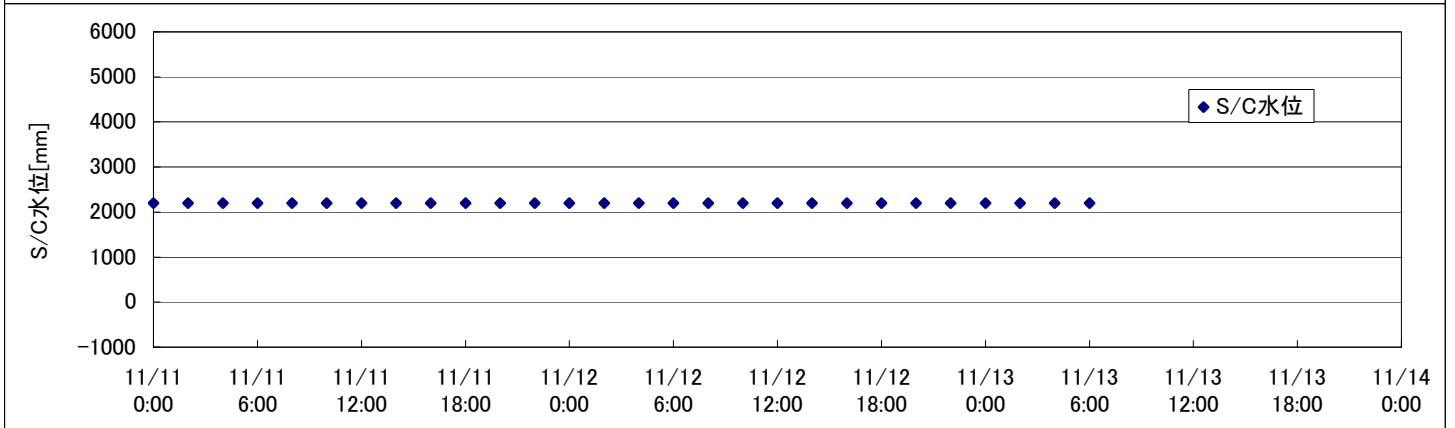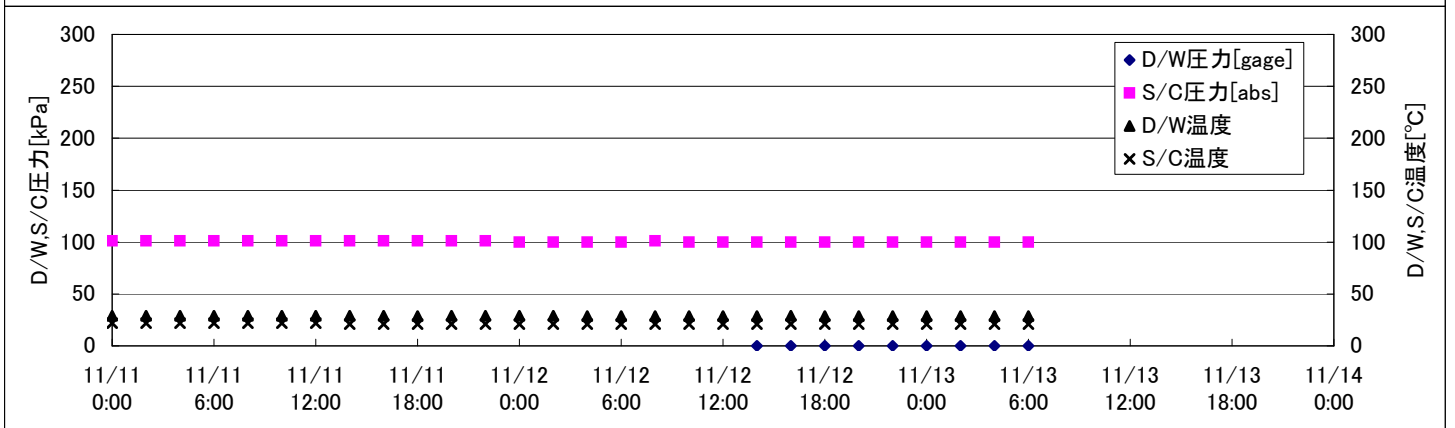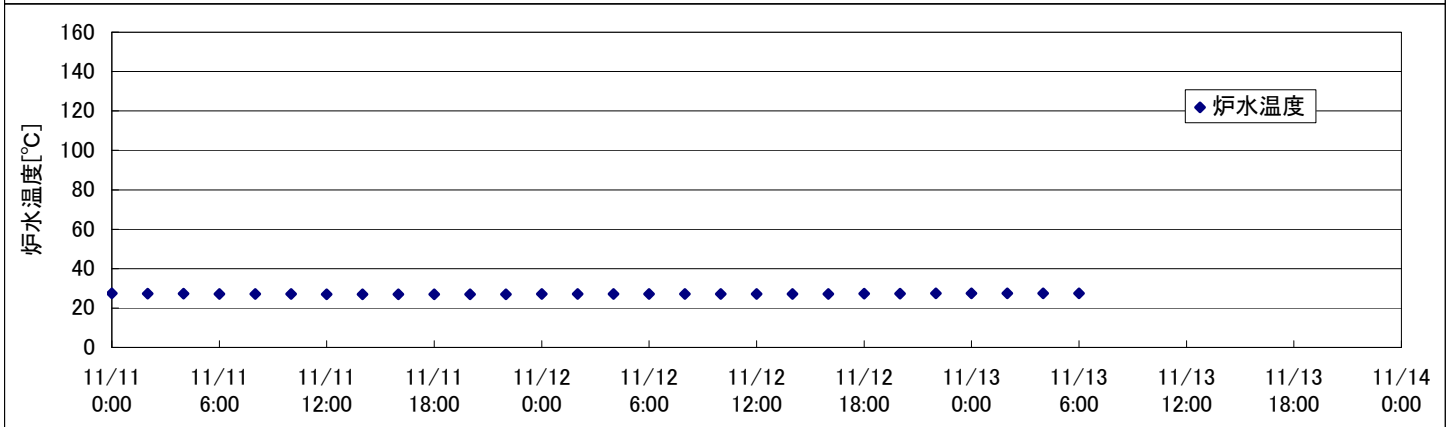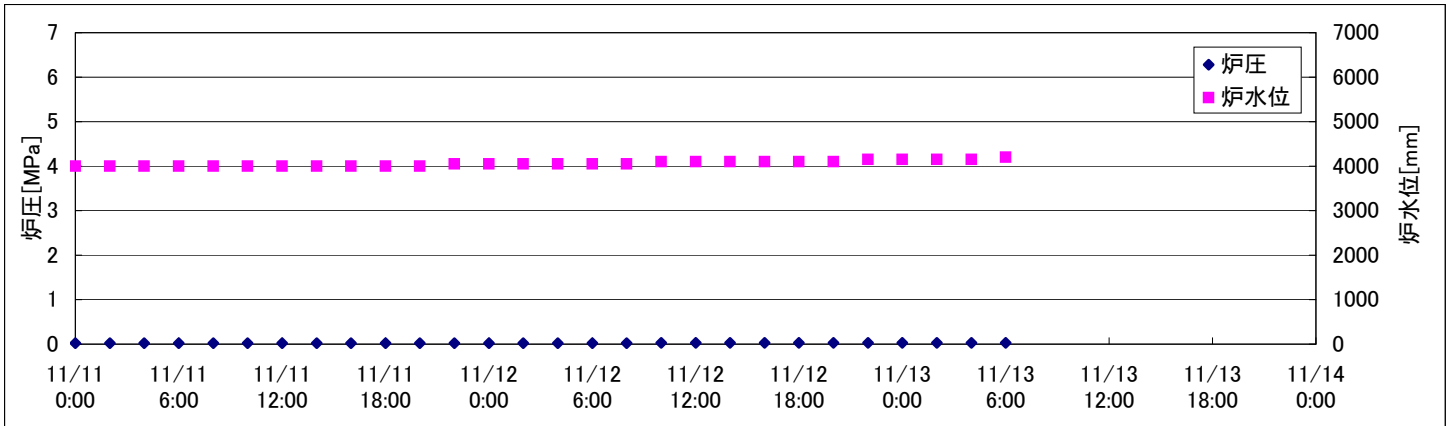





2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]





時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/11/11 0:00	0.02	4000	27.4		29.1	101	2200	22
2011/11/11 2:00	0.02	4000	27.3		28.9	101	2200	22
2011/11/11 4:00	0.02	4000	27.3		29.1	101	2200	22
2011/11/11 6:00	0.02	4000	27.2		29.1	101	2200	22
2011/11/11 8:00	0.02	4000	27.2		29.1	101	2200	22
2011/11/11 10:00	0.02	4000	27.1		29.0	101	2200	22
2011/11/11 12:00	0.02	4000	27.0		29.0	101	2200	22
2011/11/11 14:00	0.02	4000	27.0		29.0	101	2200	21
2011/11/11 16:00	0.02	4000	27.0		29.1	101	2200	21
2011/11/11 18:00	0.02	4000	27.0		28.8	101	2200	21
2011/11/11 20:00	0.02	4000	27.0		28.9	101	2200	21
2011/11/11 22:00	0.02	4050	27.0		28.9	101	2200	21
2011/11/12 0:00	0.02	4050	27.1		28.9	100	2200	21
2011/11/12 2:00	0.02	4050	27.2		28.9	100	2200	21
2011/11/12 4:00	0.02	4050	27.2		28.8	100	2200	21
2011/11/12 6:00	0.02	4050	27.2		28.8	100	2200	21
2011/11/12 8:00	0.02	4050	27.2		28.8	101	2200	21
2011/11/12 10:00	0.03	4100	27.2		28.8	100	2200	21
2011/11/12 12:00	0.03	4100	27.2		28.8	100	2200	21
2011/11/12 14:00	0.03	4100	27.2	-	28.8	100	2200	21
2011/11/12 16:00	0.03	4100	27.2	-	28.9	100	2200	21
2011/11/12 18:00	0.03	4100	27.3	-	28.8	100	2200	21
2011/11/12 20:00	0.03	4100	27.3	-	28.8	100	2200	21
2011/11/12 22:00	0.03	4150	27.4	-	28.7	100	2200	21
2011/11/13 0:00	0.03	4150	27.4	-	28.7	100	2200	21
2011/11/13 2:00	0.03	4150	27.4	-	28.7	100	2200	21
2011/11/13 4:00	0.03	4150	27.4	-	28.7	100	2200	21
2011/11/13 6:00	0.03	4200	27.4	-	28.7	100	2200	21
2011/11/13 8:00								
2011/11/13 10:00								
2011/11/13 12:00								
2011/11/13 14:00								
2011/11/13 16:00								
2011/11/13 18:00								
2011/11/13 20:00								
2011/11/13 22:00								
2011/11/14 0:00								

D/W圧力について
・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず





2F-1号機

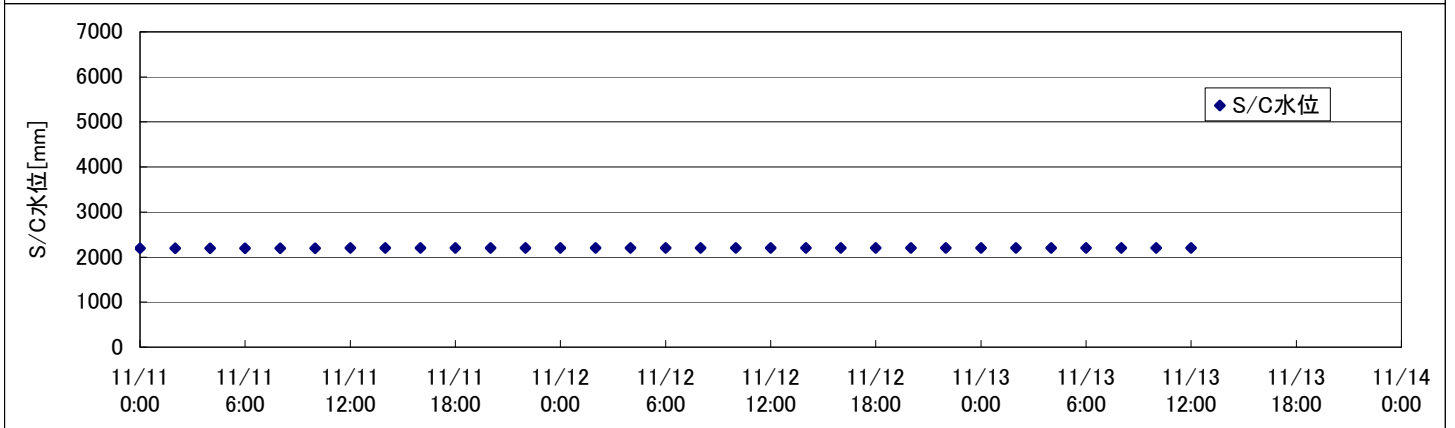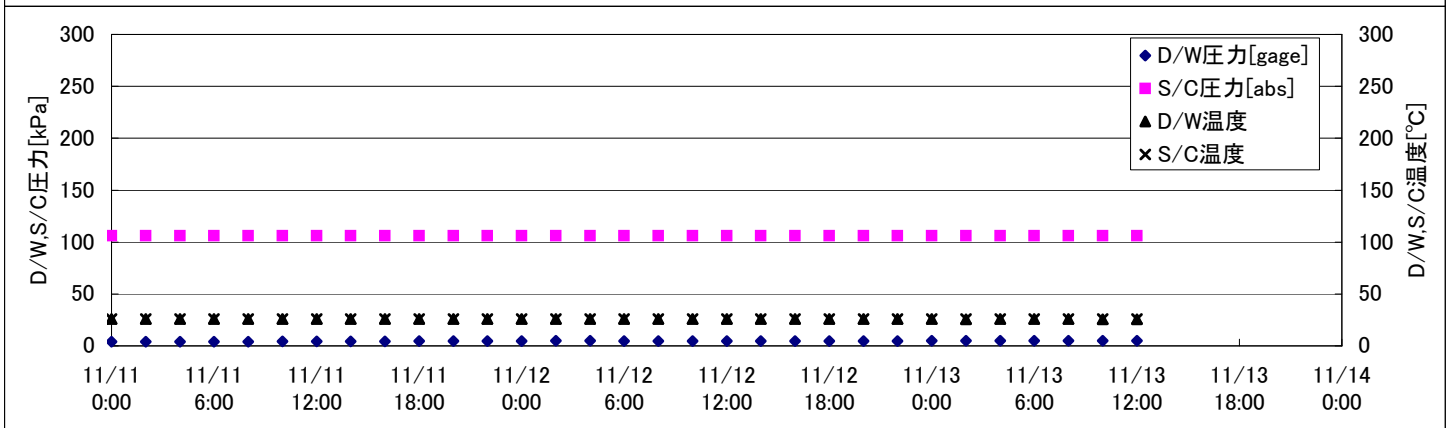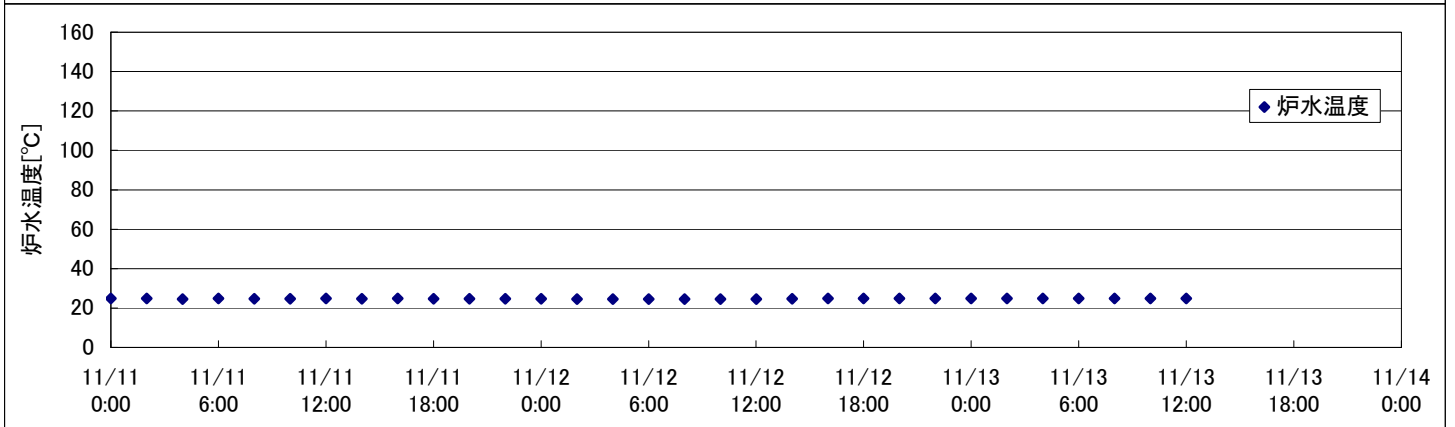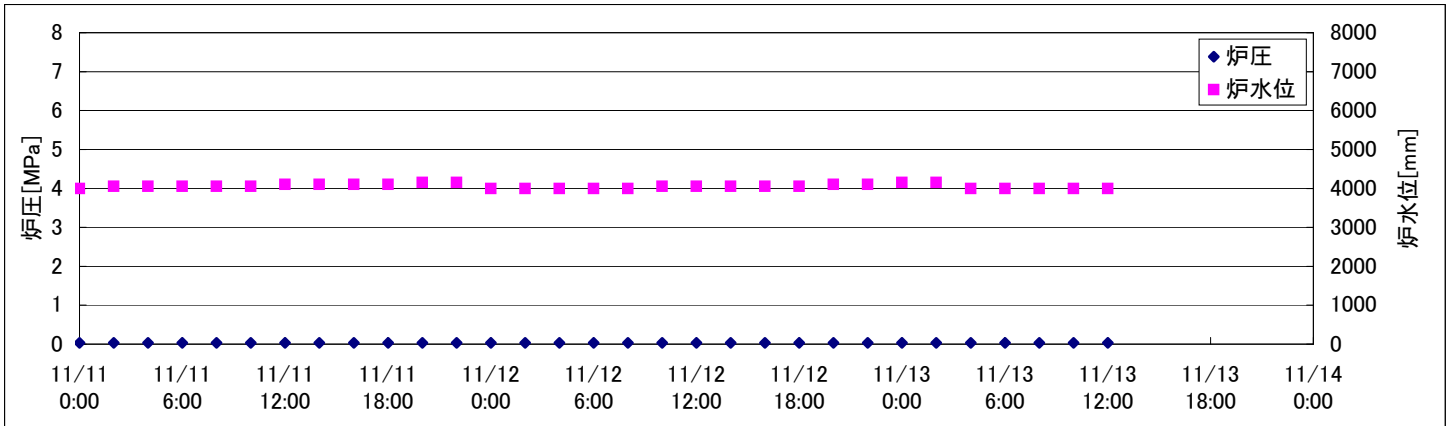





2F-2号機

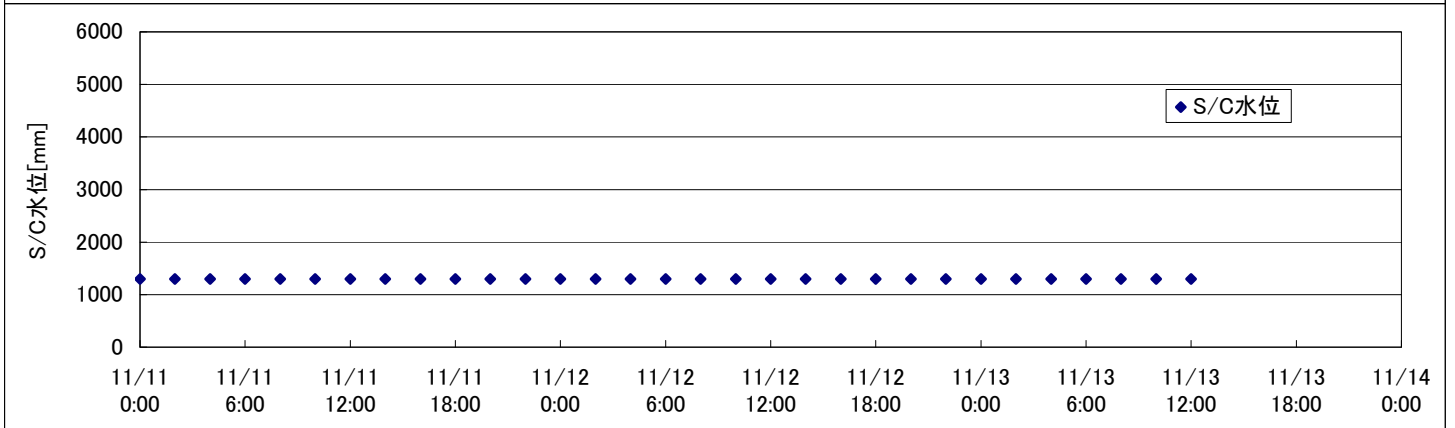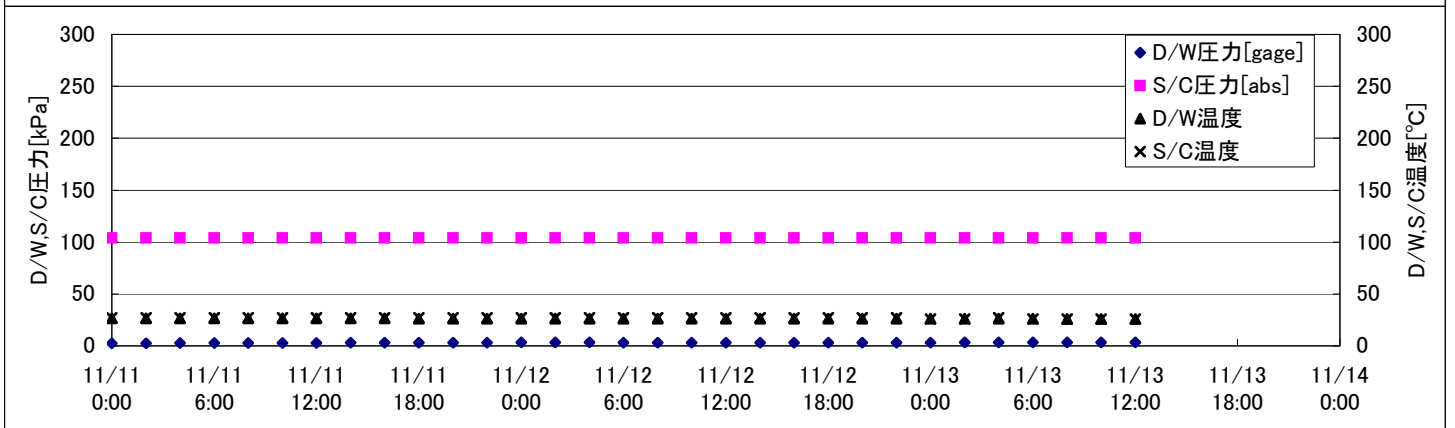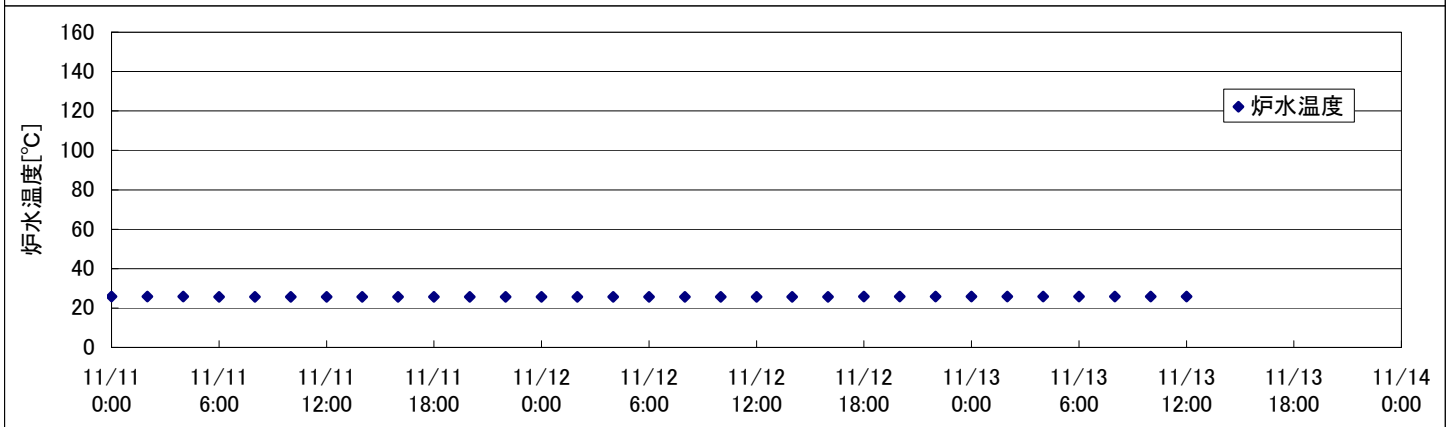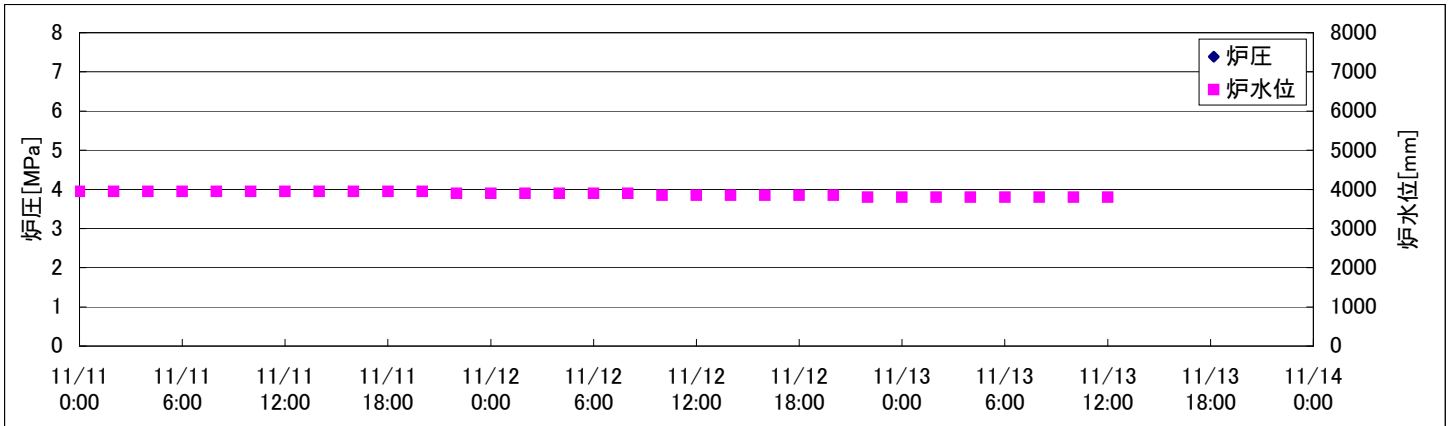

2F-3号機

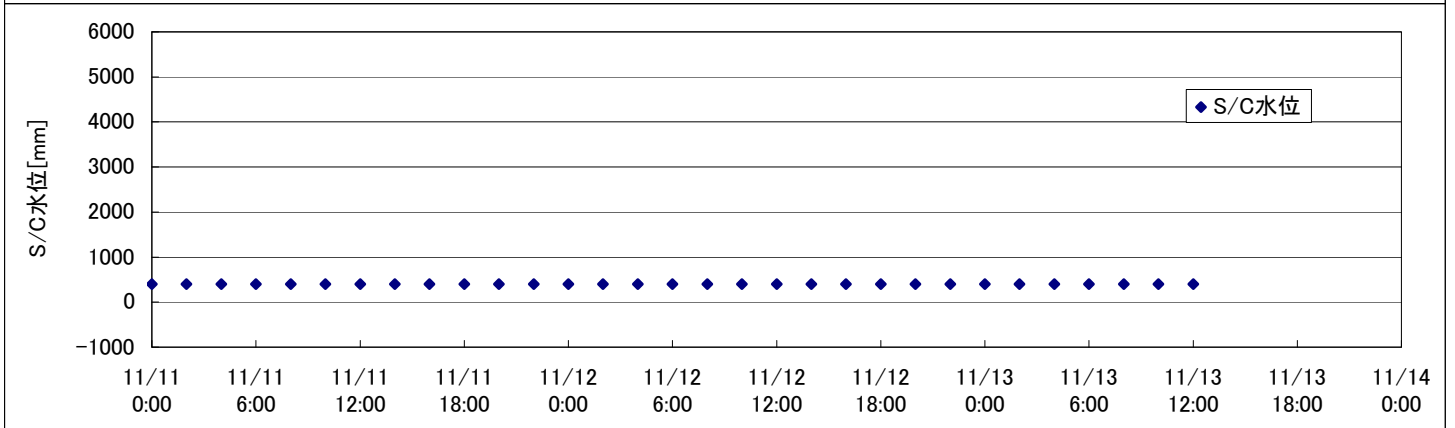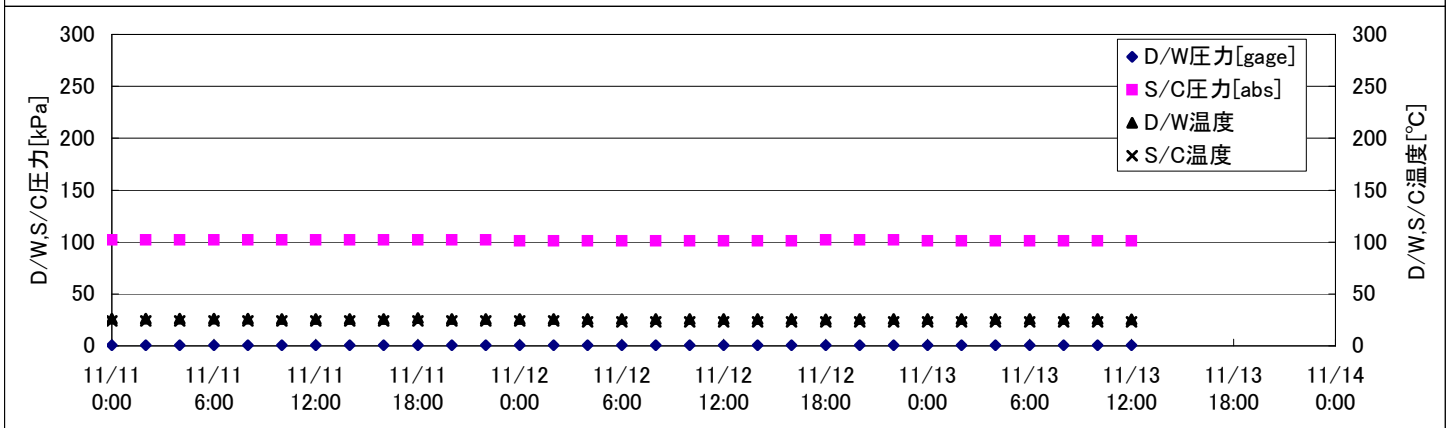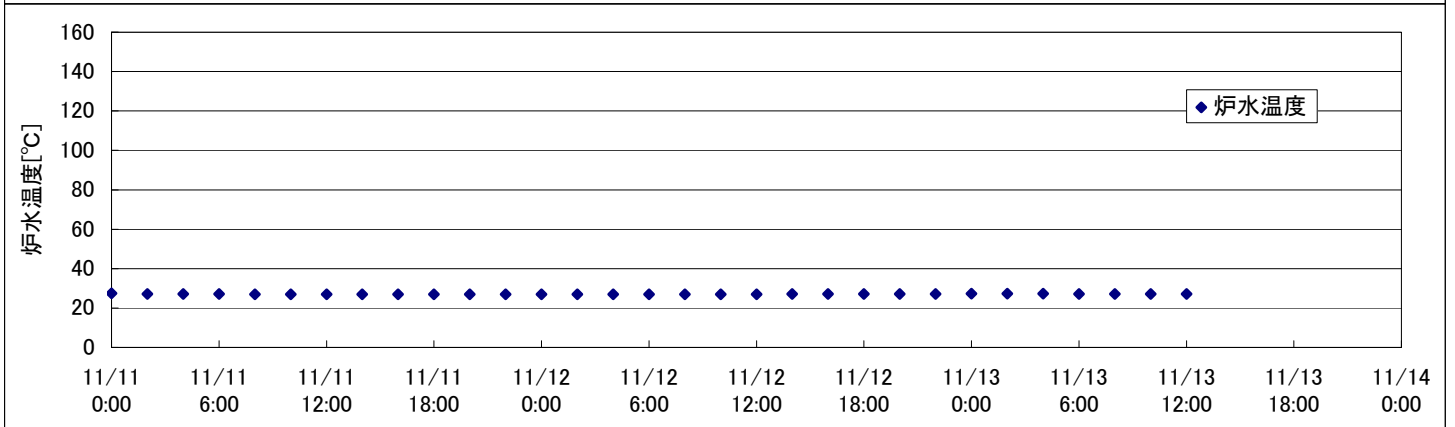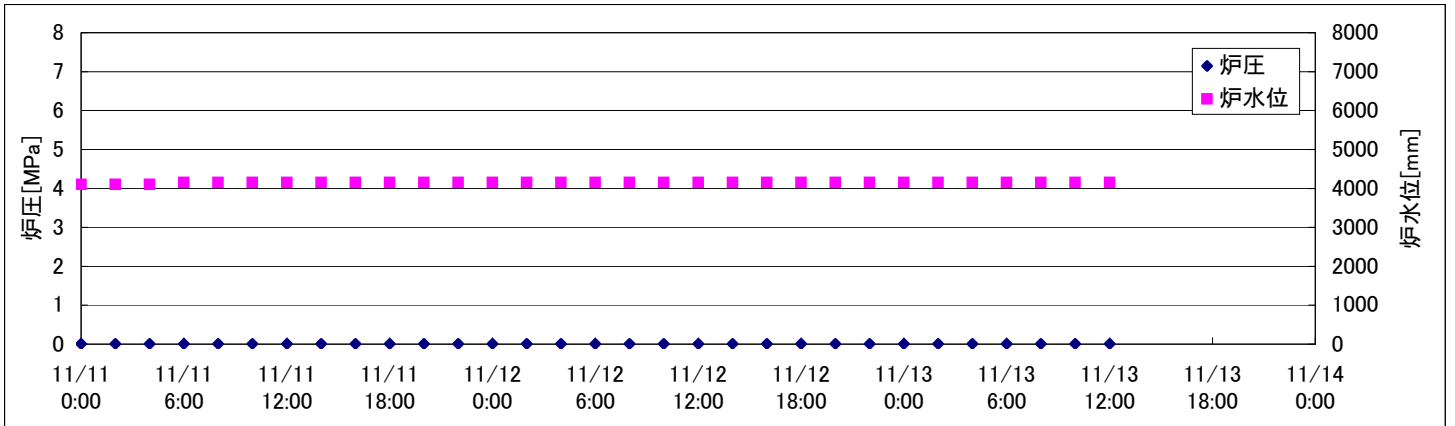

2F-4号機

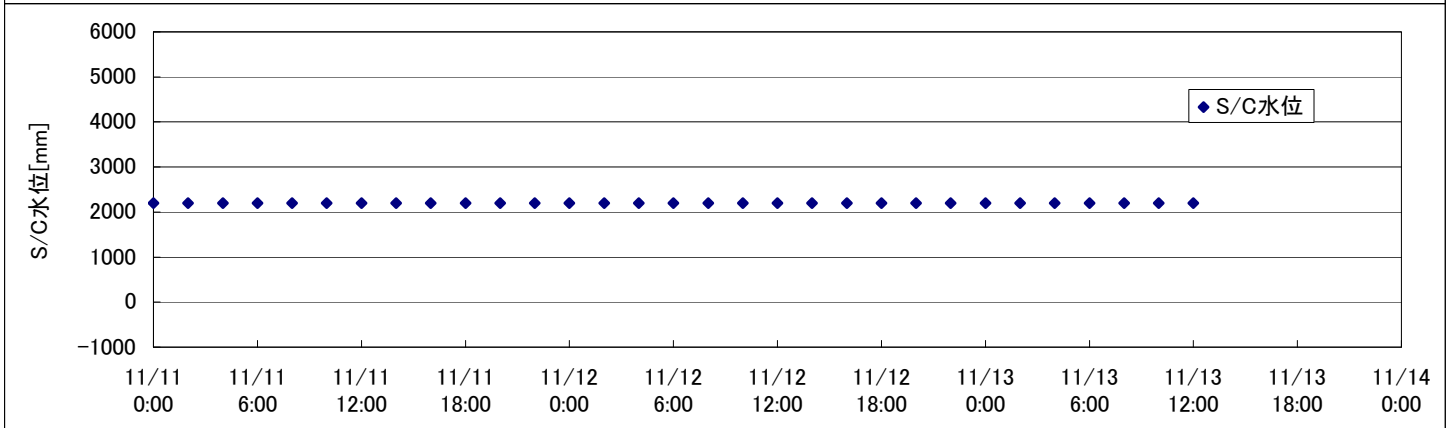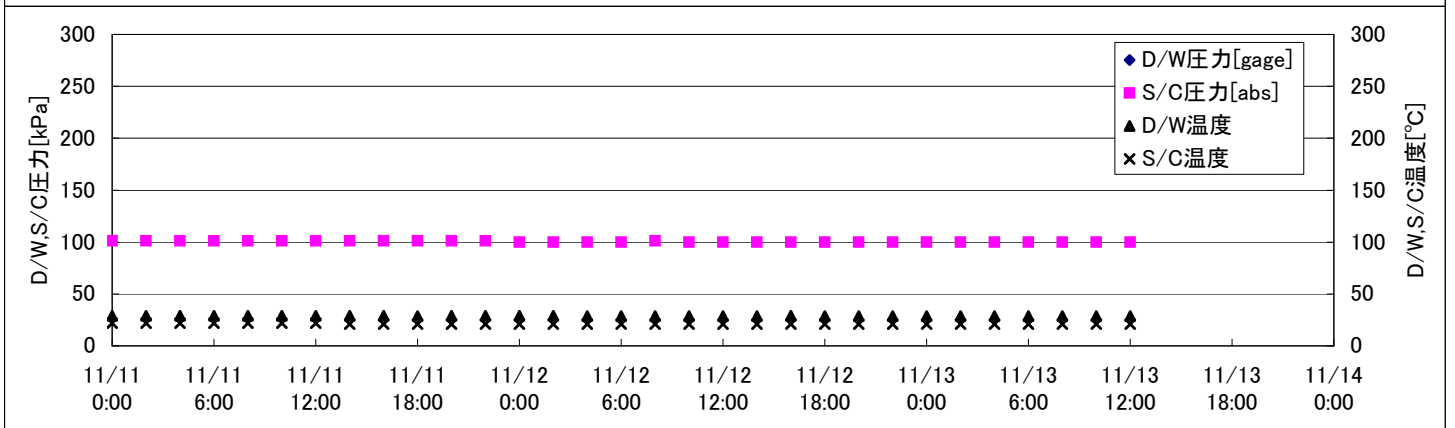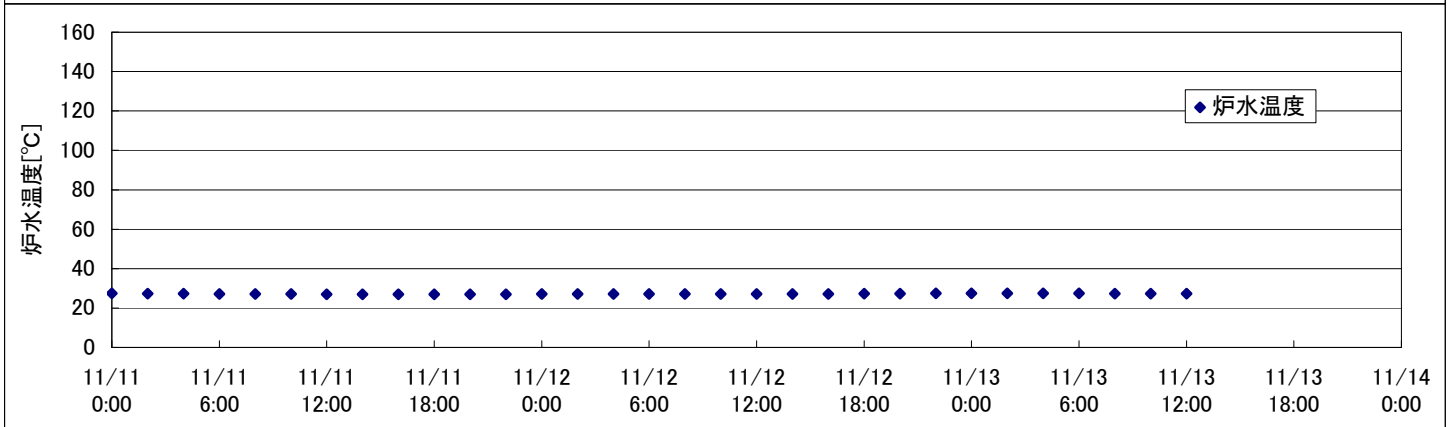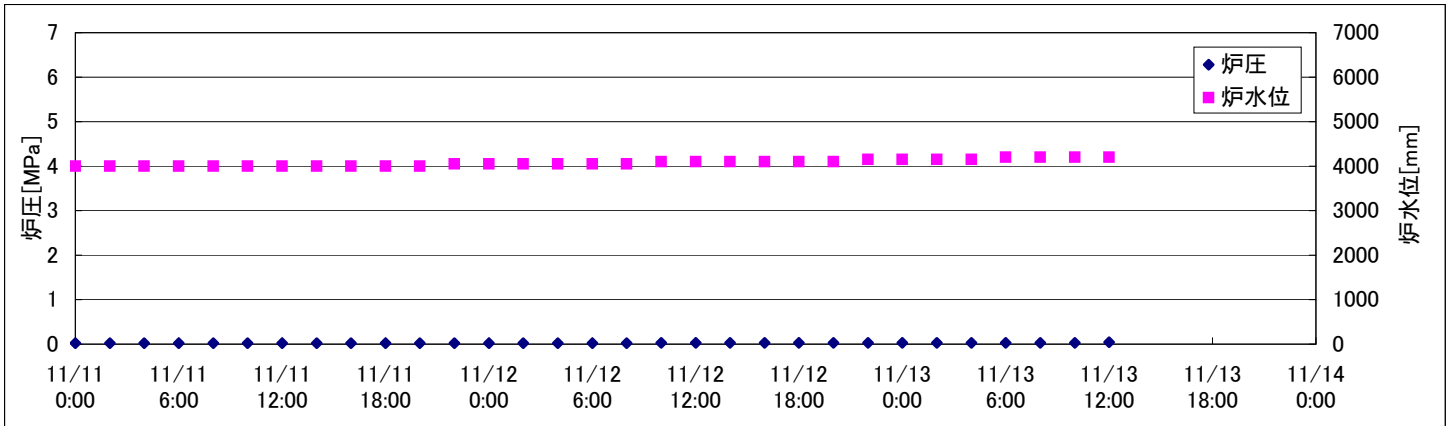

2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]

時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/11/11 0:00	0.02	4000	27.4		29.1	101	2200	22
2011/11/11 2:00	0.02	4000	27.3		28.9	101	2200	22
2011/11/11 4:00	0.02	4000	27.3		29.1	101	2200	22
2011/11/11 6:00	0.02	4000	27.2		29.1	101	2200	22
2011/11/11 8:00	0.02	4000	27.2		29.1	101	2200	22
2011/11/11 10:00	0.02	4000	27.1		29.0	101	2200	22
2011/11/11 12:00	0.02	4000	27.0		29.0	101	2200	22
2011/11/11 14:00	0.02	4000	27.0		29.0	101	2200	21
2011/11/11 16:00	0.02	4000	27.0		29.1	101	2200	21
2011/11/11 18:00	0.02	4000	27.0		28.8	101	2200	21
2011/11/11 20:00	0.02	4000	27.0		28.9	101	2200	21
2011/11/11 22:00	0.02	4050	27.0		28.9	101	2200	21
2011/11/12 0:00	0.02	4050	27.1		28.9	100	2200	21
2011/11/12 2:00	0.02	4050	27.2		28.9	100	2200	21
2011/11/12 4:00	0.02	4050	27.2		28.8	100	2200	21
2011/11/12 6:00	0.02	4050	27.2		28.8	100	2200	21
2011/11/12 8:00	0.02	4050	27.2		28.8	101	2200	21
2011/11/12 10:00	0.03	4100	27.2		28.8	100	2200	21
2011/11/12 12:00	0.03	4100	27.2		28.8	100	2200	21
2011/11/12 14:00	0.03	4100	27.2		28.8	100	2200	21
2011/11/12 16:00	0.03	4100	27.2		28.9	100	2200	21
2011/11/12 18:00	0.03	4100	27.3		28.8	100	2200	21
2011/11/12 20:00	0.03	4100	27.3		28.8	100	2200	21
2011/11/12 22:00	0.03	4150	27.4		28.7	100	2200	21
2011/11/13 0:00	0.03	4150	27.4		28.7	100	2200	21
2011/11/13 2:00	0.03	4150	27.4		28.7	100	2200	21
2011/11/13 4:00	0.03	4150	27.4		28.7	100	2200	21
2011/11/13 6:00	0.03	4200	27.4		28.7	100	2200	21
2011/11/13 8:00	0.03	4200	27.3		28.7	100	2200	21
2011/11/13 10:00	0.03	4200	27.3		28.7	100	2200	21
2011/11/13 12:00	0.04	4200	27.3		28.7	100	2200	21
2011/11/13 14:00								
2011/11/13 16:00								
2011/11/13 18:00								
2011/11/13 20:00								
2011/11/13 22:00								
2011/11/14 0:00								

D/W圧力について

・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず