

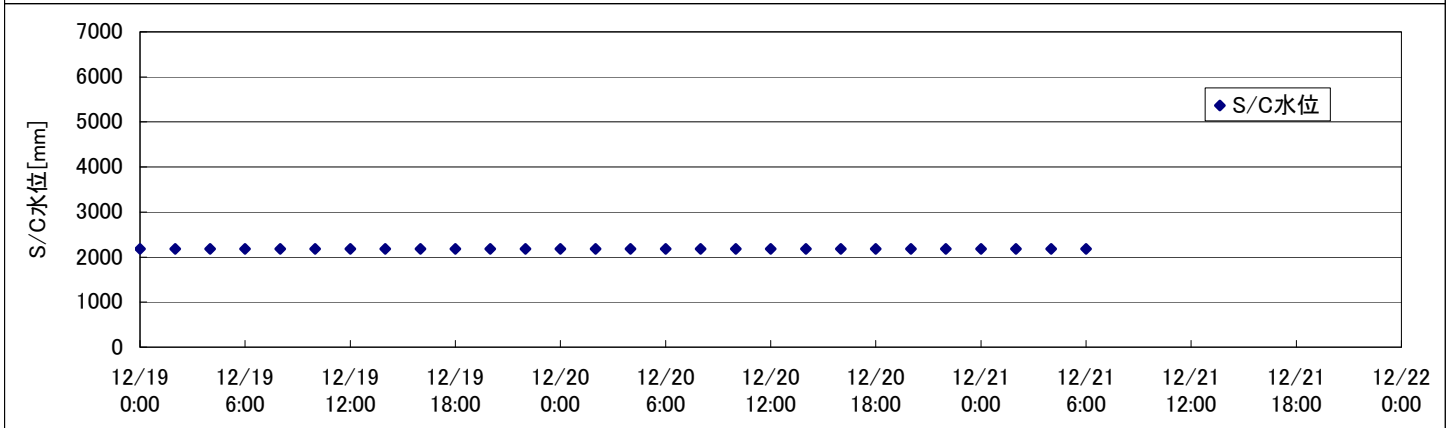
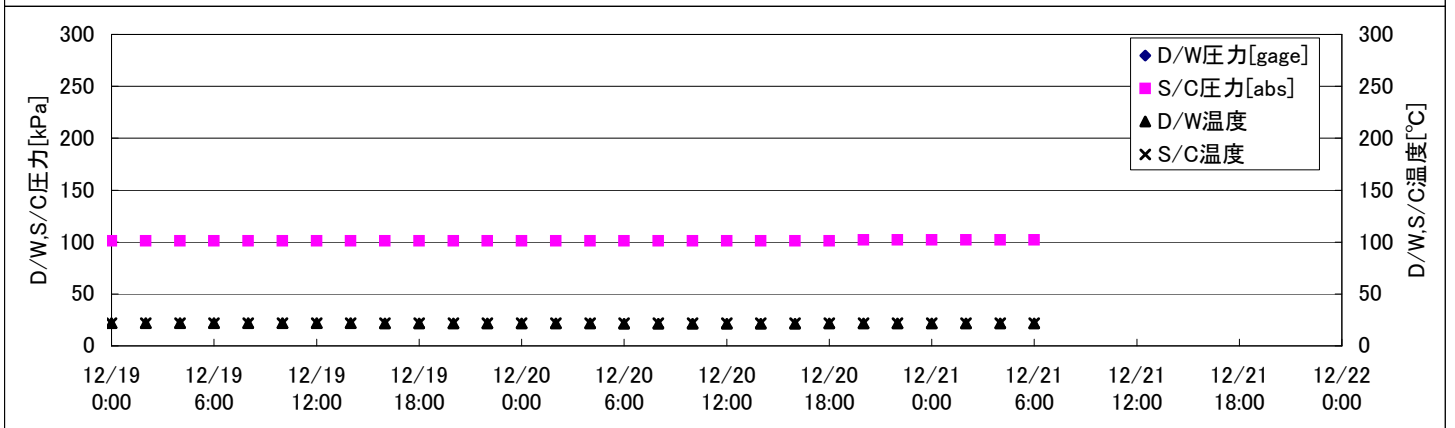
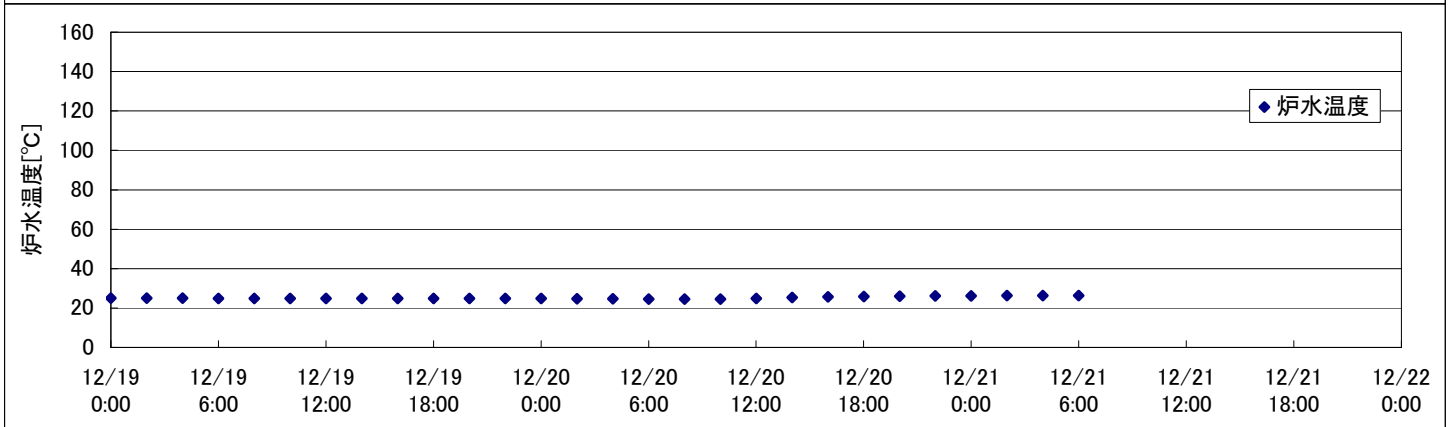
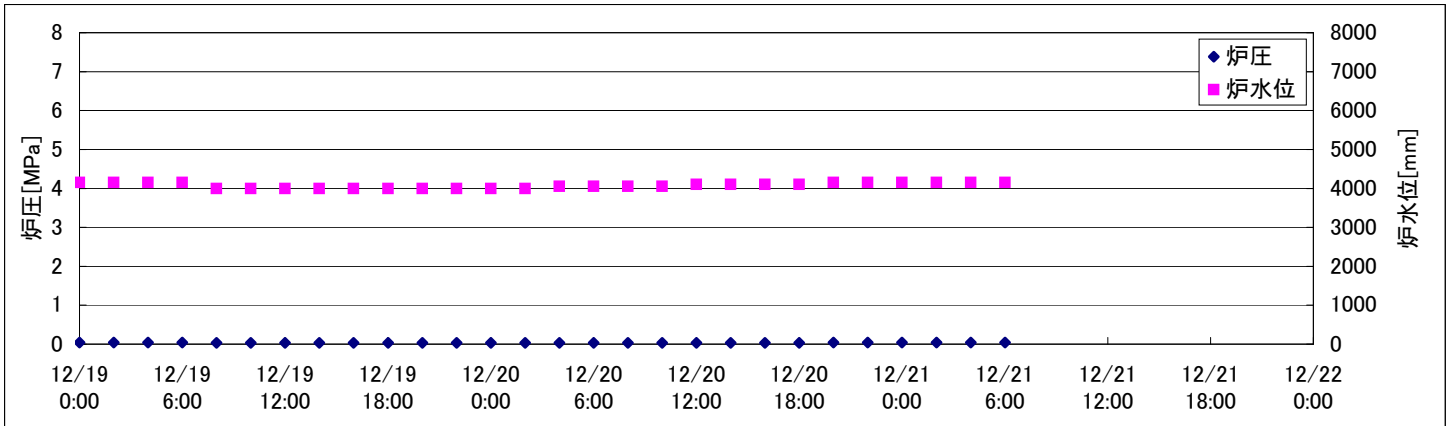
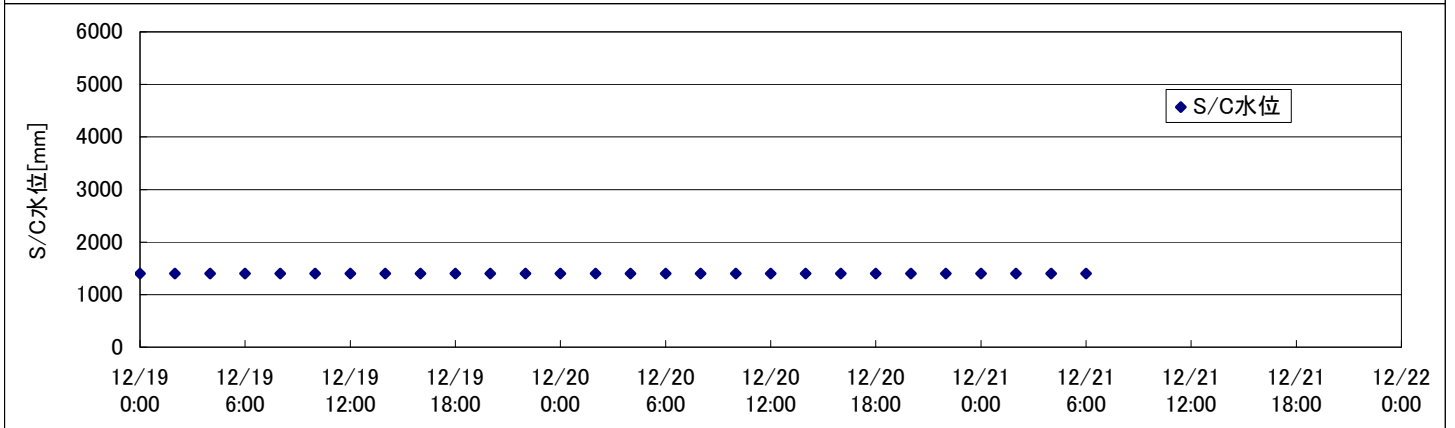
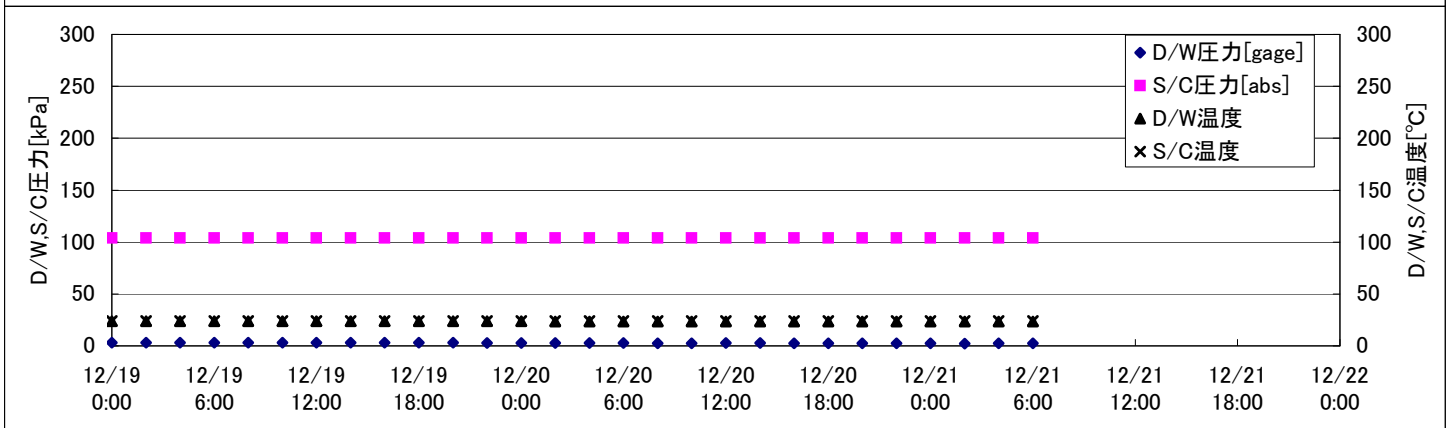






2F-1号機

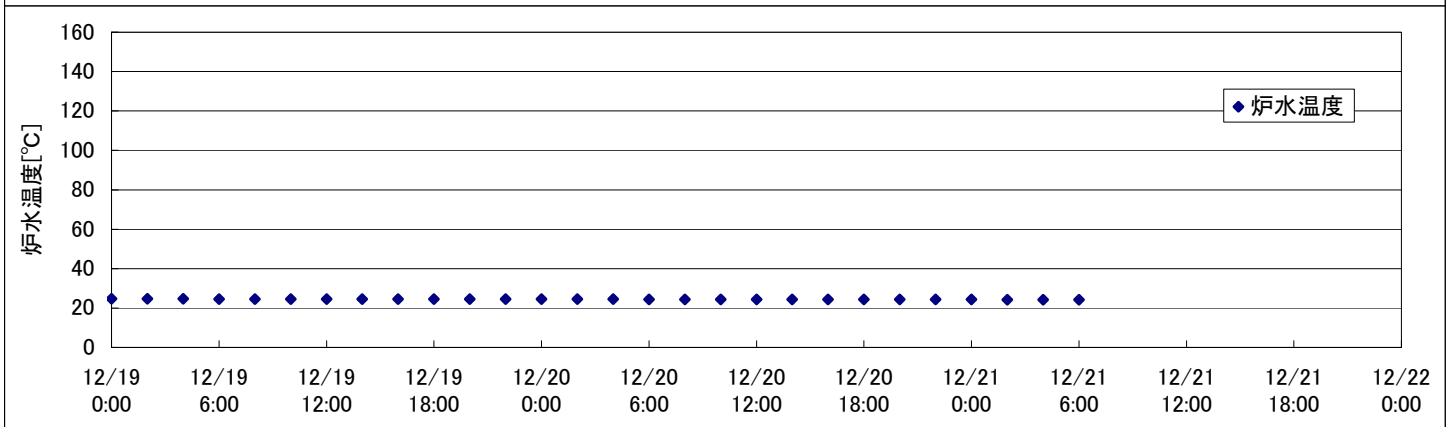





2F-2号機

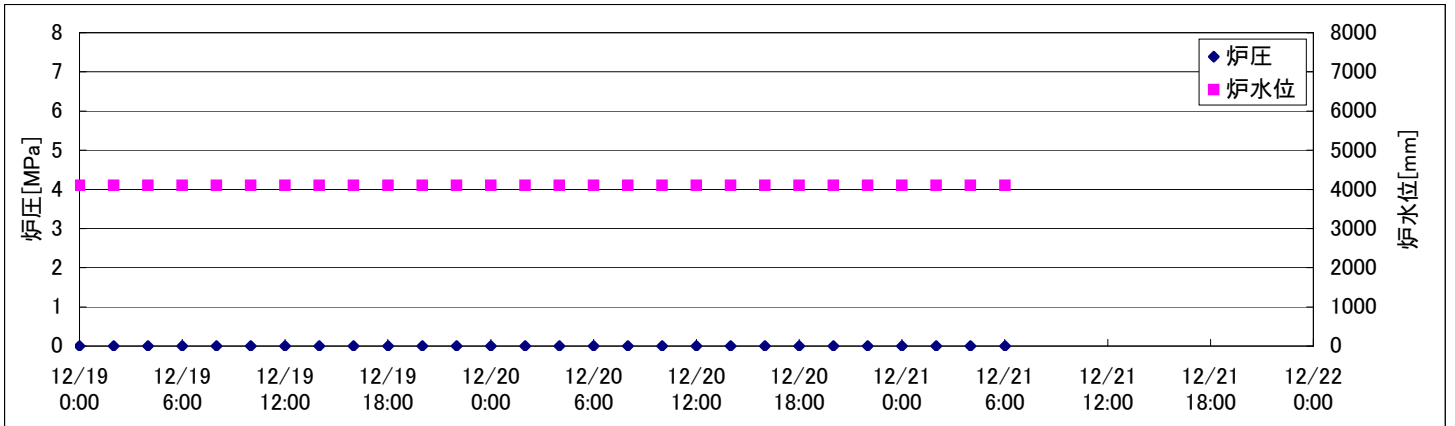

2F-3号機

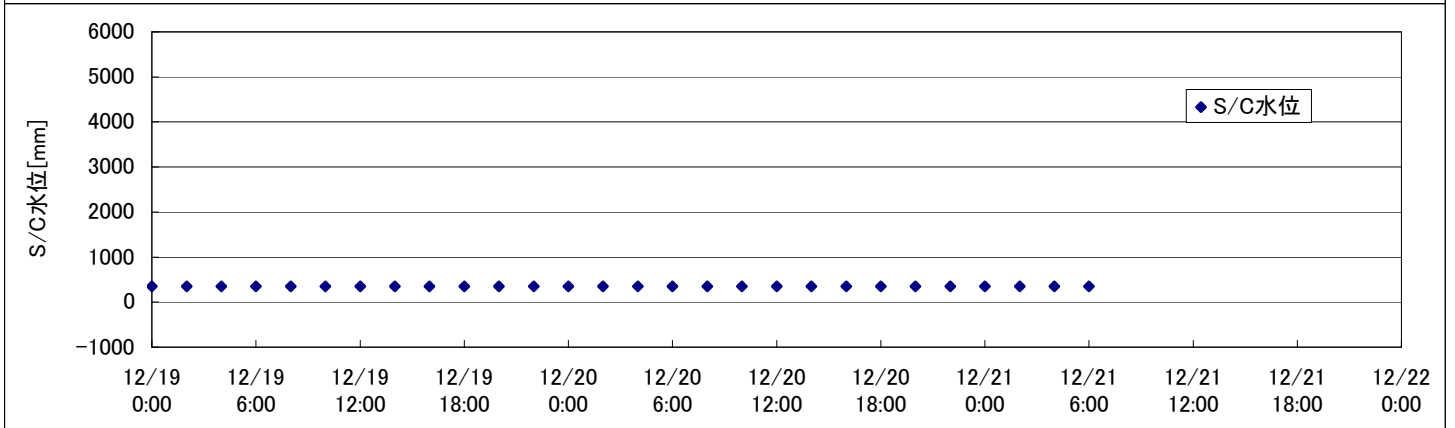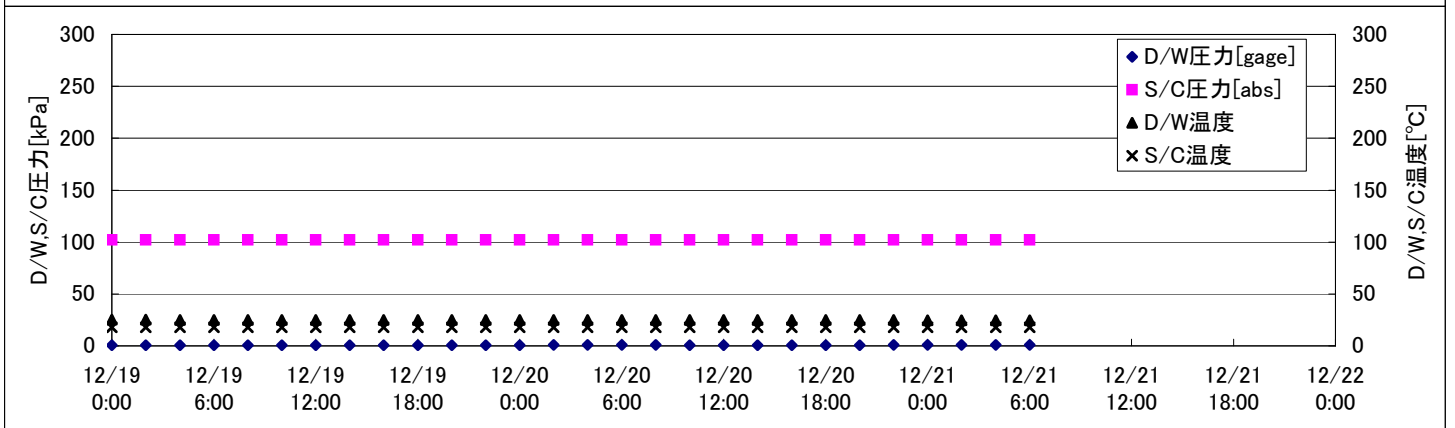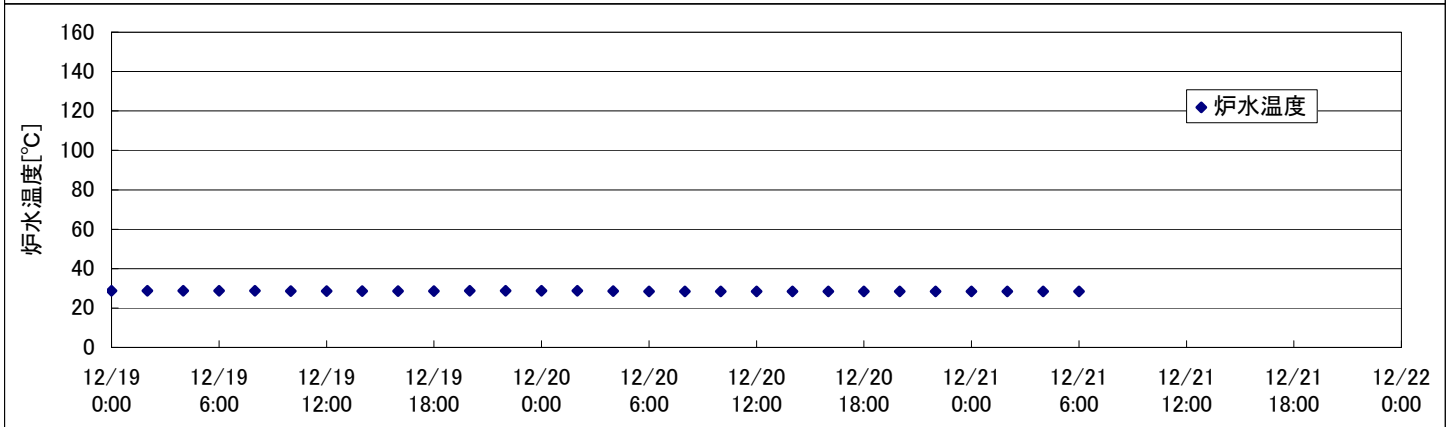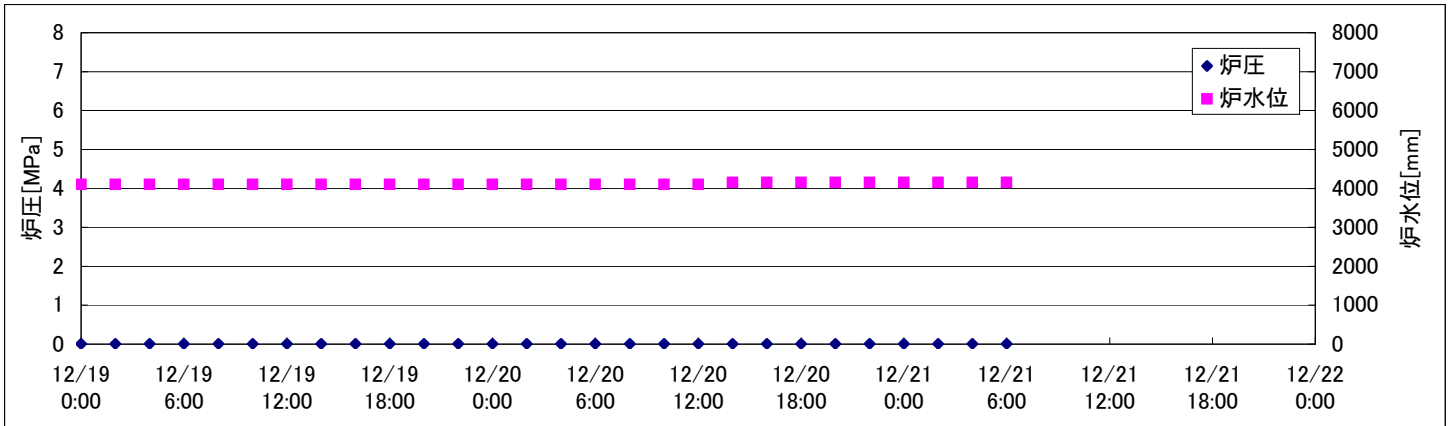

2F-4号機

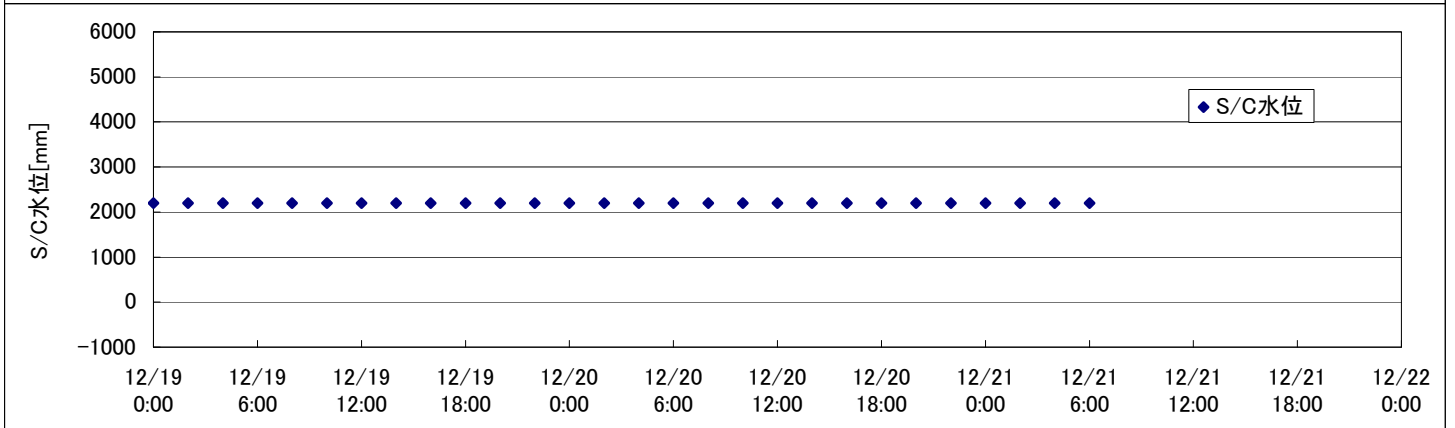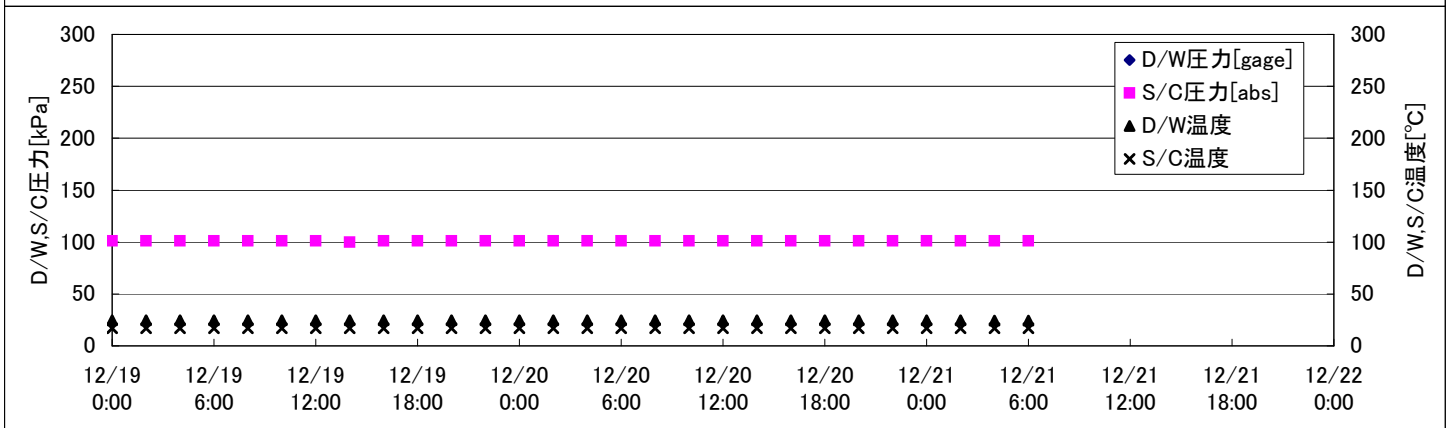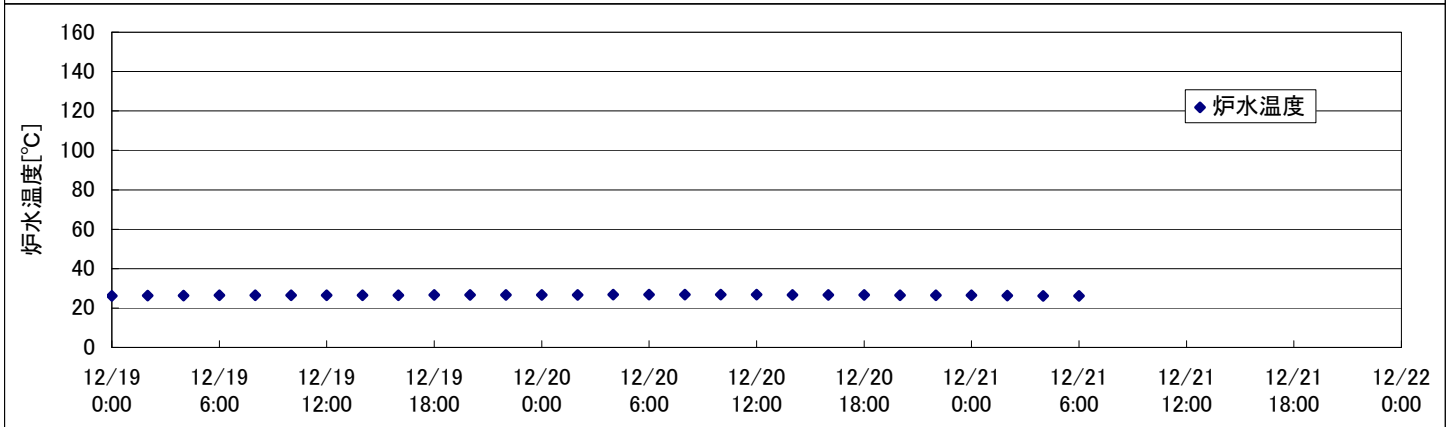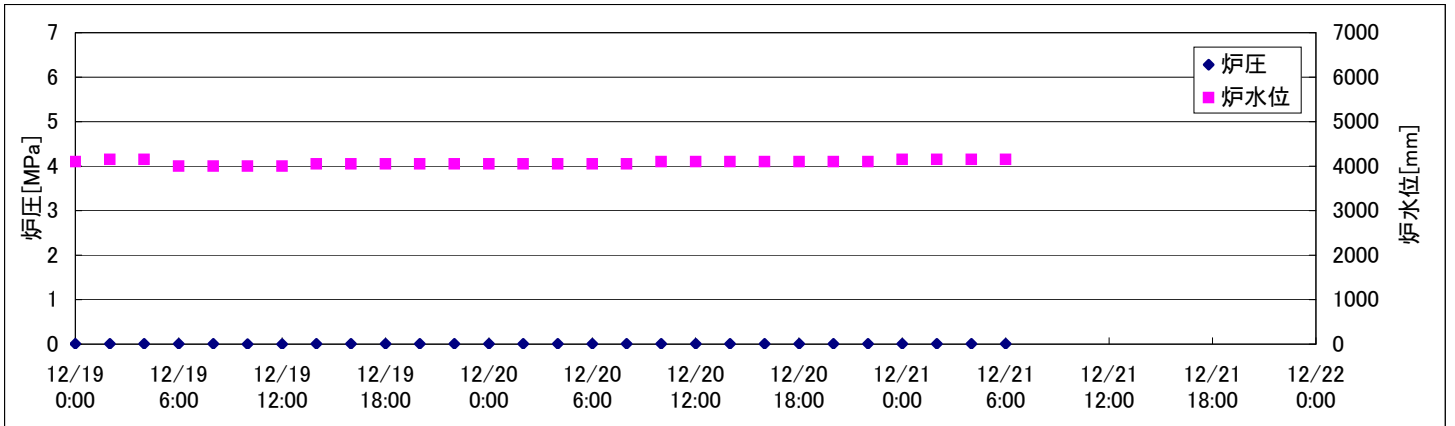





2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]





時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/12/19 0:00	0.01	4100	26.2		24.6	101	2200	17
2011/12/19 2:00	0.01	4150	26.3		24.6	101	2200	17
2011/12/19 4:00	0.01	4150	26.3		24.7	101	2200	17
2011/12/19 6:00	0.01	4000	26.4		24.7	101	2200	17
2011/12/19 8:00	0.01	4000	26.4		24.8	101	2200	17
2011/12/19 10:00	0.00	4000	26.4		24.7	101	2200	17
2011/12/19 12:00	0.00	4000	26.4		24.6	101	2200	17
2011/12/19 14:00	0.01	4050	26.4		24.7	100	2200	17
2011/12/19 16:00	0.01	4050	26.5		24.6	101	2200	17
2011/12/19 18:00	0.01	4050	26.6		24.6	101	2200	17
2011/12/19 20:00	0.01	4050	26.6		24.7	101	2200	17
2011/12/19 22:00	0.01	4050	26.7		24.8	101	2200	17
2011/12/20 0:00	0.01	4050	26.7		24.7	101	2200	17
2011/12/20 2:00	0.01	4050	26.7		24.7	101	2200	17
2011/12/20 4:00	0.01	4050	26.8		24.8	101	2200	17
2011/12/20 6:00	0.01	4050	26.8		24.7	101	2200	17
2011/12/20 8:00	0.01	4050	26.8		24.7	101	2200	17
2011/12/20 10:00	0.01	4100	26.8		24.7	101	2200	17
2011/12/20 12:00	0.01	4100	26.8		24.7	101	2200	17
2011/12/20 14:00	0.01	4100	26.7		24.7	101	2200	17
2011/12/20 16:00	0.01	4100	26.6		24.6	101	2200	17
2011/12/20 18:00	0.01	4100	26.6		24.6	101	2200	17
2011/12/20 20:00	0.01	4100	26.5		24.6	101	2200	17
2011/12/20 22:00	0.01	4100	26.4		24.6	101	2200	17
2011/12/21 0:00	0.01	4150	26.4		24.6	101	2200	17
2011/12/21 2:00	0.01	4150	26.3		24.6	101	2200	17
2011/12/21 4:00	0.01	4150	26.2		24.4	101	2200	17
2011/12/21 6:00	0.01	4150	26.1		24.4	101	2200	17
2011/12/21 8:00								
2011/12/21 10:00								
2011/12/21 12:00								
2011/12/21 14:00								
2011/12/21 16:00								
2011/12/21 18:00								
2011/12/21 20:00								
2011/12/21 22:00								
2011/12/22 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず





2F-1号機

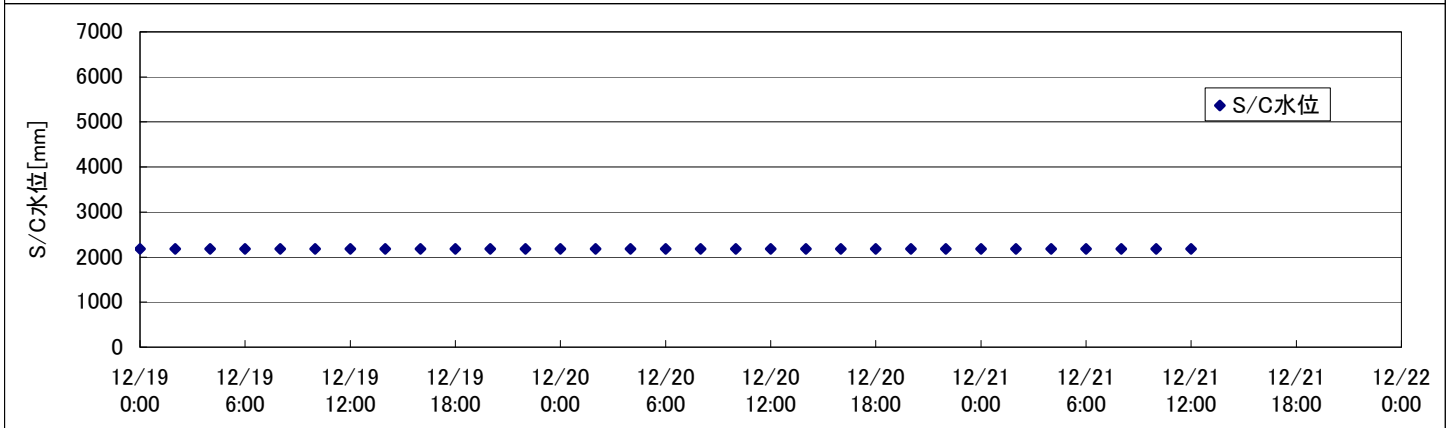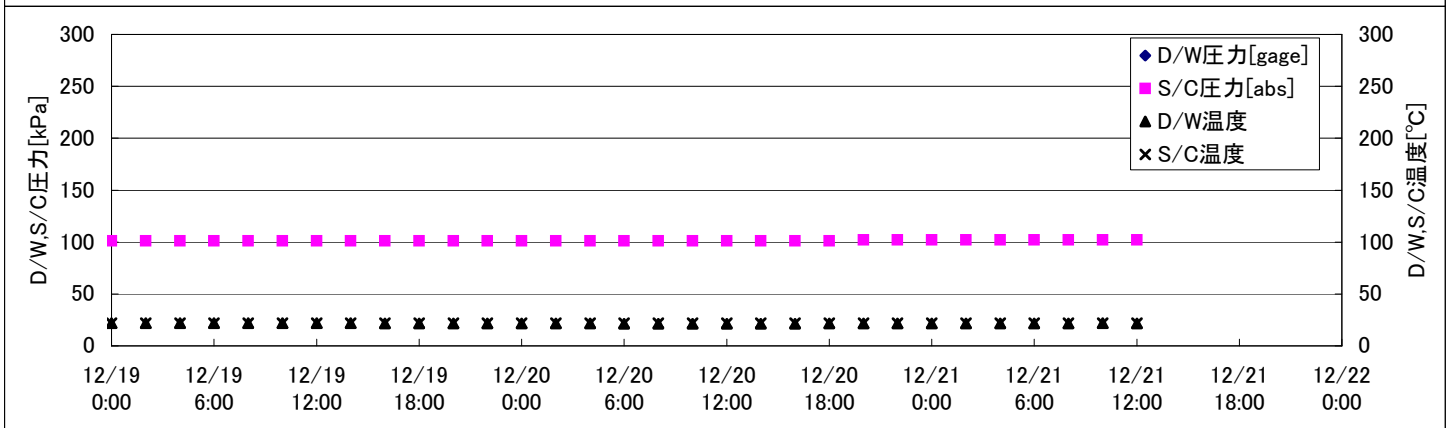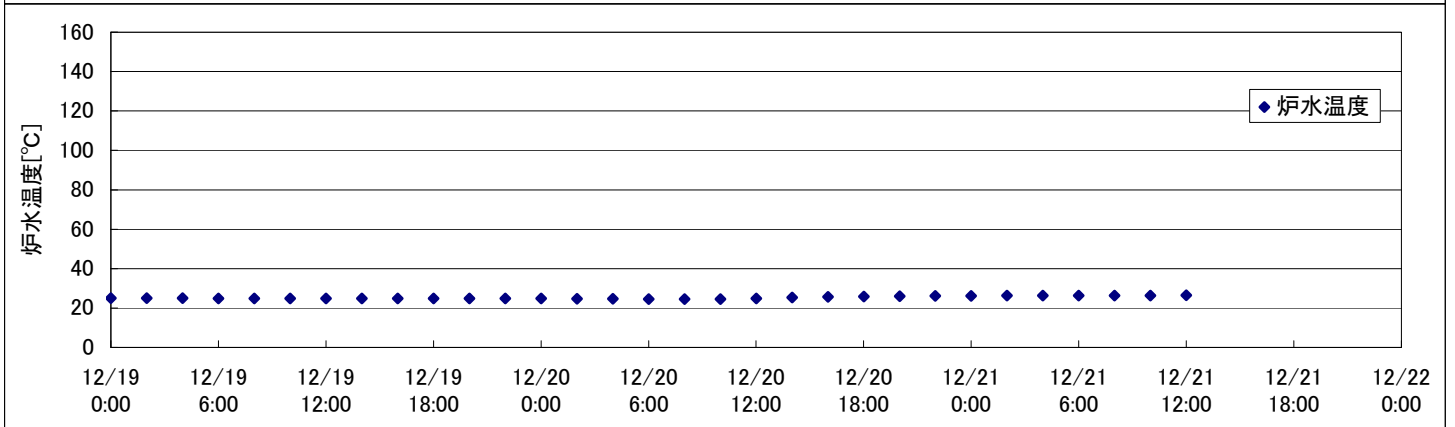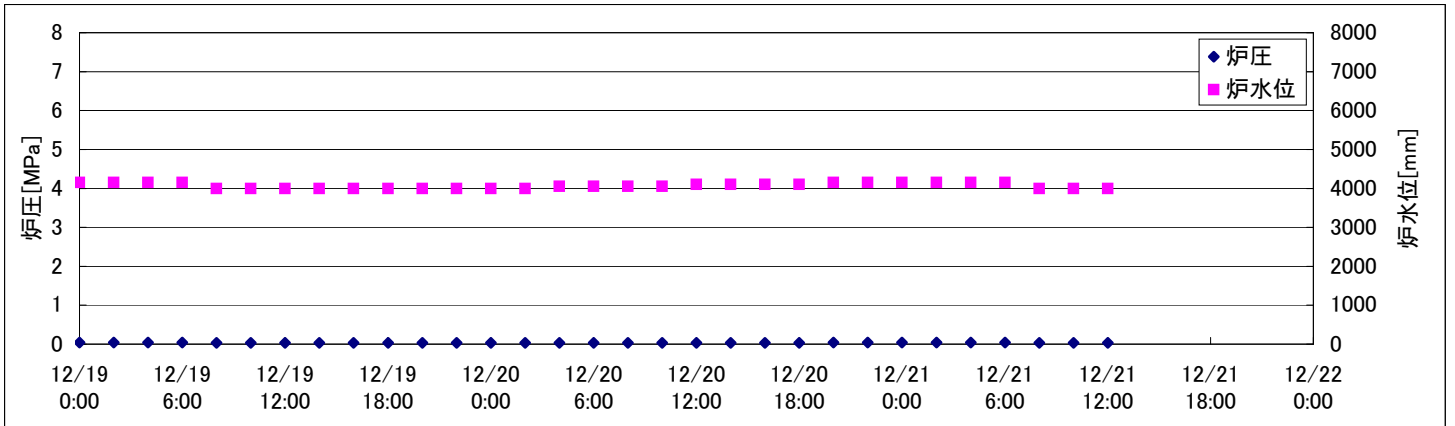





2F-2号機

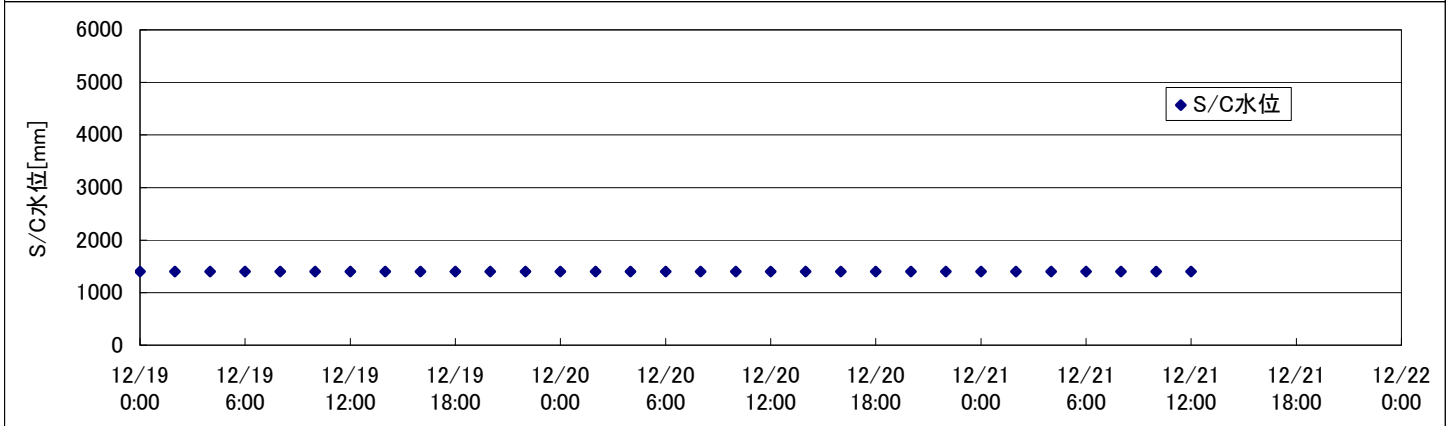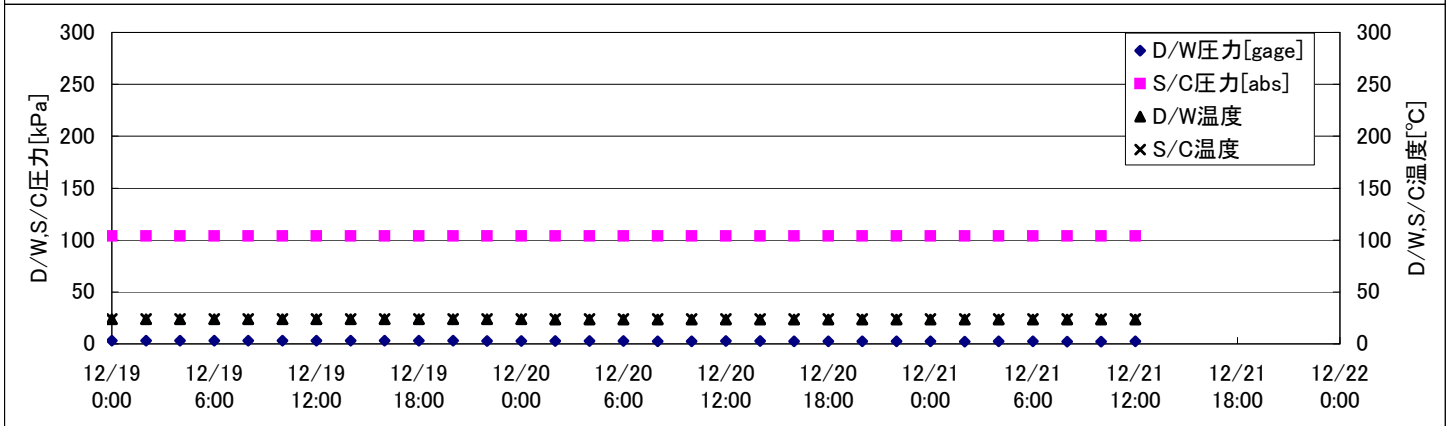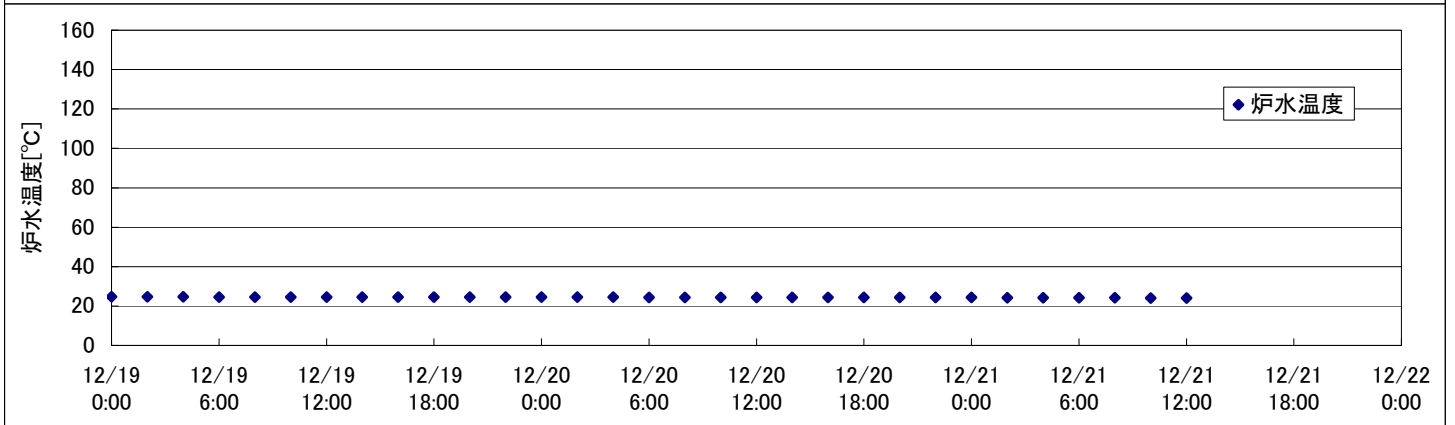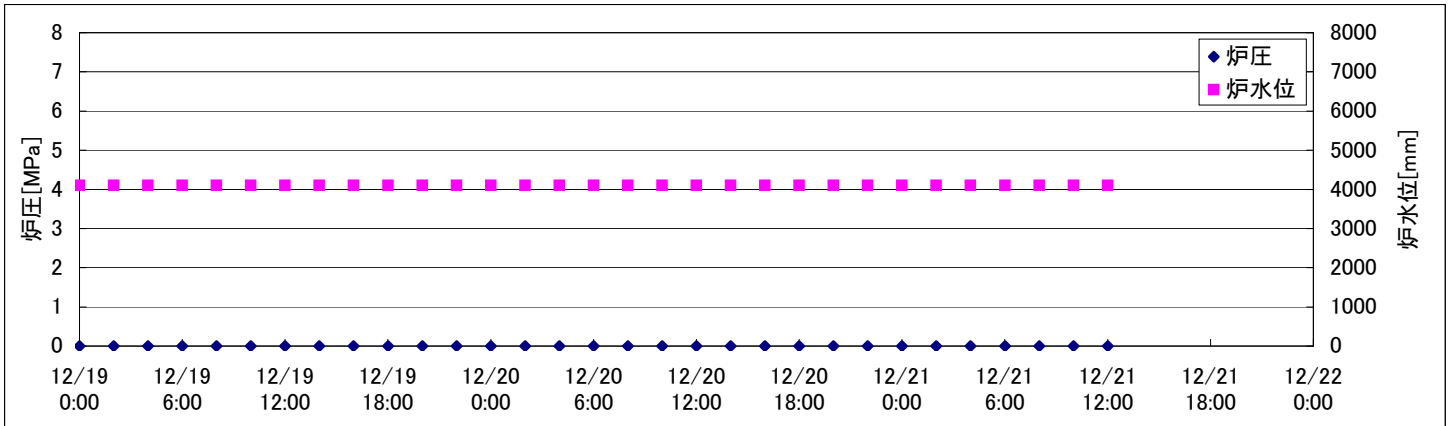

2F-3号機

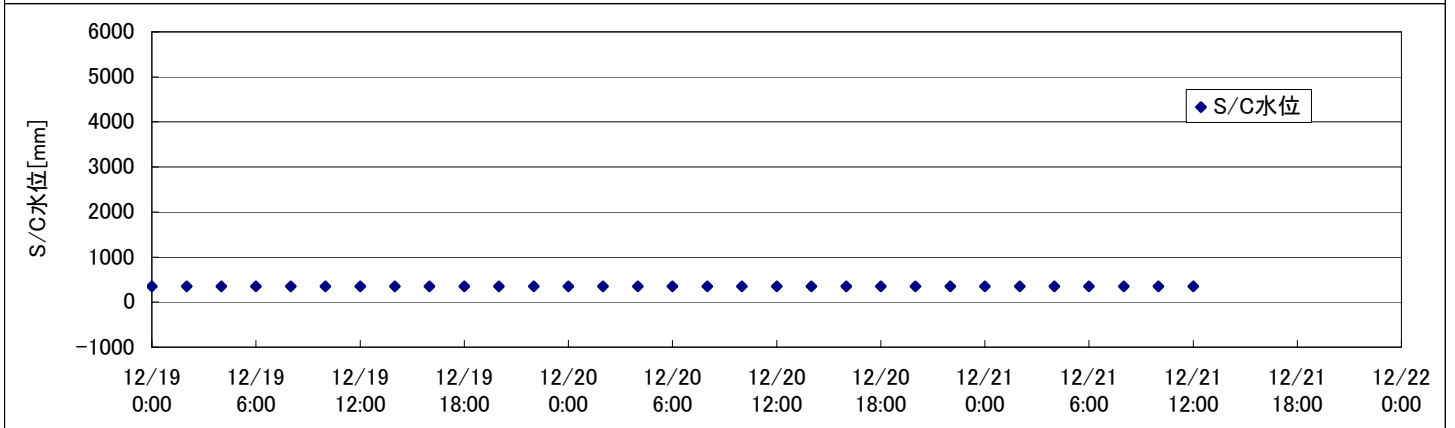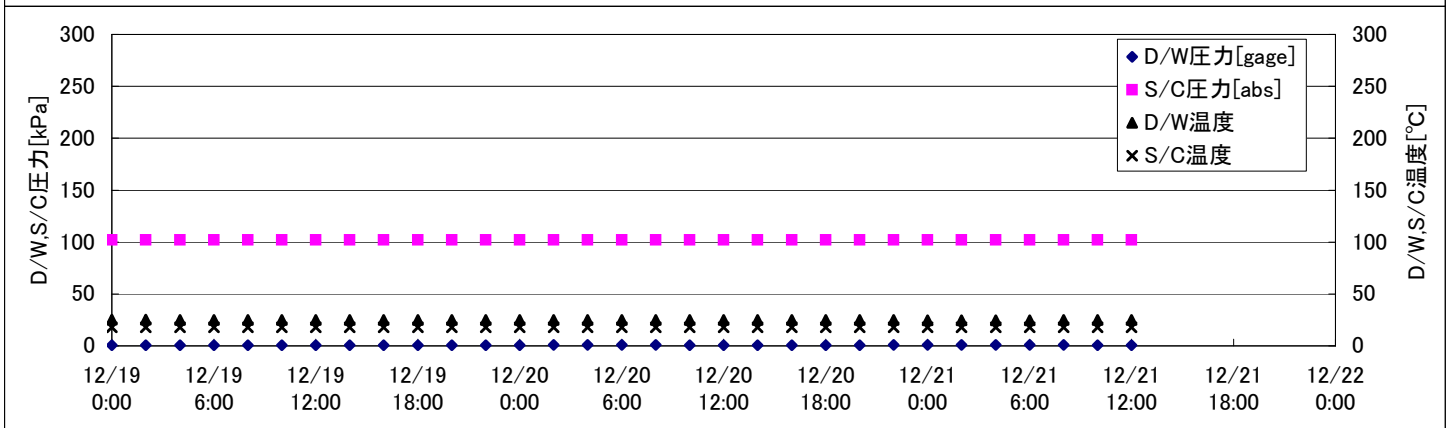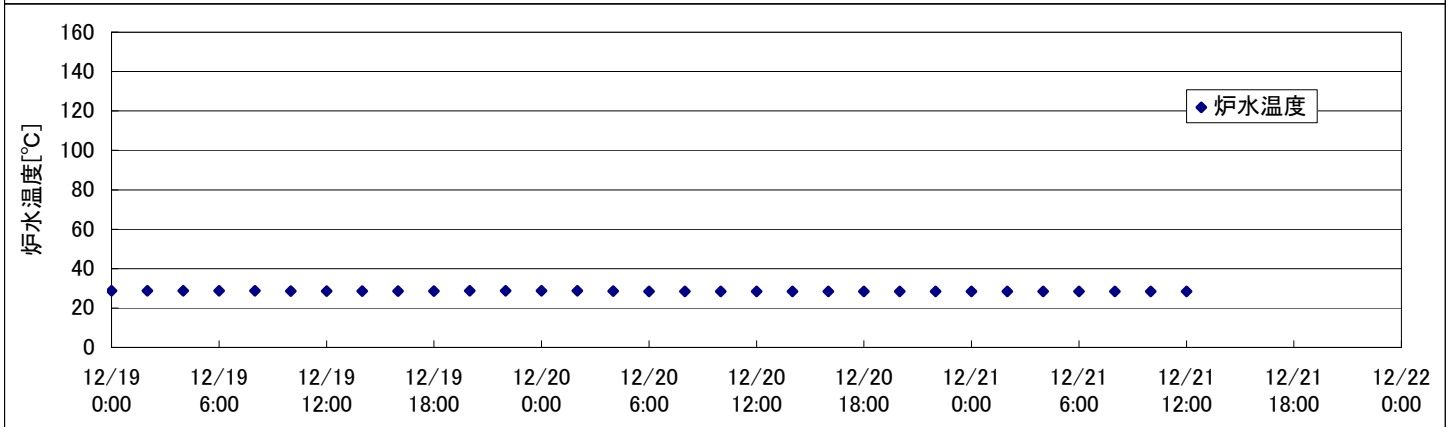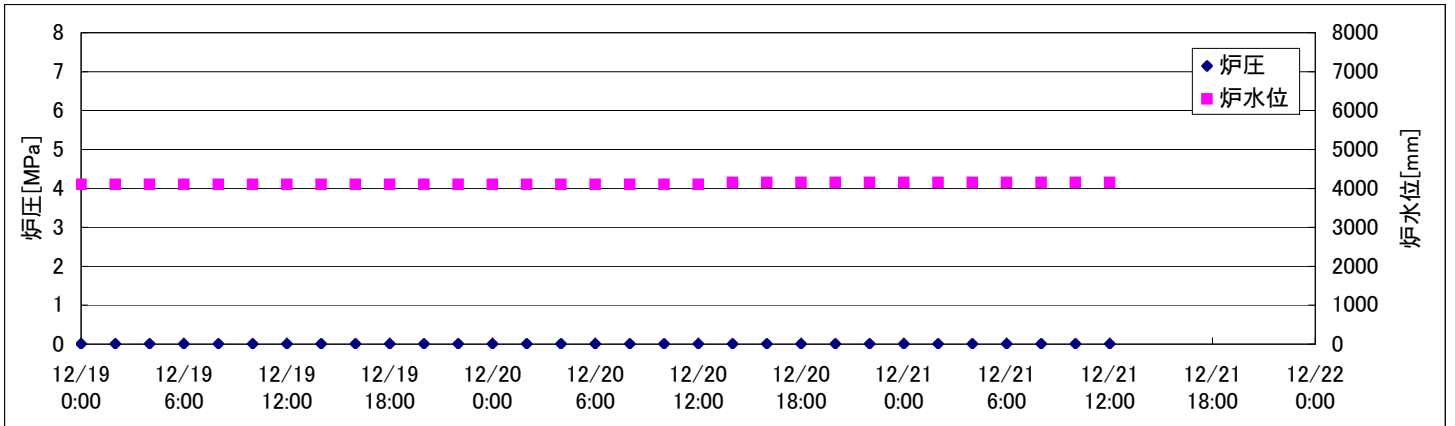

2F-4号機

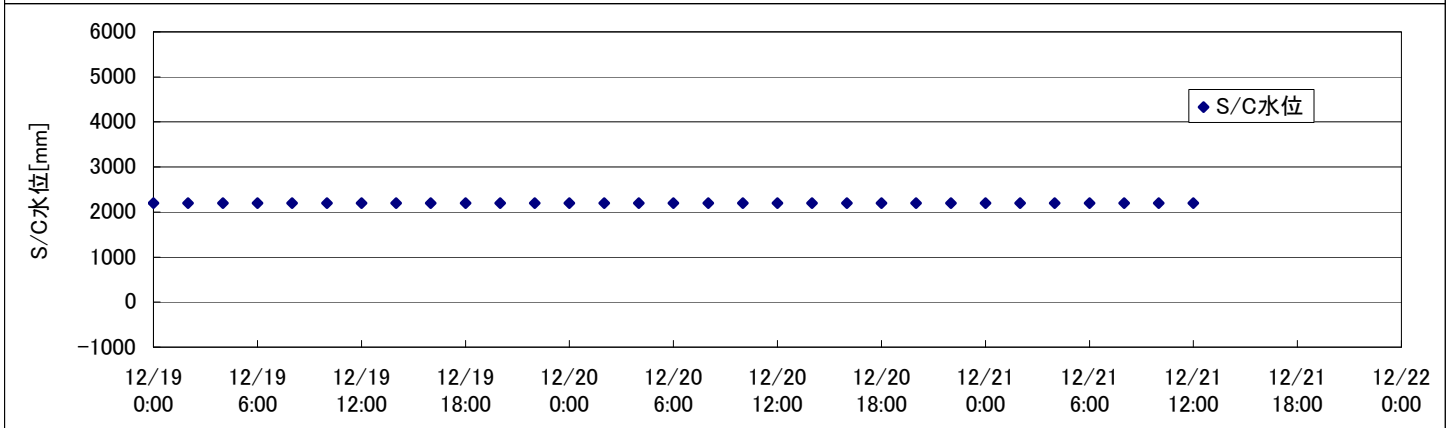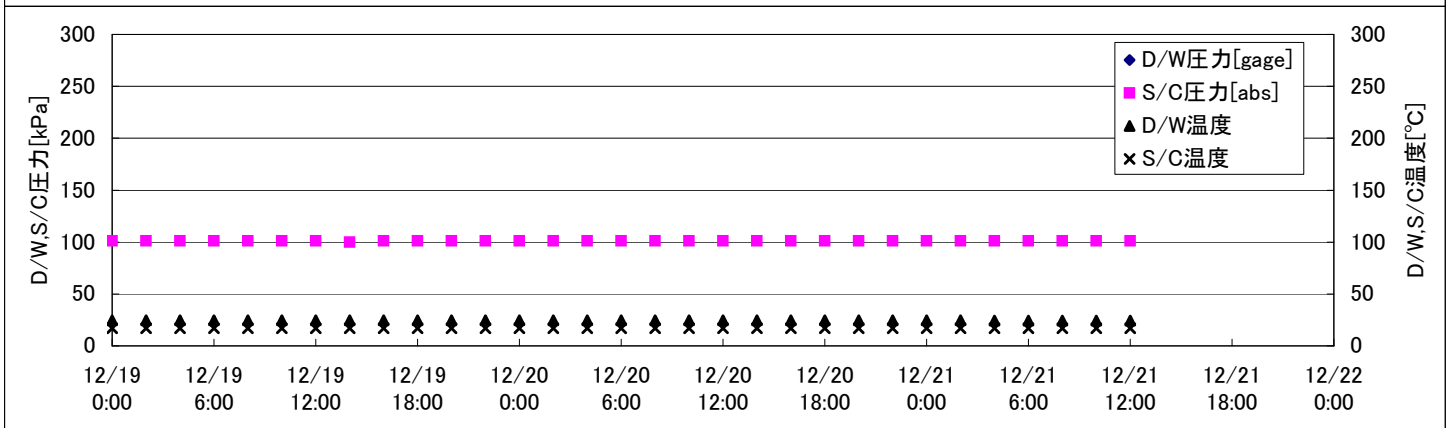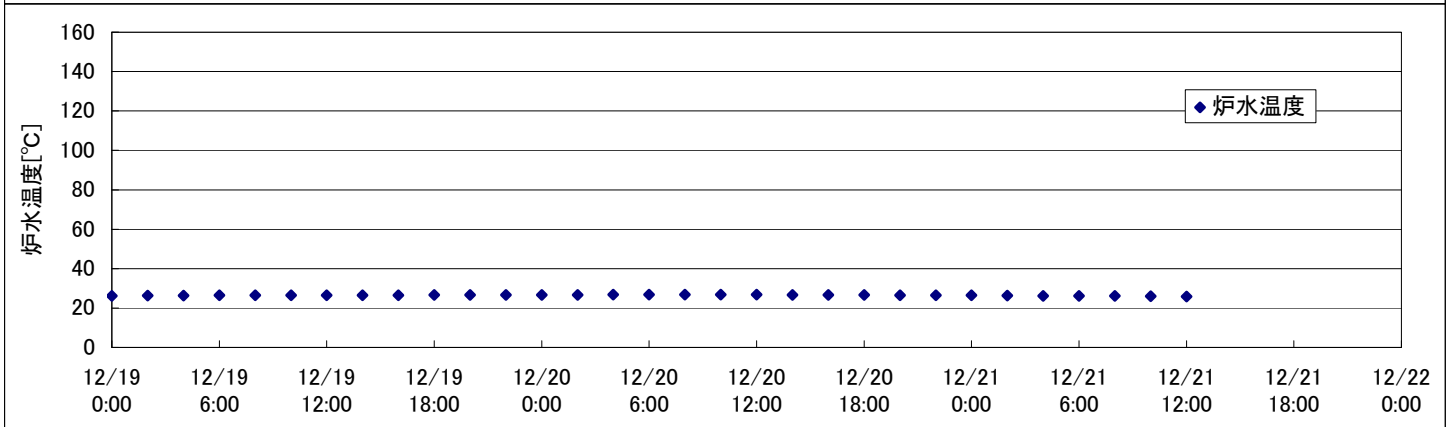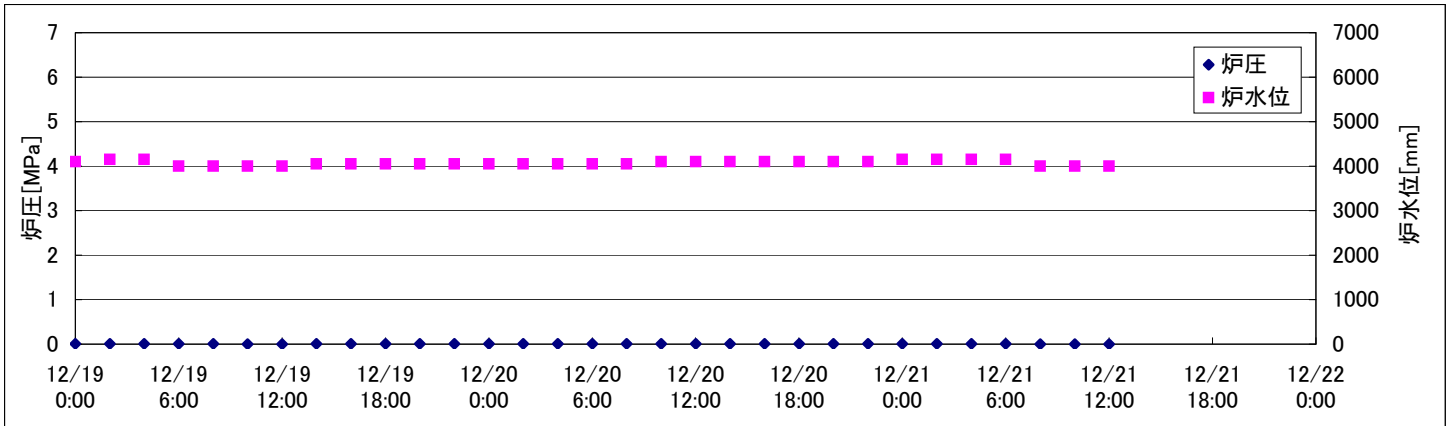

2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]

時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/12/19 0:00	0.01	4100	26.2		24.6	101	2200	17
2011/12/19 2:00	0.01	4150	26.3		24.6	101	2200	17
2011/12/19 4:00	0.01	4150	26.3		24.7	101	2200	17
2011/12/19 6:00	0.01	4000	26.4		24.7	101	2200	17
2011/12/19 8:00	0.01	4000	26.4		24.8	101	2200	17
2011/12/19 10:00	0.00	4000	26.4		24.7	101	2200	17
2011/12/19 12:00	0.00	4000	26.4		24.6	101	2200	17
2011/12/19 14:00	0.01	4050	26.4		24.7	100	2200	17
2011/12/19 16:00	0.01	4050	26.5		24.6	101	2200	17
2011/12/19 18:00	0.01	4050	26.6		24.6	101	2200	17
2011/12/19 20:00	0.01	4050	26.6		24.7	101	2200	17
2011/12/19 22:00	0.01	4050	26.7		24.8	101	2200	17
2011/12/20 0:00	0.01	4050	26.7		24.7	101	2200	17
2011/12/20 2:00	0.01	4050	26.7		24.7	101	2200	17
2011/12/20 4:00	0.01	4050	26.8		24.8	101	2200	17
2011/12/20 6:00	0.01	4050	26.8		24.7	101	2200	17
2011/12/20 8:00	0.01	4050	26.8		24.7	101	2200	17
2011/12/20 10:00	0.01	4100	26.8		24.7	101	2200	17
2011/12/20 12:00	0.01	4100	26.8		24.7	101	2200	17
2011/12/20 14:00	0.01	4100	26.7		24.7	101	2200	17
2011/12/20 16:00	0.01	4100	26.6		24.6	101	2200	17
2011/12/20 18:00	0.01	4100	26.6		24.6	101	2200	17
2011/12/20 20:00	0.01	4100	26.5		24.6	101	2200	17
2011/12/20 22:00	0.01	4100	26.4		24.6	101	2200	17
2011/12/21 0:00	0.01	4150	26.4		24.6	101	2200	17
2011/12/21 2:00	0.01	4150	26.3		24.6	101	2200	17
2011/12/21 4:00	0.01	4150	26.2		24.4	101	2200	17
2011/12/21 6:00	0.01	4150	26.1		24.4	101	2200	17
2011/12/21 8:00	0.00	4000	26.1		24.4	101	2200	17
2011/12/21 10:00	0.00	4000	26.0		24.5	101	2200	17
2011/12/21 12:00	0.00	4000	25.9		24.3	101	2200	17
2011/12/21 14:00								
2011/12/21 16:00								
2011/12/21 18:00								
2011/12/21 20:00								
2011/12/21 22:00								
2011/12/22 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず