

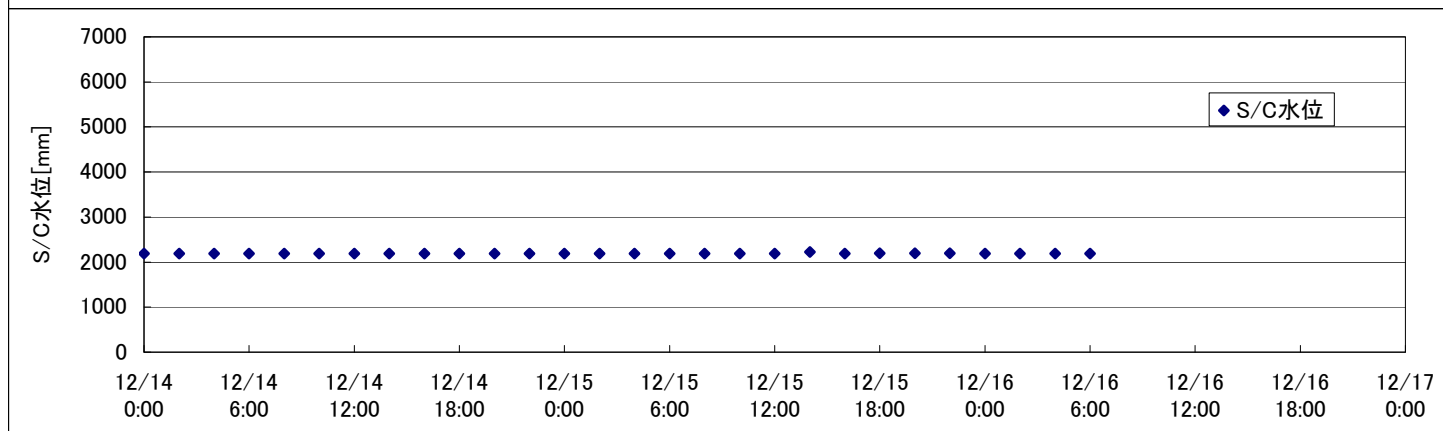
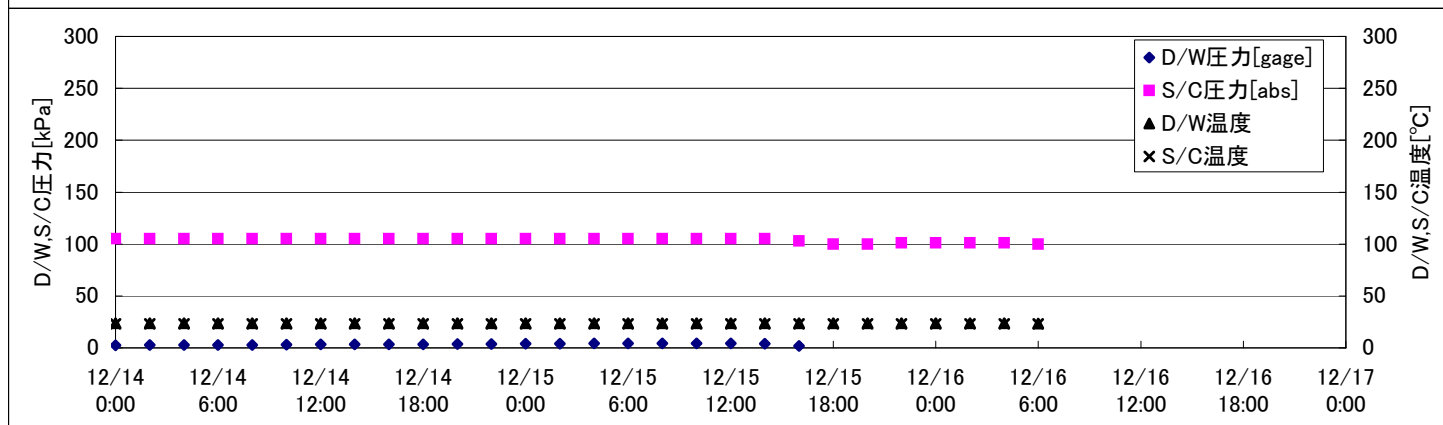
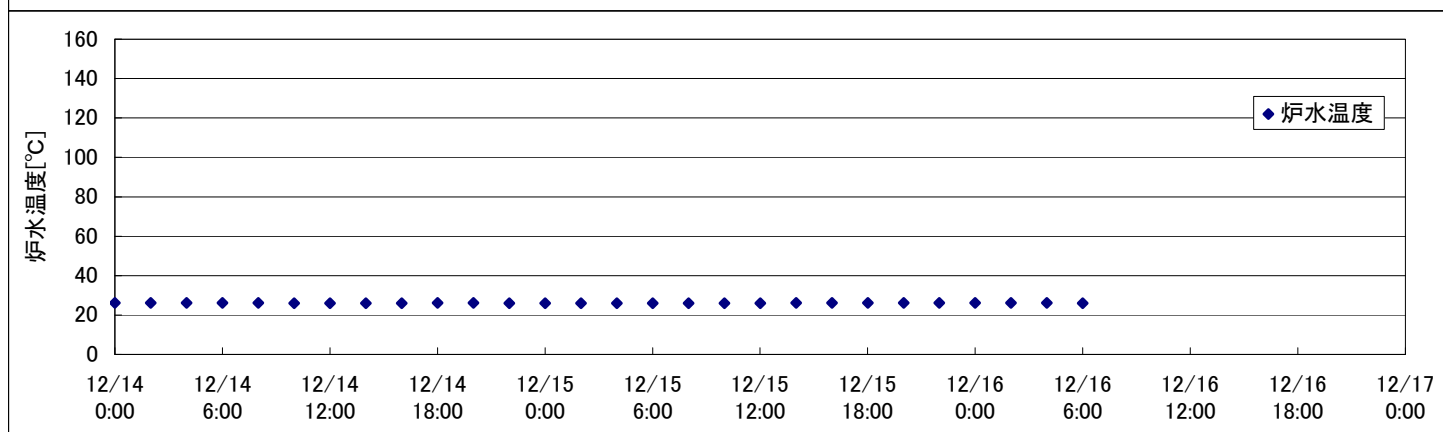
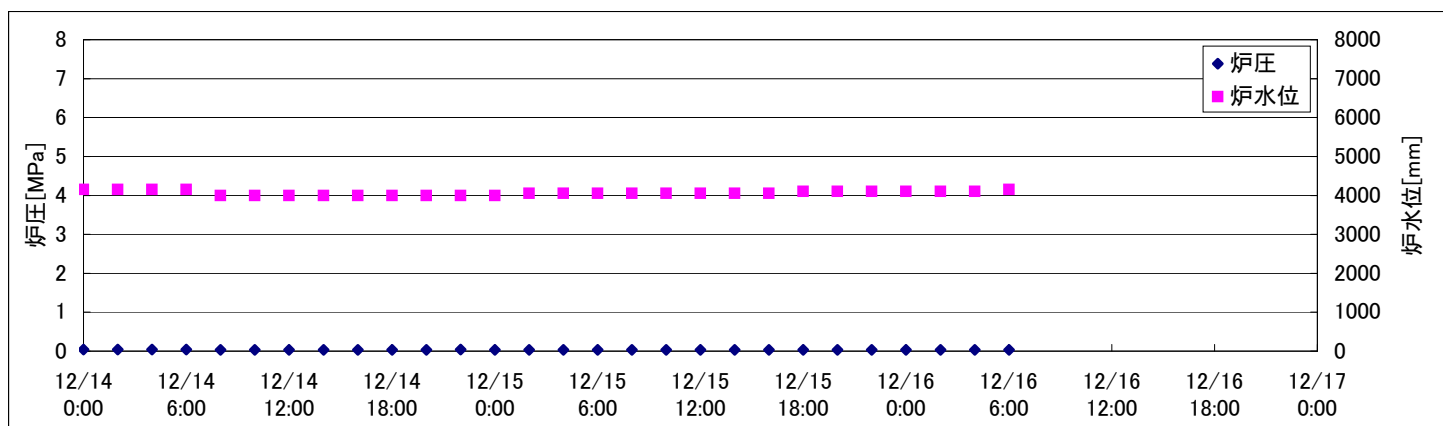
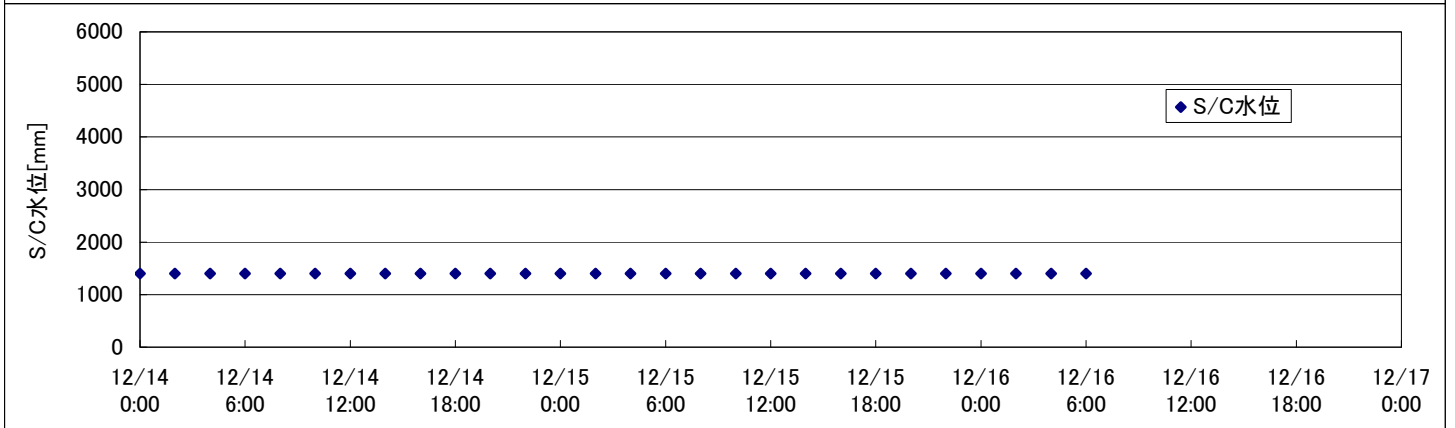
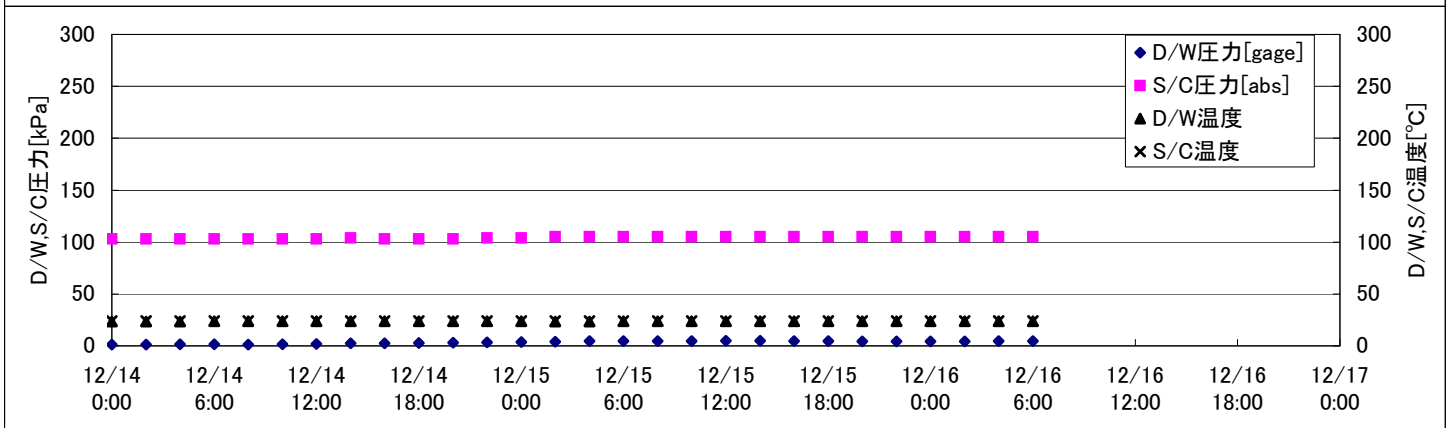






2F-1号機

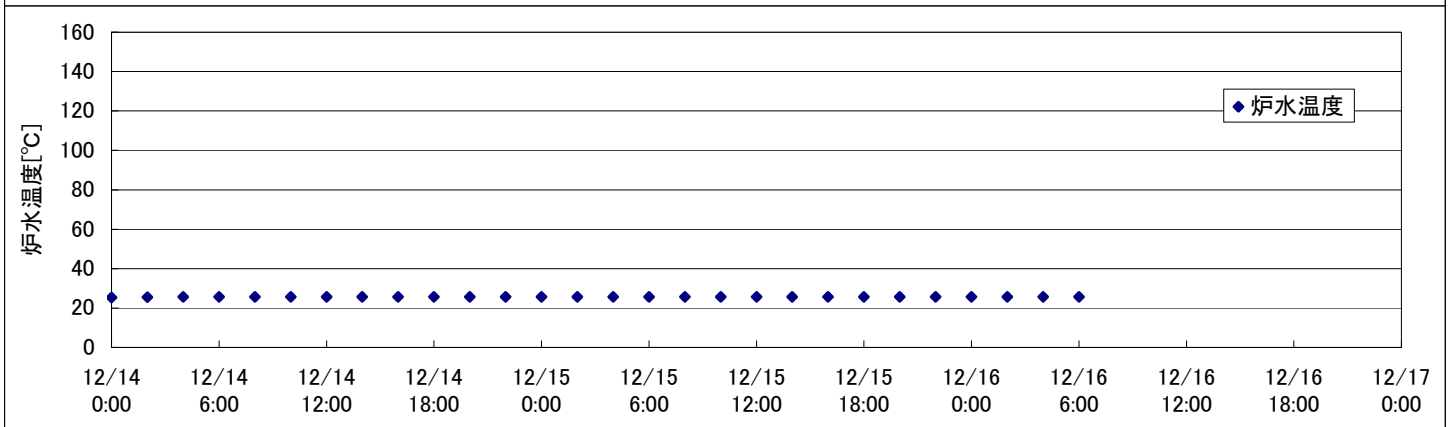





2F-2号機

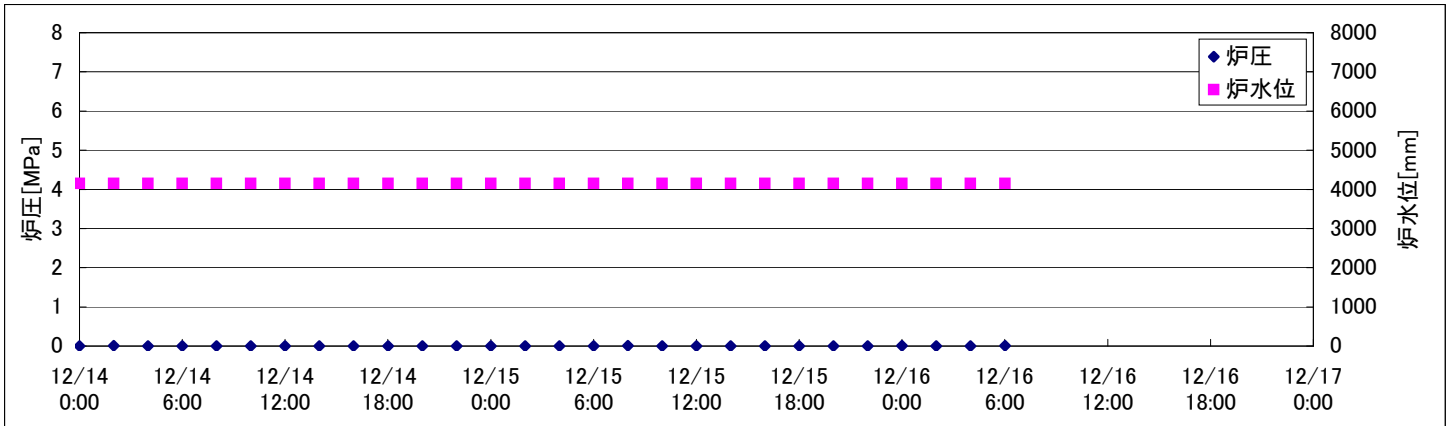

2F-3号機

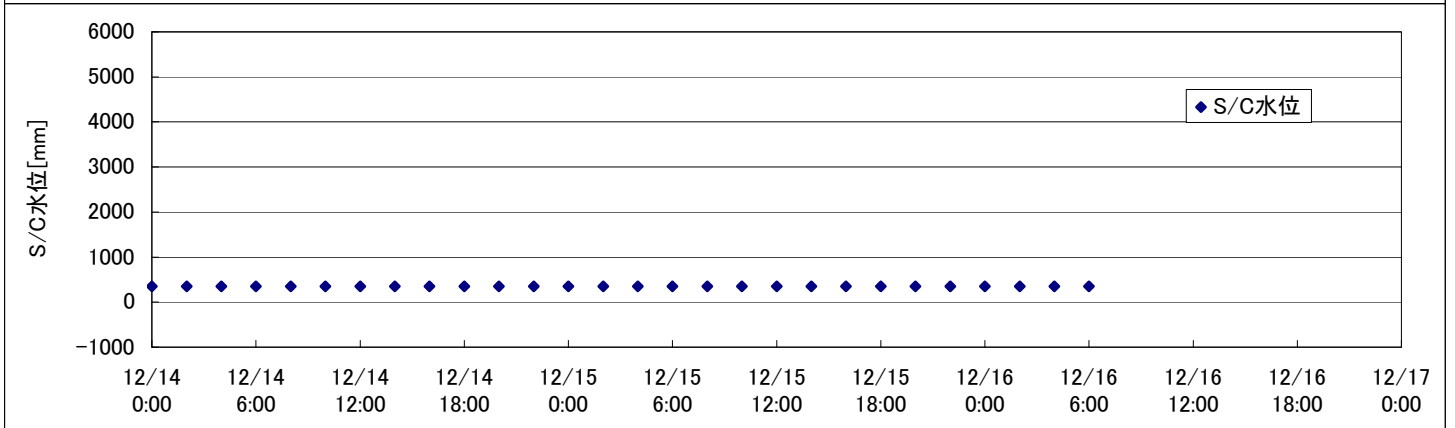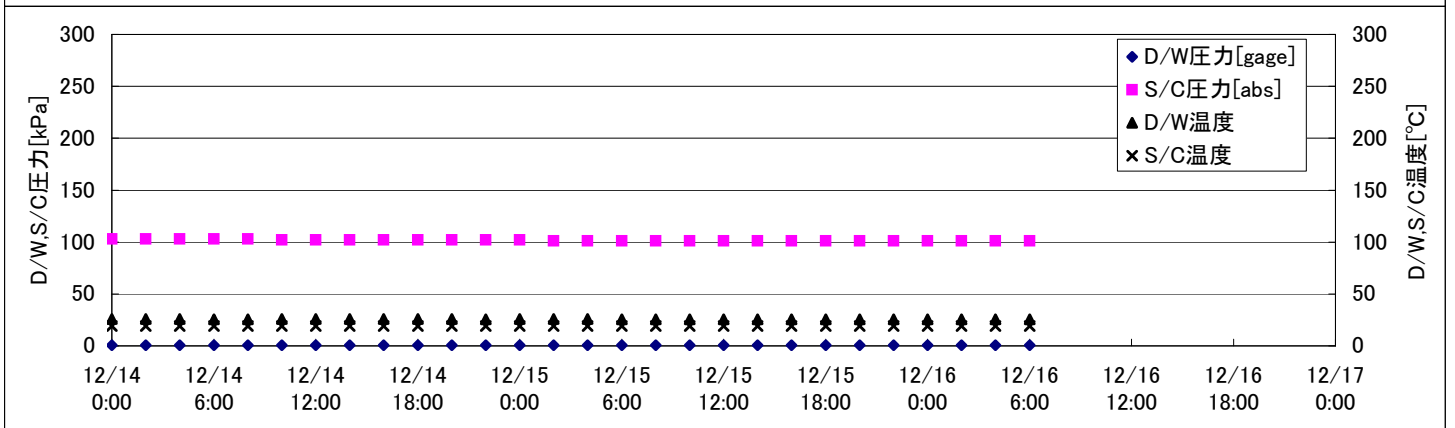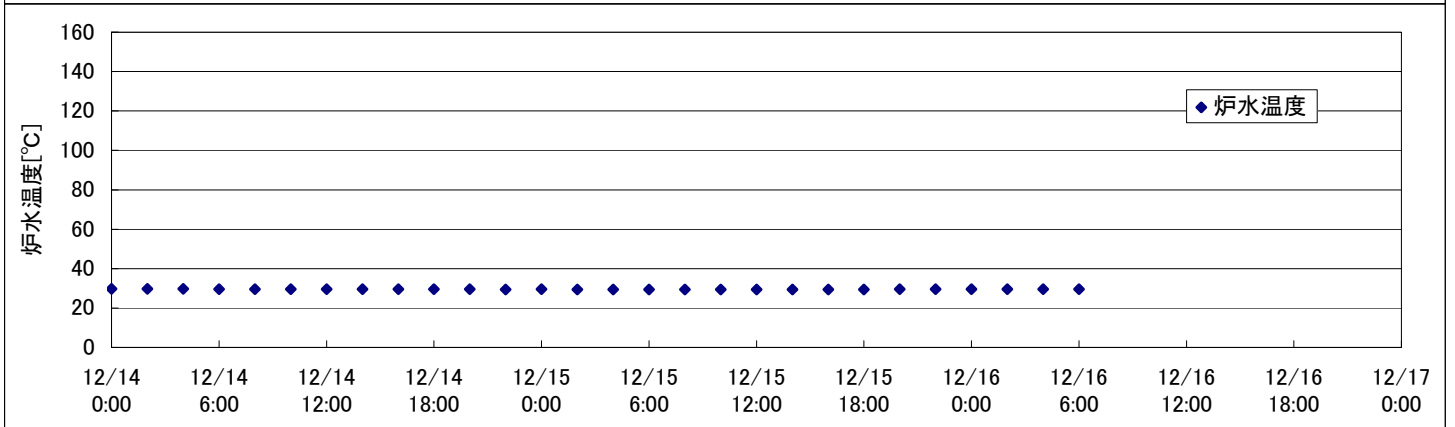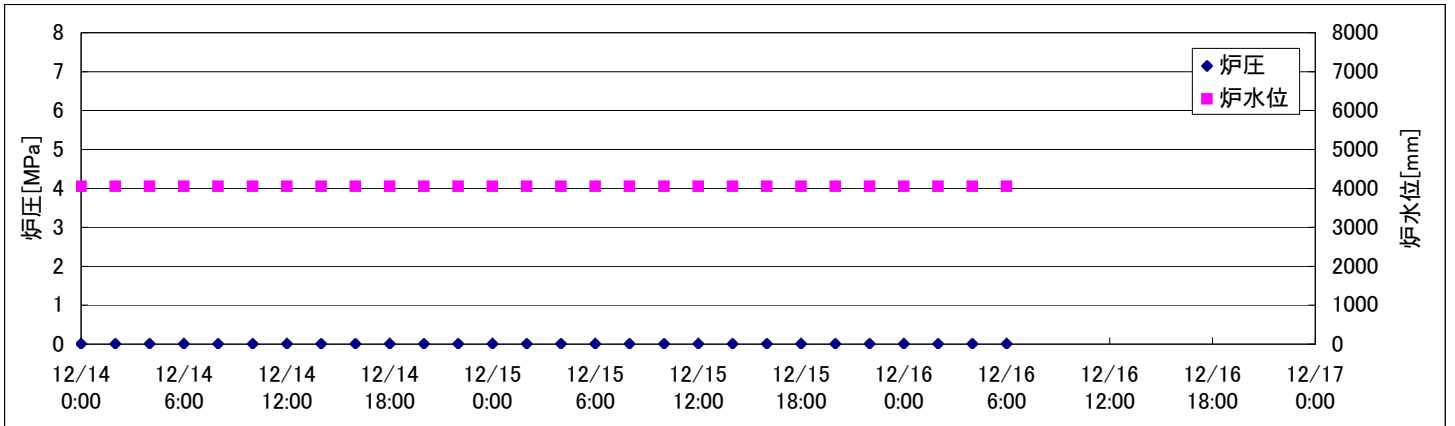

2F-4号機

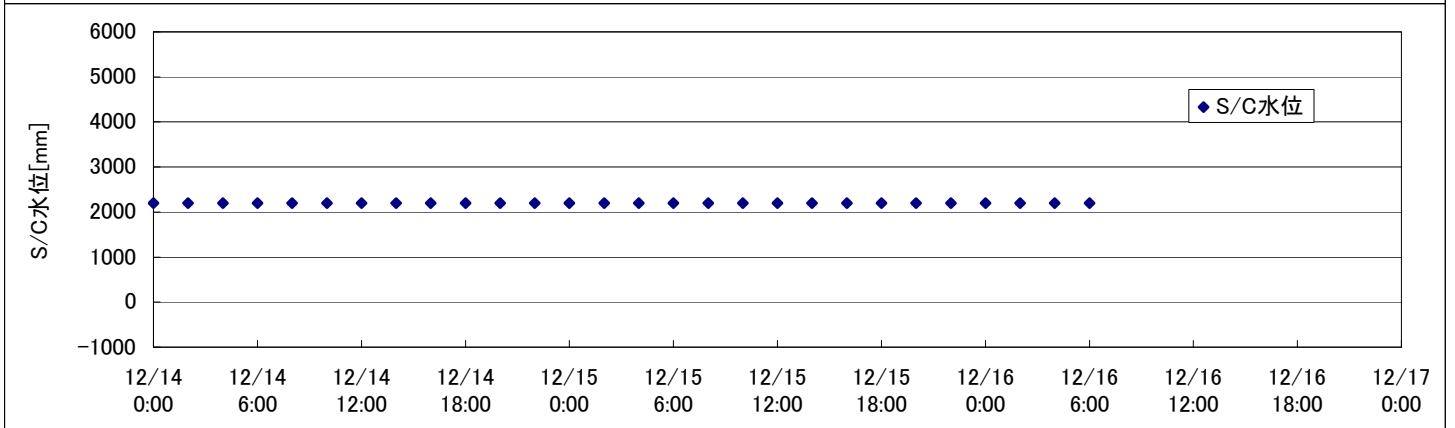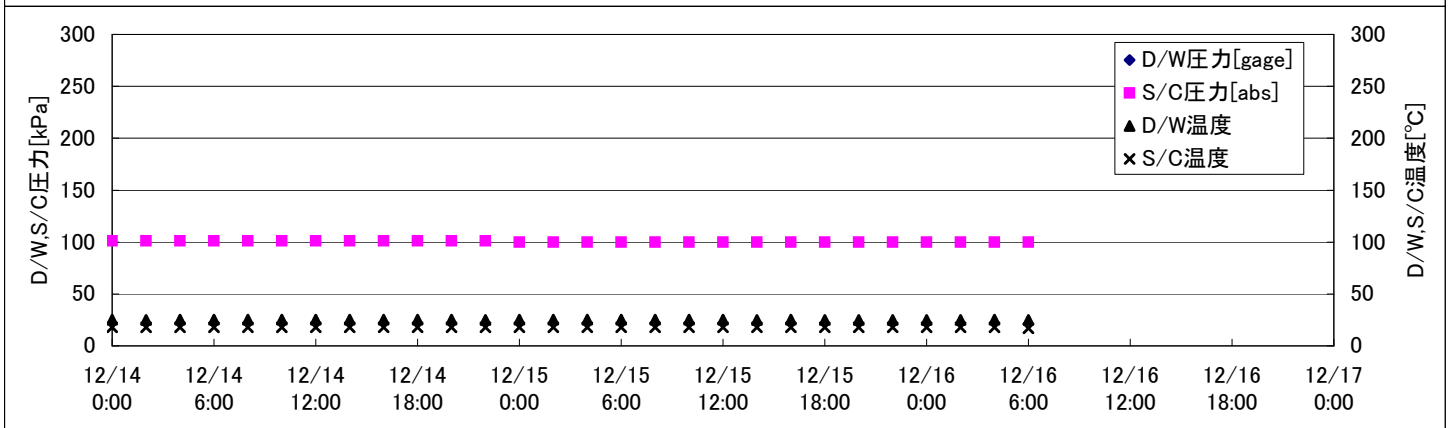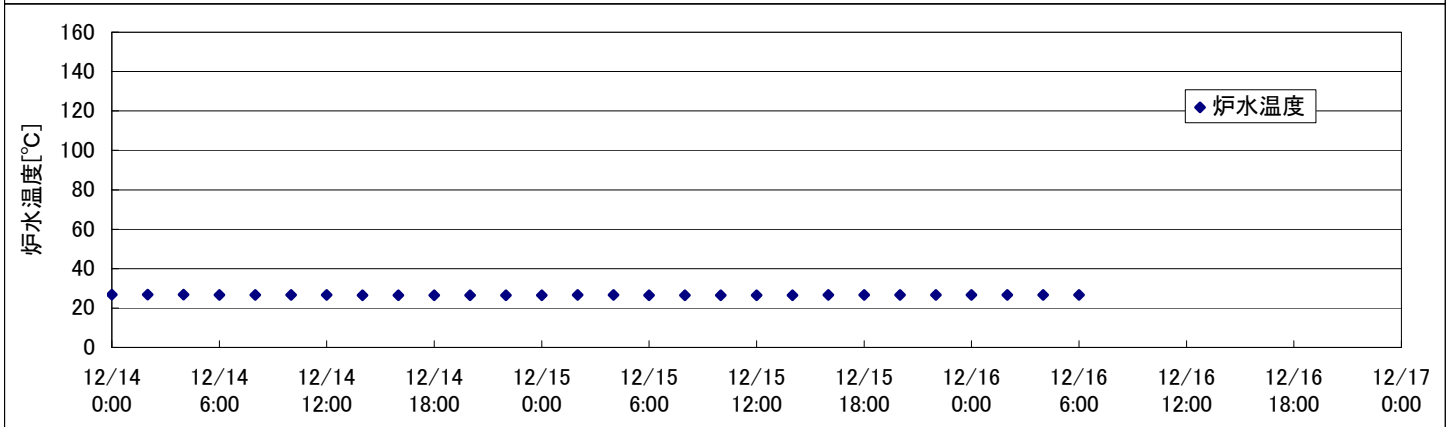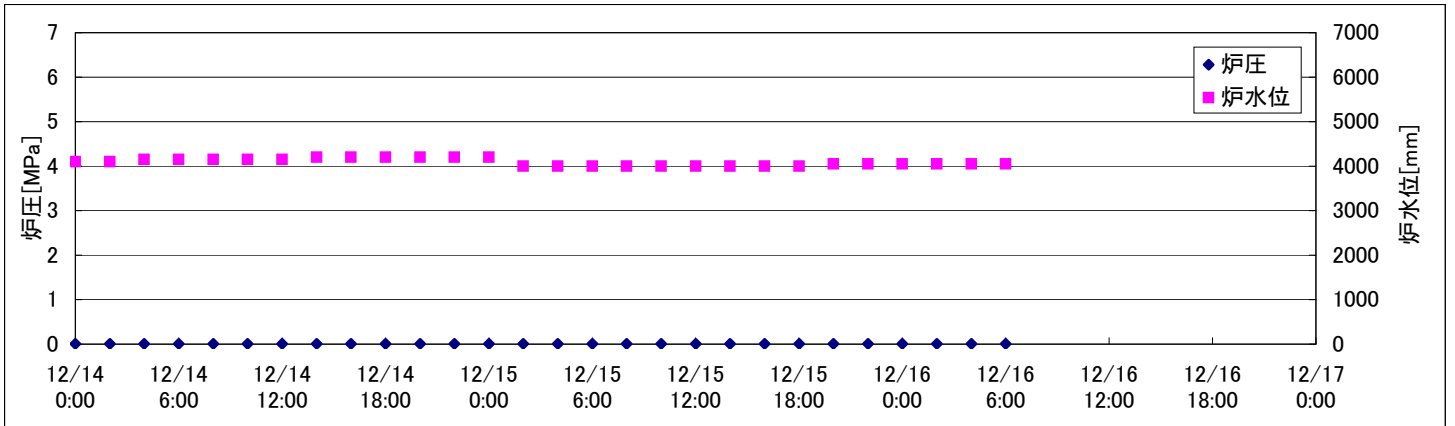

2F-1号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]

時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/12/14 0:00	0.04	4150	26.2	3	23.8	105	2188	23
2011/12/14 2:00	0.04	4150	26.1	3	23.8	105	2188	23
2011/12/14 4:00	0.04	4150	26.1	3	23.8	105	2188	23
2011/12/14 6:00	0.04	4150	26.1	3	23.8	105	2188	23
2011/12/14 8:00	0.03	4000	26.1	3	23.8	105	2187	23
2011/12/14 10:00	0.03	4000	26.0	3	23.8	105	2187	23
2011/12/14 12:00	0.03	4000	26.0	3	23.8	105	2188	23
2011/12/14 14:00	0.03	4000	26.0	3	23.8	105	2188	23
2011/12/14 16:00	0.03	4000	26.0	3	23.8	105	2188	23
2011/12/14 18:00	0.03	4000	26.1	4	23.8	105	2188	23
2011/12/14 20:00	0.03	4000	26.1	4	23.8	105	2188	23
2011/12/14 22:00	0.04	4000	26.0	4	23.8	105	2188	23
2011/12/15 0:00	0.03	4000	26.0	4	23.8	105	2188	23
2011/12/15 2:00	0.03	4050	26.0	4	23.8	105	2188	23
2011/12/15 4:00	0.03	4050	26.0	4	23.8	105	2188	23
2011/12/15 6:00	0.03	4050	26.0	4	23.8	105	2188	23
2011/12/15 8:00	0.03	4050	26.0	4	23.8	105	2188	23
2011/12/15 10:00	0.03	4050	26.0	4	23.8	105	2189	23
2011/12/15 12:00	0.03	4050	26.0	4	23.8	105	2189	23
2011/12/15 14:00	0.03	4050	26.1	4	23.8	105	2222	23
2011/12/15 16:00	0.03	4050	26.1	2	23.8	103	2189	23
2011/12/15 18:00	0.03	4100	26.1	-1	23.7	100	2194	23
2011/12/15 20:00	0.03	4100	26.1	0	23.8	100	2193	23
2011/12/15 22:00	0.03	4100	26.2	0	23.6	101	2193	23
2011/12/16 0:00	0.03	4100	26.2	0	23.6	101	2189	23
2011/12/16 2:00	0.03	4100	26.1	0	23.6	101	2189	23
2011/12/16 4:00	0.03	4100	26.1	0	23.6	101	2188	23
2011/12/16 6:00	0.03	4150	26.0	0	23.4	100	2188	23
2011/12/16 8:00								
2011/12/16 10:00								
2011/12/16 12:00								
2011/12/16 14:00								
2011/12/16 16:00								
2011/12/16 18:00								
2011/12/16 20:00								
2011/12/16 22:00								
2011/12/17 0:00								

D/Wベントおよびパージ操作
 ・12/15 13:53～14:52 D/Wベント
 ・12/15 17:43よりD/Wパージ(空気置換)





2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]





時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/12/14 0:00	0.01	4100	26.8		25.4	101	2200	18
2011/12/14 2:00	0.01	4100	26.8		25.1	101	2200	18
2011/12/14 4:00	0.01	4150	26.8		25.3	101	2200	18
2011/12/14 6:00	0.01	4150	26.7		25.3	101	2200	18
2011/12/14 8:00	0.01	4150	26.6		25.3	101	2200	18
2011/12/14 10:00	0.01	4150	26.6		25.2	101	2200	18
2011/12/14 12:00	0.01	4150	26.6		25.2	101	2200	18
2011/12/14 14:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 16:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 18:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 20:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 22:00	0.01	4200	26.5		25.1	101	2200	18
2011/12/15 0:00	0.01	4200	26.5		25.2	100	2200	18
2011/12/15 2:00	0.01	4000	26.6		25.3	100	2200	18
2011/12/15 4:00	0.01	4000	26.6		25.3	100	2200	18
2011/12/15 6:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 8:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 10:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 12:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 14:00	0.01	4000	26.5		25.1	100	2200	18
2011/12/15 16:00	0.01	4000	26.6		25.2	100	2200	18
2011/12/15 18:00	0.01	4000	26.6		25.1	100	2200	18
2011/12/15 20:00	0.01	4050	26.6		25.0	100	2200	18
2011/12/15 22:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 0:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 2:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 4:00	0.01	4050	26.6		25.2	100	2200	18
2011/12/16 6:00	0.01	4050	26.6		25.0	100	2200	17
2011/12/16 8:00								
2011/12/16 10:00								
2011/12/16 12:00								
2011/12/16 14:00								
2011/12/16 16:00								
2011/12/16 18:00								
2011/12/16 20:00								
2011/12/16 22:00								
2011/12/17 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず





2F-1号機

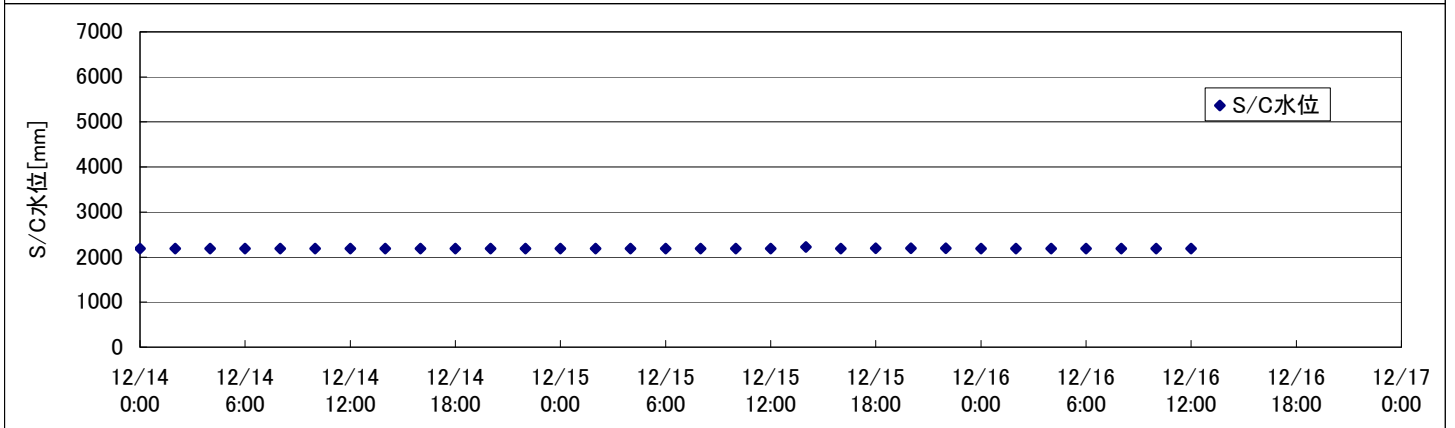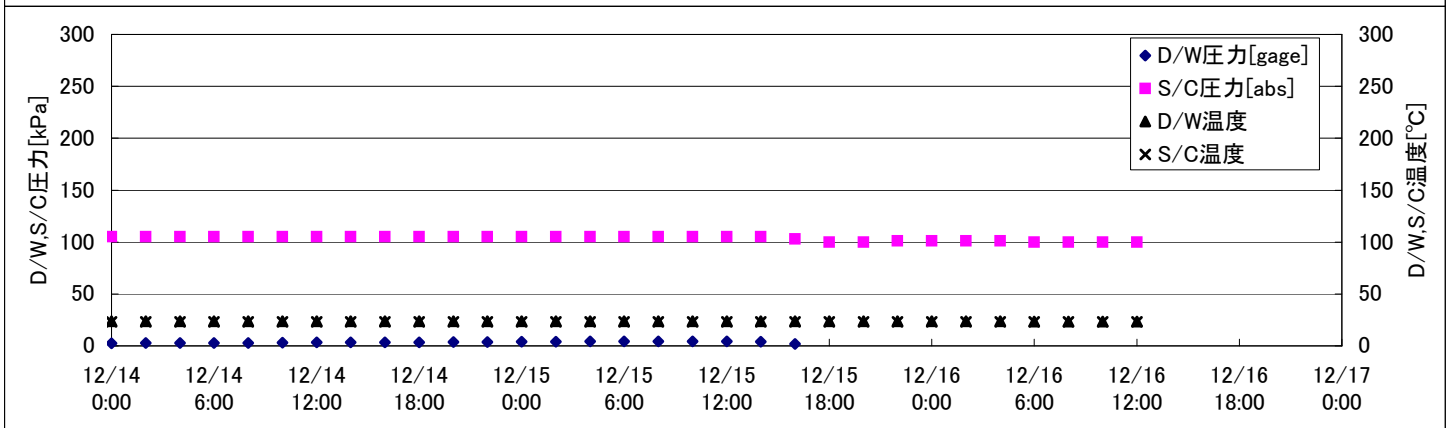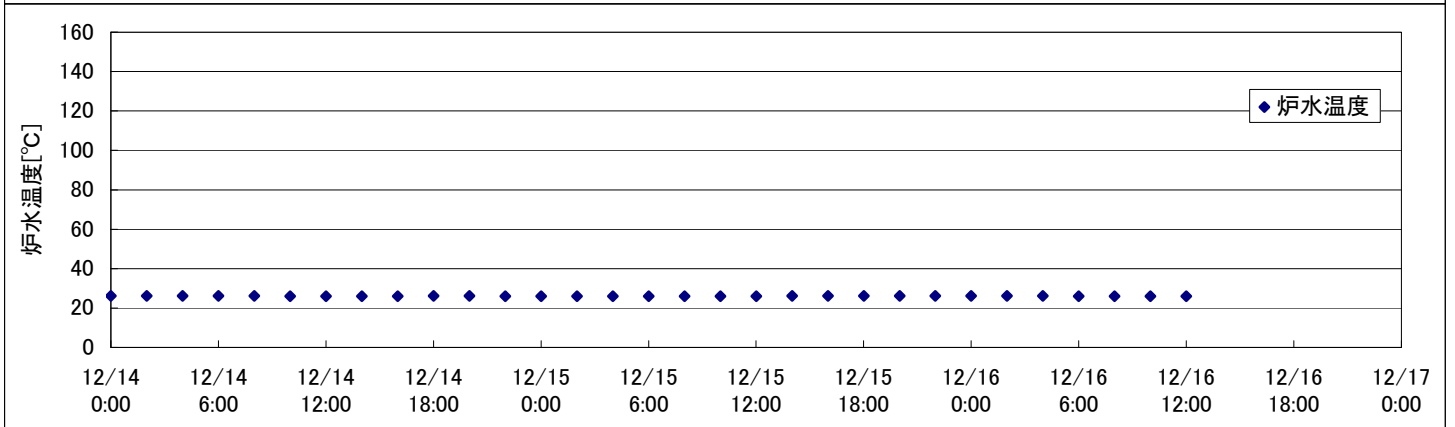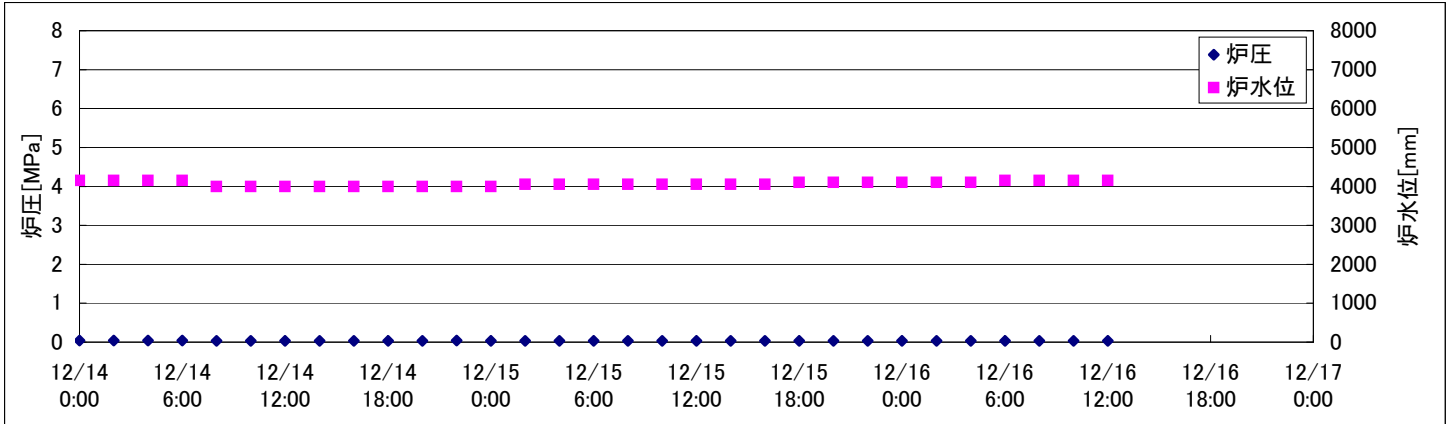





2F-2号機

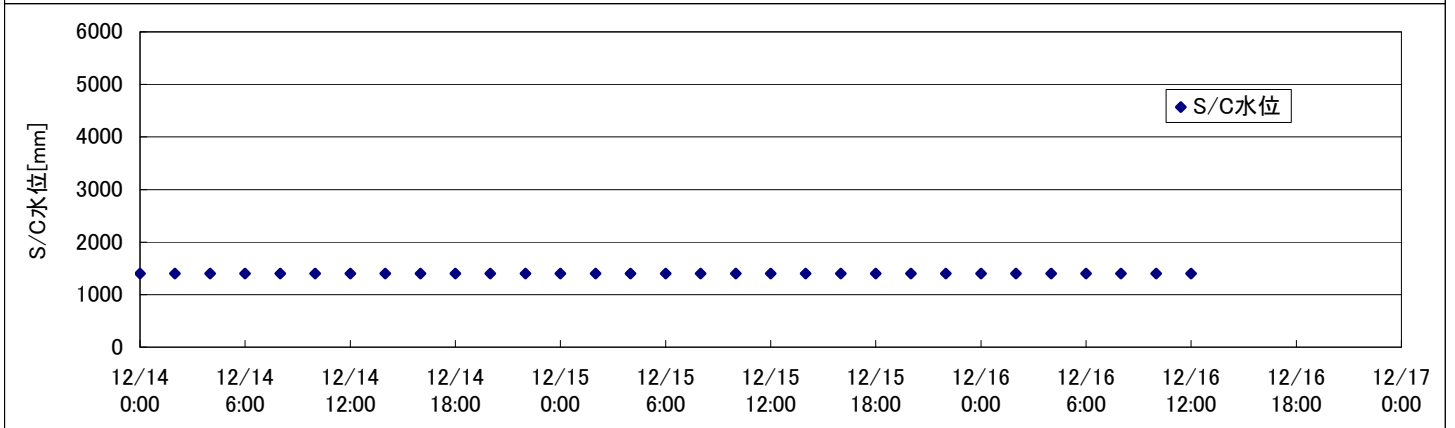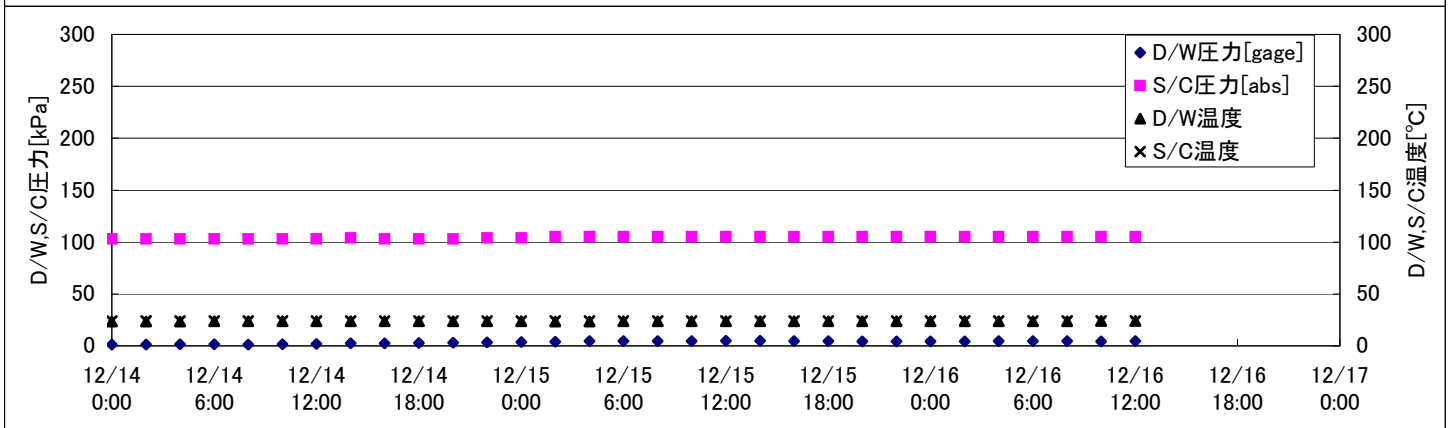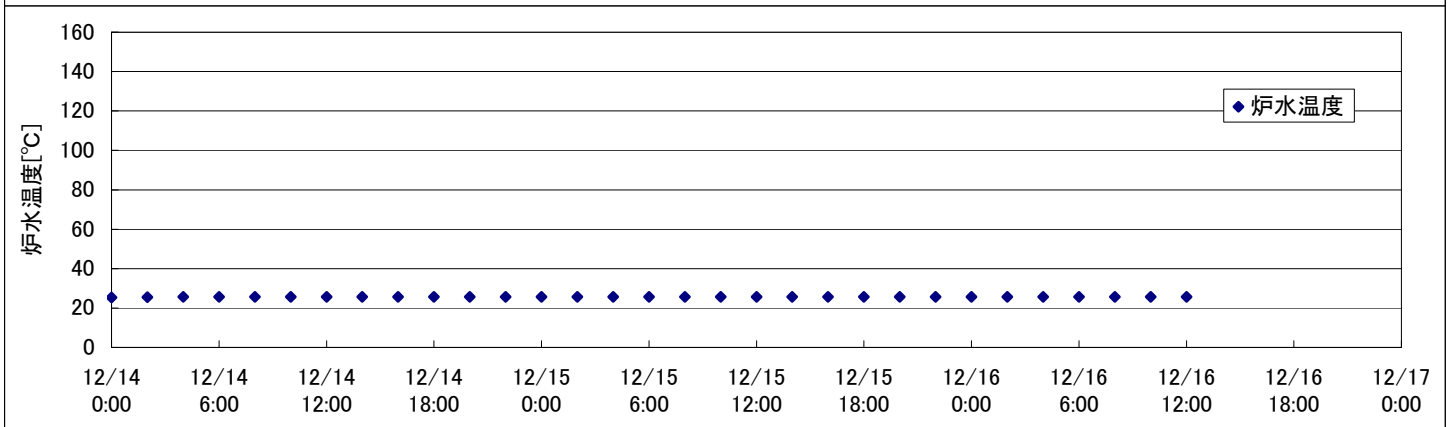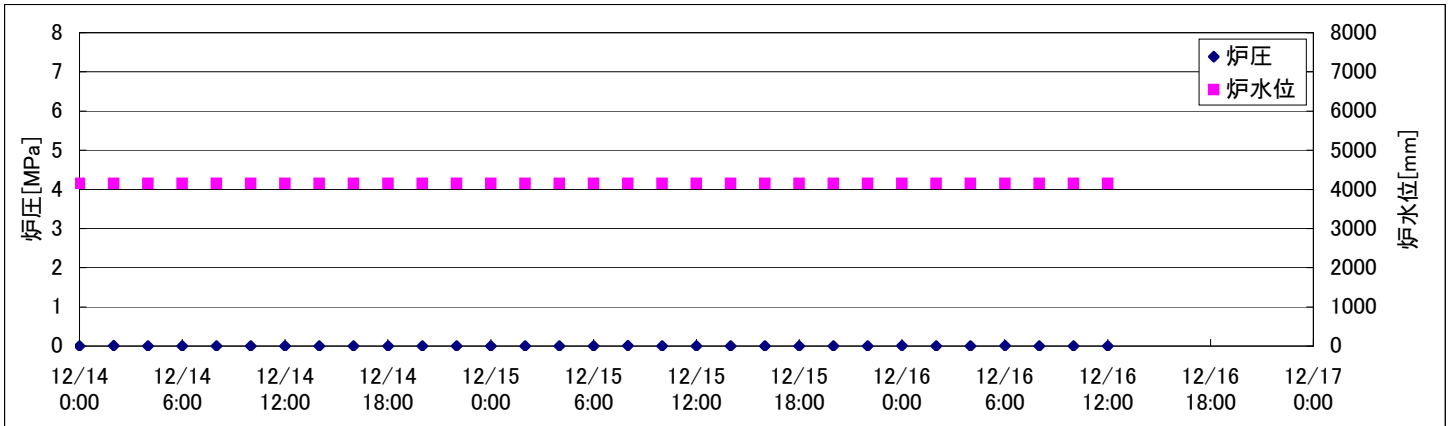

2F-3号機

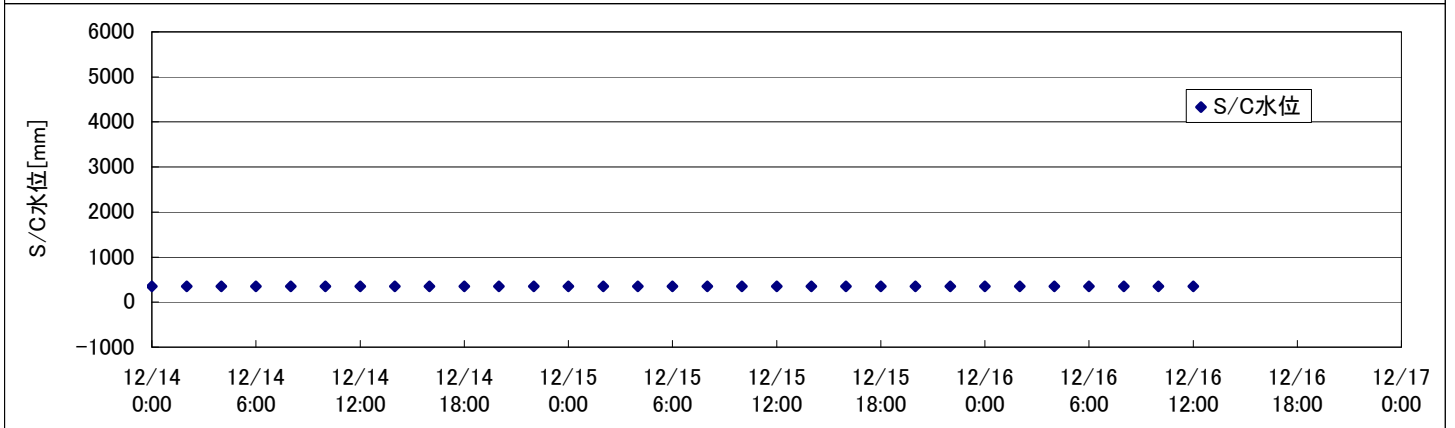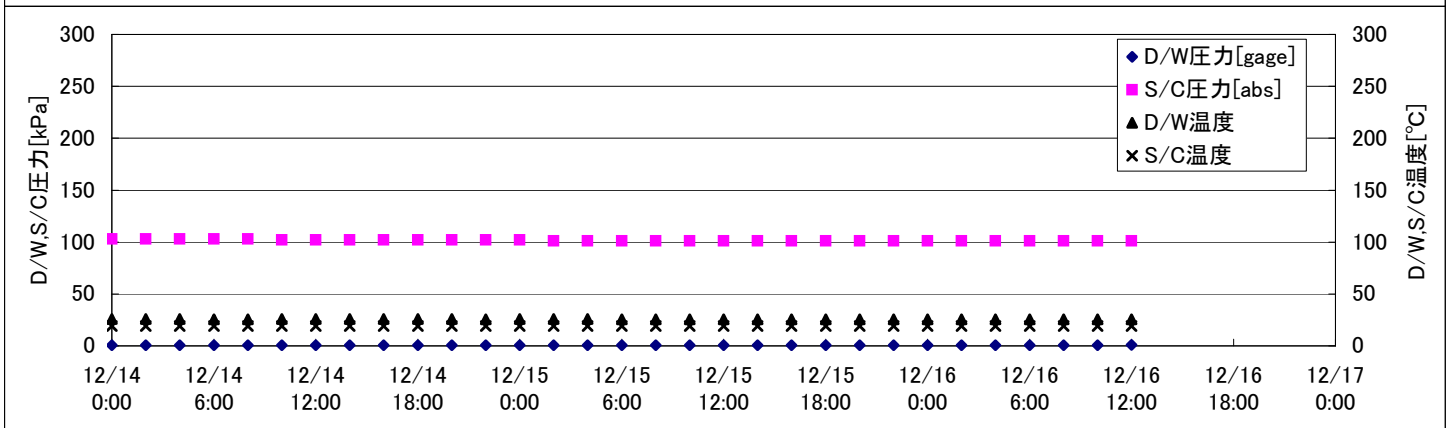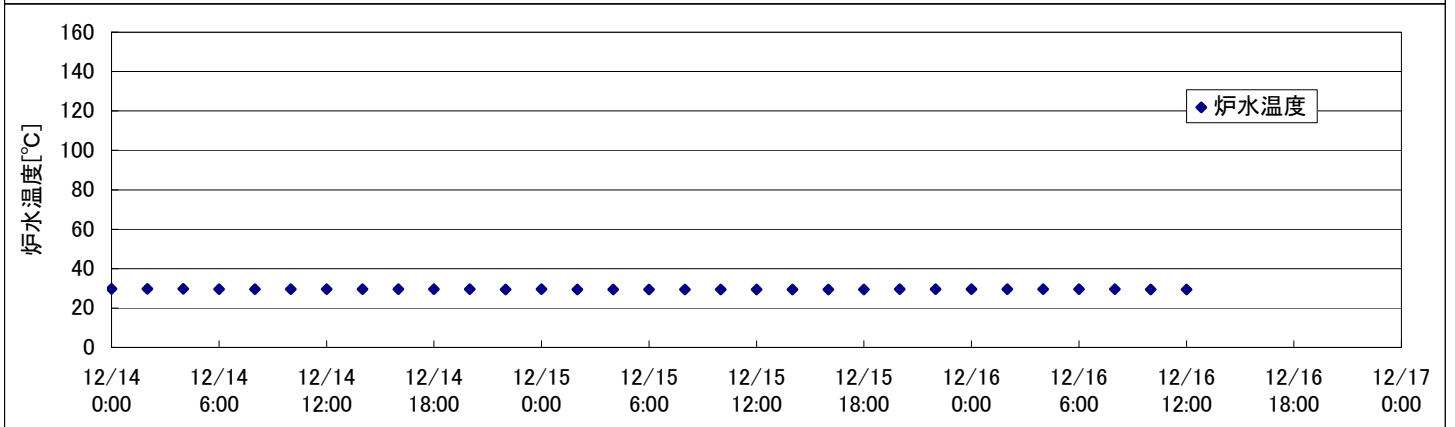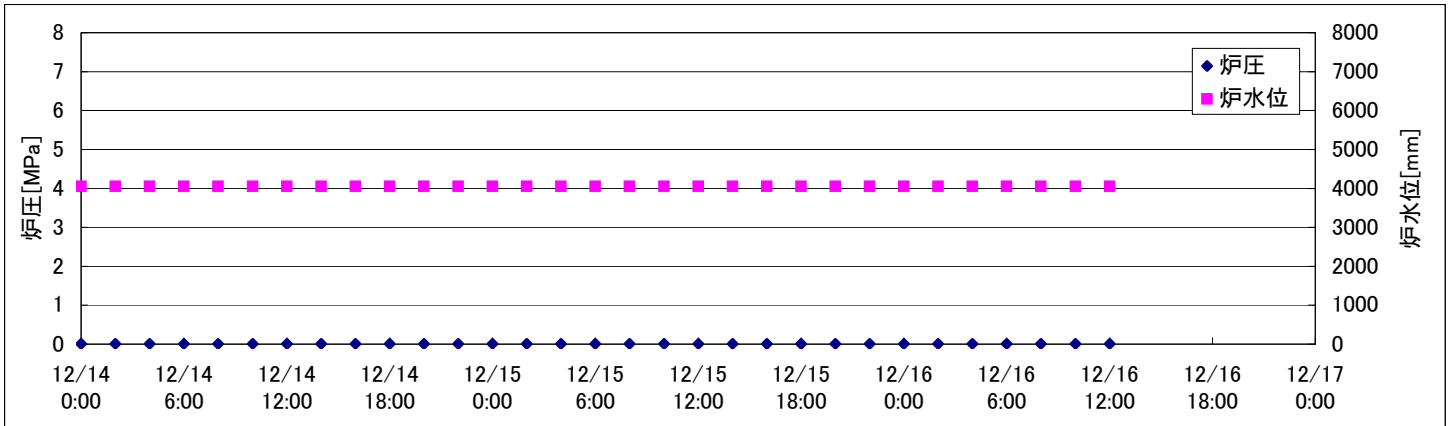

2F-4号機

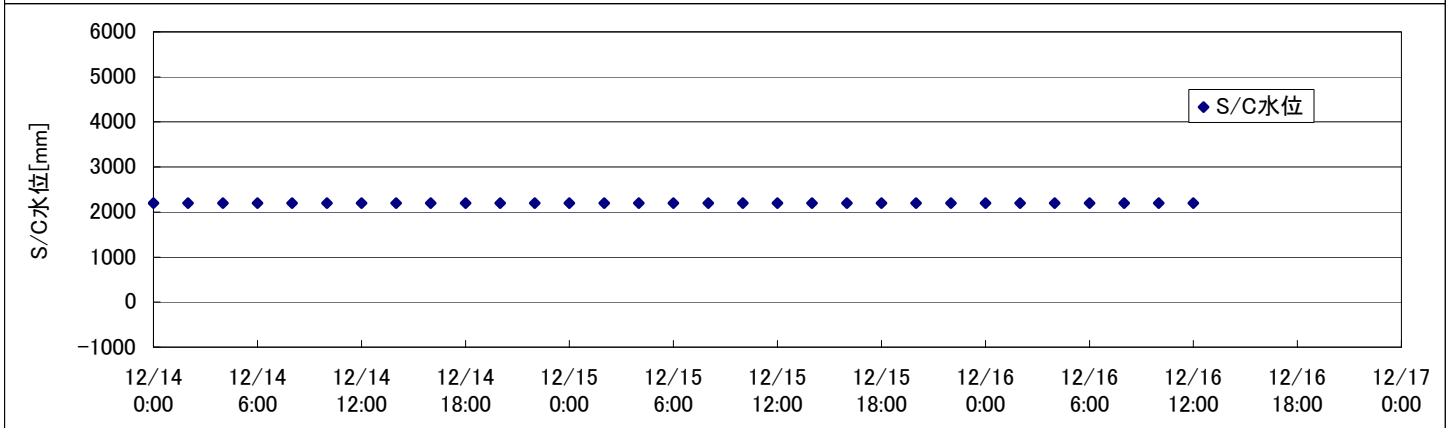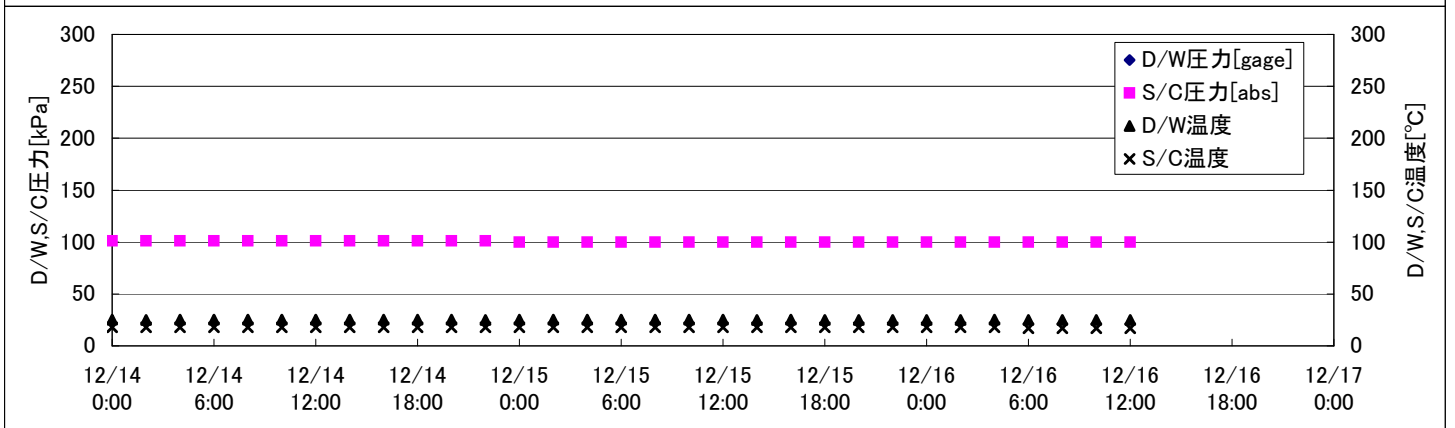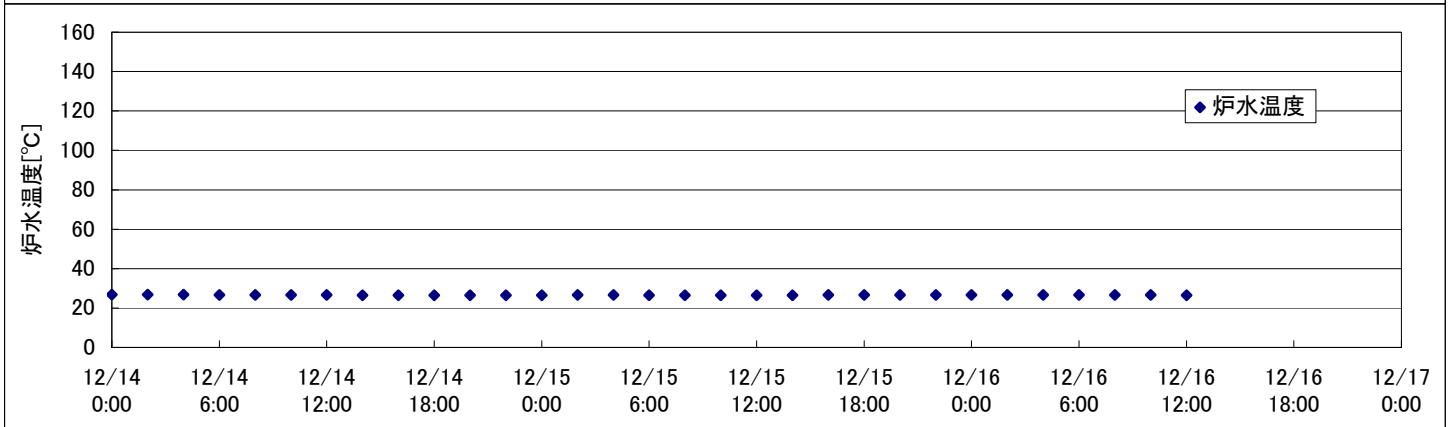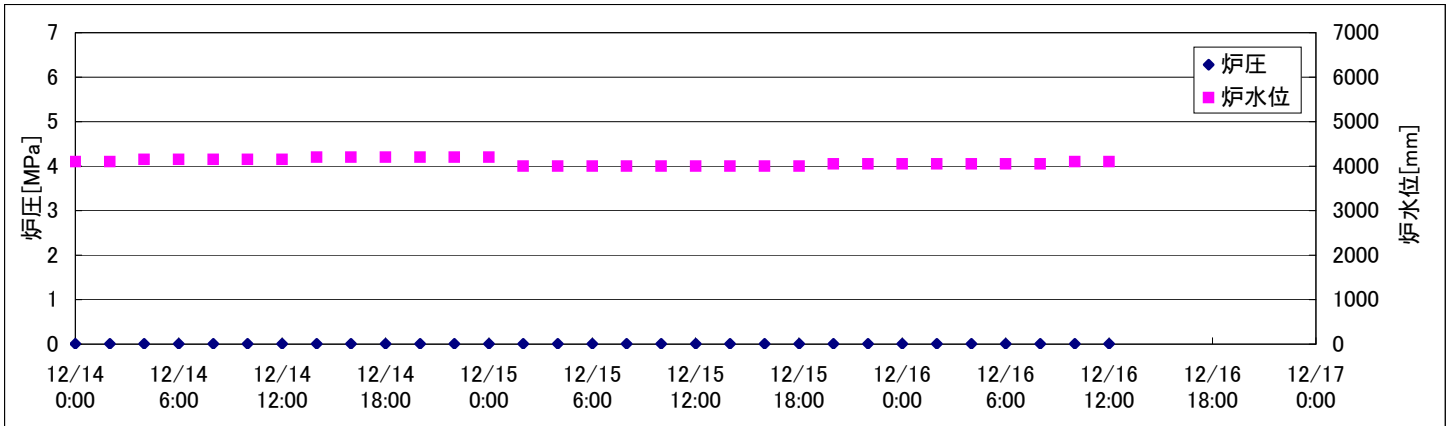

2F-4号機

※燃料頂部(TAF)からの水位 = 炉水位 + 4200[mm]

時間	炉圧 [MPa (gage)]	炉水位 [mm] 停止時	炉水温度[°C]	D/W圧力 [kPa(gage)]	D/W温度 [°C]	S/C圧力 [kPa(abs)]	S/C水位 [mm]	S/C温度 [°C]
2011/12/14 0:00	0.01	4100	26.8		25.4	101	2200	18
2011/12/14 2:00	0.01	4100	26.8		25.1	101	2200	18
2011/12/14 4:00	0.01	4150	26.8		25.3	101	2200	18
2011/12/14 6:00	0.01	4150	26.7		25.3	101	2200	18
2011/12/14 8:00	0.01	4150	26.6		25.3	101	2200	18
2011/12/14 10:00	0.01	4150	26.6		25.2	101	2200	18
2011/12/14 12:00	0.01	4150	26.6		25.2	101	2200	18
2011/12/14 14:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 16:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 18:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 20:00	0.01	4200	26.5		25.2	101	2200	18
2011/12/14 22:00	0.01	4200	26.5		25.1	101	2200	18
2011/12/15 0:00	0.01	4200	26.5		25.2	100	2200	18
2011/12/15 2:00	0.01	4000	26.6		25.3	100	2200	18
2011/12/15 4:00	0.01	4000	26.6		25.3	100	2200	18
2011/12/15 6:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 8:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 10:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 12:00	0.01	4000	26.5		25.2	100	2200	18
2011/12/15 14:00	0.01	4000	26.5		25.1	100	2200	18
2011/12/15 16:00	0.01	4000	26.6		25.2	100	2200	18
2011/12/15 18:00	0.01	4000	26.6		25.1	100	2200	18
2011/12/15 20:00	0.01	4050	26.6		25.0	100	2200	18
2011/12/15 22:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 0:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 2:00	0.01	4050	26.6		25.1	100	2200	18
2011/12/16 4:00	0.01	4050	26.6		25.2	100	2200	18
2011/12/16 6:00	0.01	4050	26.6		25.0	100	2200	17
2011/12/16 8:00	0.01	4050	26.6		25.0	100	2200	17
2011/12/16 10:00	0.01	4100	26.6		25.1	100	2200	17
2011/12/16 12:00	0.01	4100	26.5		25.1	100	2200	17
2011/12/16 14:00								
2011/12/16 16:00								
2011/12/16 18:00								
2011/12/16 20:00								
2011/12/16 22:00								
2011/12/17 0:00								

D/W圧力について
 ・パーソナルエアロックドア開放中であるため、9/6 10:00 より記載せず