

# Status of Unit 3, Ikata NPP (As of 16:30 JST November 28)

## Status of Reactor : Automatically stopped

|             |         |
|-------------|---------|
| ① Reactor   |         |
| Pressure    | 7.29Mpa |
| Temp.       | 206.8°C |
| Water level | 102.5mm |


|                            |         |
|----------------------------|---------|
| ② Containment Vessel (C/V) |         |
| Pressure                   | 23.6kPa |
| Temp.                      | 51.9°C  |

③ Power

External power Diesel generator Other power (Standing-Mobile Specialized safety facility)

④ Spent fuel pool (SPF)

High pressure Low pressure low alternative pressure

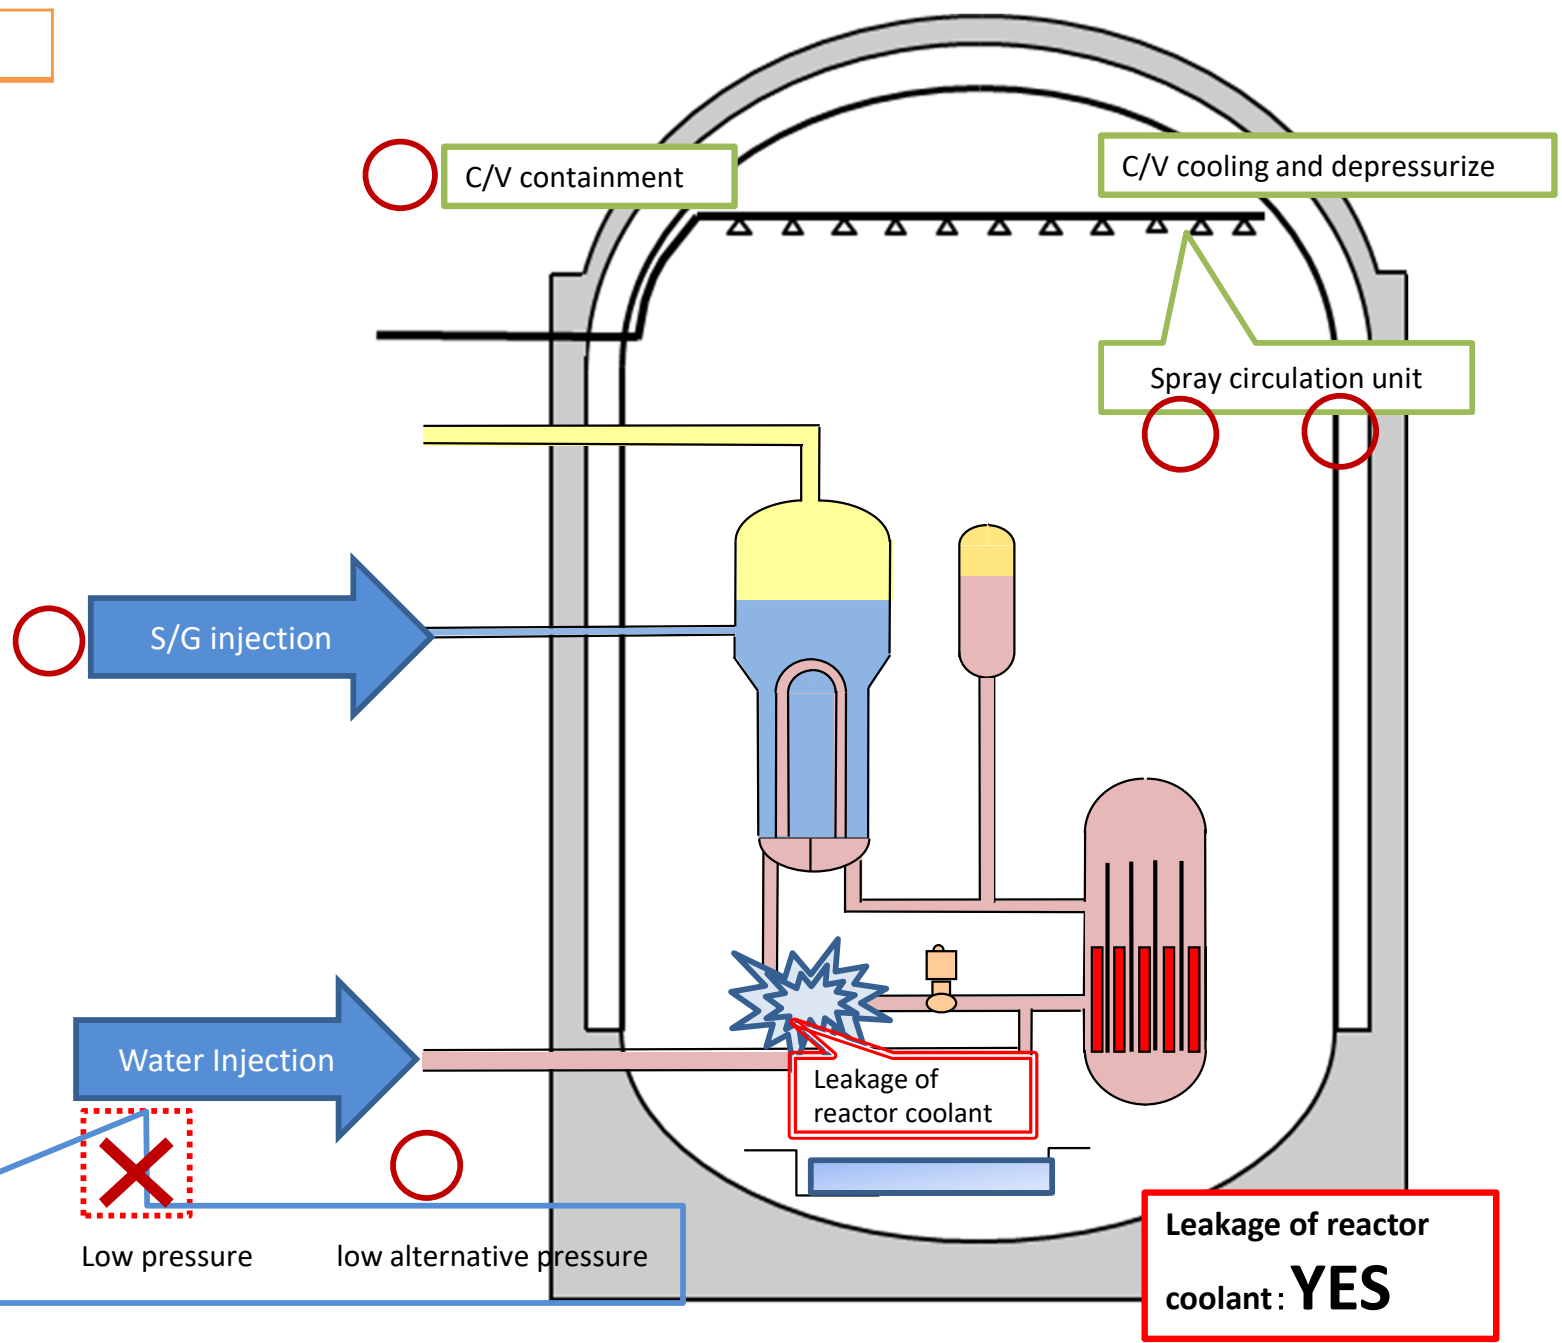

○ : no abnormality (in operation・standby)    × : Loss of function/no availability    ■ : unknown/confirming    ⬜ (dashed) : revised points